

STATEMENT OF NO BID

NOTE: If you DO NOT intend to bid on this commodity or service, please complete and return this form immediately. Your response will assist us in evaluating all responses for this important project and to improve our bid solicitation process.

The Purchasing/Risk Management Division of the City of Kalamazoo wishes to keep its bidders list file up to date. If, for any reason you cannot supply the commodity/service noted in this bid solicitation, this form must be completed and returned to remain on the particular bid list for future projects of this type.

If you do not respond to this inquiry within the time set for the bid opening date and time noted, we will assume that you can no longer supply this commodity/service, and your name will be removed from this bid list.

- _____ Specifications too "tight", i.e. geared toward one brand or manufacturer only (explain below).
- _____ Specifications are unclear (explain below).
- _____ We are unable to meet specifications.
- _____ Insufficient time to respond to the Invitation for Bid.
- _____ Our schedule would not permit us to perform.
- _____ We are unable to meet bond requirements.
- _____ We are unable to meet insurance requirements.
- _____ We do not offer this product or service.
- _____ Remove us from your bidders list for this commodity or service.
- _____ Other (specify below).

REMARKS: _____

SIGNED: _____ NAME: _____
(Type or Print)

TITLE: _____ DATE: _____

FIRM NAME: _____
(if any)

ADDRESS: _____
(Street address) (City) (State) (Zip)

PHONE: _____ FAX: _____

EMAIL: _____

**SECTION I
INSTRUCTIONS TO BIDDERS**

1. **EXAMINATION OF BID DOCUMENT**-Before submitting a bid, bidders shall carefully examine the specifications and shall fully inform themselves as to all existing conditions and limitations. The bidder shall indicate in the bid the sum to cover the cost of all items included on the bid form.
2. **PREPARATION OF BID**-The bid shall be legibly prepared in ink or typed. If a unit price or extension already entered by the bidder on the Bid and Award form is to be altered, it shall be crossed out and the new unit price or extension entered above or below and initialed by the bidder with ink. The bid shall be legally signed, and the complete address of the bidder given thereon.

All bids shall be tightly sealed in an envelope plainly marked **SEALED BID** and identified by project name, bid opening date and time. Bids opened by mistake, due to improper identification, will be so documented and resealed. The Purchasing Division will maintain and guarantee confidentiality of the contents until the specified opening date and time. Bids submitted electronically will not be accepted.

3. **EXPLANATION TO BIDDERS**-Any binding explanation desired by a bidder regarding the meaning or interpretation of the Invitation for Bids (IFB) and attachments must be requested in writing, **at least 5 business days before the bid opening** so a reply may reach all prospective bidders prior to the submission of bids. Any information given to a prospective bidder concerning the IFB will be furnished to all prospective bidders as an amendment or addendum to the IFB if such information would be prejudicial to uninformed bidders. Receipt of amendments or addenda by a bidder must be acknowledged in the bid by attachment, or by letter or fax received before the time set for opening of bids. Oral explanation or instructions given prior to the opening will not be binding.
4. **CASH DISCOUNTS**-Discount offered for payment of less than thirty (30) days will not be considered in evaluating bids for award. Offered discounts of less than thirty (30) days will be taken if payment is made within the discount period, even though not considered in evaluation of the bid.
5. **WITHDRAWAL OF BIDS**-Bids may be withdrawn in person by a bidder or authorized representative, provided their identity is made known and a receipt is signed for the bid, but only if the withdrawal is made prior to the exact time set for receipt of bid. No bid may be withdrawn for at least ninety (90) days after bid opening.
6. **ALTERNATE BIDS**-bidders are cautioned that any alternate bid, unless specifically requested or any changes, insertions or omissions to the terms and conditions, specifications or any other requirement of this IFB may be considered non-responsive, and at the option of the City, result in rejection of the alternate bid.
7. **LATE BIDS**-Any bid received at the office designated herein after the exact time specified for receipt will not be considered. (Note: The City reserves the right to consider bids that have been determined by the City to be received late due to mishandling by the City after receipt of the bid and no award has been made.)
8. **UNIT PRICES**-If there is a discrepancy between unit prices and their extension, unit prices shall prevail.
9. **BID SUBMITTAL**- Bidders can submit sealed bids in one of the following ways:
 - 9.1. **Mail your bid**, to be received before the bid due date and time indicated in the bid document, to the City of Kalamazoo at the following address:

CITY OF KALAMAZOO – INVITATION FOR BID
Demolition of 3 Houses & 1 Garage

City of Kalamazoo
Purchasing Division
241 West South Street

Kalamazoo, MI 49007

- 9.2. **Deliver your bid to City Hall In-Person** before the bid due date and time indicated in the bid document.
- 9.3. **Deliver your bid to the Treasurer’s Office Payment Drop Box** located in the northwest corner of City Hall (see photos below) before the bid due date and time indicated in the bid document.



1. Open drop box located at City Hall.



2. Insert SEALED BID here.



- 10. **BID TABULATIONS-** The Purchasing Division makes an effort to post bid tabulations to the City of Kalamazoo website within 24 hours after the bid opening date and time at: <https://www.kalamazoo.org/bidopportunities>. However, in certain cases the posting of the bid tabulation may extend beyond the 24-hour window.

**SECTION II
BID AND AWARD**

The undersigned having become thoroughly familiar with the project and sites, location conditions affecting the work and understanding all of the special requirements, terms and condition incorporated herein, agrees to perform the demolition work in strict accordance with all the requirements of these documents and all governing statutes, ordinances, rules and regulations as written now and as may be amended, including but not limited to Chapter 9, Article VI, Sections 9-251 through 9-313 of the City of Kalamazoo Code of Ordinance and to provide and furnish all the equipment, labor and materials necessary to complete in a professional manner all work required for the lump sums as stated below:

SCOPE OF WORK/ PROJECT DESCRIPTION

The project includes complete demolition and removal of the buildings/structures listed below and restoration of the project site following the general specifications detailed in Section III: SPECIAL INSTRUCTIONS FOR RESIDENTIAL DEMOLITION. SPECIAL INSTRUCTIONS FOR RESIDENTIAL AND LIGHT COMMERCIAL DEMOLITIONS.

Professional surveys/inspections of these structures have been completed to determine presence, types, quantities and locations of asbestos-containing materials (ACM), mercury, and household hazardous waste unless otherwise noted as PACM. A partial report will be distributed to each firm attending the Pre-Bid Inspection. Proper removal of any and all such materials shall be the responsibility of the successful demolition bidder and all costs for removal shall be included in the bid for each site. Please invite any potential sub-contractors to attend pre-bid inspections. All structures are wood frame houses on basement unless noted otherwise. Area given is total floor area as shown in City Assessor database.

<u>ITEM</u>	<u>ADDRESS/LOCATION</u>	<u>DESCRIPTION</u>	<u>BID AMOUNT</u>
1.	1423 N Edwards Street	1,574 sq. ft, 2 story 440 sq. ft, garage	\$ _____
2.	518 W North Street	1,551 sq. ft, 2 story	\$ _____
3.	750 Skinner Drive	845 sq. ft, 1.5 story	\$ _____
4.	*1011 Cobb Avenue	400 sq. ft (Garage Only)	\$ _____
GRAND TOTAL OF ALL 4 LINE-ITEM PRICES ABOVE			\$ _____
DISCOUNTED TOTAL (if awarded <u>all</u> project sites)			\$ _____

*Contractor will need to check for any electrical to each garage and include disconnect charges in the bid amount.

Note: This is for demolition of garages only and owners currently reside in each house.

For additional details and specifications, See - Section III: Special Instructions for Residential and Light Commercial Demolitions; Section IV: Special Requirements - Demolition.

Work shall start within twenty (20) calendar days after receipt of the NOTICE TO PROCEED and the first line item shall be substantially completed no later than twenty-five (25) calendar days after commencement. Each additional item for each contract shall be substantially completed within a maximum of one week after completion of the previous item.

The bidder understands that no work may commence until all bonds, permits, licenses and certificates of insurance have been obtained and all fees paid. Said documents shall be obtained within ten (10) days after receipt of **NOTICE OF AWARD**. The bidder agrees to complete all work detailed herein and to conform with the terms of this contract and all applicable laws, ordinances, rules and regulations within the schedule outlined above.

Failure to obtain all required documents within ten (10) days of the receipt of notice of award, or failure to complete all required work within the time specified above shall constitute breach of this contract and justify cancellation by the City. Upon cancellation of the contract, the bidder shall be liable to the City for any increased cost caused by the bidder's breach. Bidders declared in breach will also be removed from the active bidders list maintained by the department until such time as any costs have been reimbursed to the City and/or the matter is otherwise fully resolved to the satisfaction of the City.

Bidder/Contractor has examined and carefully studied the bidding documents and attachments, and acknowledges receipt of the following addenda:

Addendum No: _____

Dated: _____

Bidder shall provide all of the information as requested herein with their bid. **Failure to do so and/or failure to provide post-bid requested information may be cause for rejecting the bid as non-responsive.**

By my signature below, I certify that the firm bidding on this contract, when making hiring decisions, does not use a past criminal conviction as a bar to or preclude a person with a criminal conviction from being considered for employment with the bidding firm unless otherwise precluded by federal or state law. I further certify that I have read and agree to be bound by the provisions of the City's Non-Discrimination Clause found in Appendix A.

Signed: _____ Name: _____

Title: _____

QUALIFICATIONS OF BIDDERS

1. To demonstrate Bidder's qualifications to perform the Work, provide the following as a supplement to your bid. If Bidder will be subcontracting asbestos abatement services, Bidder shall also provide the following for the asbestos subcontractor. OWNER reserves the right to require bidders to submit additional information as OWNER deems necessary to satisfy OWNER that the bidders are adequately prepared to fulfill all provisions of the contract and as to which bidder should be awarded the contract. Failure to provide information requested within the time frames established by the OWNER will subject the bidder to disqualification of the bid.
 - Description of Contractor's experience with projects of comparative size, complexity, and cost. Specify projects, name of project manager, owners and locations of projects, dates of each project completion. A reference name and current contact phone number for each project must be provided.
 - Provide a listing of equipment that will be dedicated to this project. Written certification that the equipment owned and/or leased by the bidder that will be utilized on the project will conform to all safety requirements required by Michigan and federal law, regulations, and codes.
 - Provide names and addresses of licensed or permitted facilities for recycling or disposal of all wastes and construction debris that will be used at this site.

2. OWNER retains the right to take into account factors others than those set forth in the bid specifications in evaluating and qualifying bidders. Contractor shall provide the information below. Failure to provide requested information will subject the bidder to disqualification of the bid. These factors include, but are not limited to the following:
 - Projects involving the bidder for which performance was and/or not delivered on time;
 - Fines and penalties imposed on the bidder for any projects in the last five (5) years;
 - State, Federal and local environmental violations in the last five (5) years;
 - Liens filed against bidder in the last five (5) years;
 - Suspension or revocations of any professional license of any director, officer, or managerial employee of the bidder, to the extent that any work to be performed is within the field of such licensed profession;
 - OSHA violations by the bidder or bidder's subcontractors within the last five (5) year (including Michigan MIOSHA or other state occupational or construction health and safety laws or regulations), as well as all notices of OSHA or other health and safety citations filed against bidder, together with a description and explanation of remediation or other steps taken regarding such violations and notices of violations;
 - Litigation or arbitration cases in which bidder has been a defendant or third party related to any construction or demolition project in which it has been engaged within the previous five (5) years;
 - Violations, if any, of prevailing wage laws or other wage and hour law violations, including, but not limited to, child labor violations, failure to pay wages, or unemployment insurance tax delinquencies within the past five (5) years;
 - Criminal convictions related to the construction or demolition business of bidder, its officers, directors, and/or managerial employees, within the past five (5) years;

SUB-CONTRACTING INFORMATION

Using the table below provide information regarding the sub-contractors that will be working to fulfill the requirements of this contract. Submit as complete a list as possible at the time of your proposal. You will have two business days after the proposal opening to update the list as needed. The information provided will be used for evaluating your proposal and to assist in determining if you qualify as a Kalamazoo County Bidder.

INSTRUCTIONS:

Nature of Contract - State a brief description of the work or product that will be provided.

BIDDER – Provide the percentage of services or construction activity that will be provided by your firm.

Subcontractors:

- Provide the Name and Address for each subcontractor providing services or construction activities for this contract.
- Provide the percentage for the dollar amount of the contract work they will be performing.

If there are not enough lines in the table below make additional copies as needed.

Subcontractor Name/Address	% Of Total Contract
BIDDER	

Does this List of Subcontractors need to be updated after the proposal opening? **Yes** ___ **No** ___

REFERENCE QUESTIONNAIRE

Please answer the following questions completely.

1. Firm name: _____
2. Established: Year _____ Number of Employees: _____
3. Type of organization:
 - a. Individual: _____
 - b. Partnership: _____
 - c. Corporation: _____
 - d. Other: _____
4. Former firm name(s) if any, and year(s) in business:

5. Include at least 3 references of contracts for similar work performed over the last five (5) years. Include: owner, contact person and phone number and description of work performed.
 - 5.1 Company Name: _____
Address: _____
Phone: _____
Contact: _____
Type of work or contract: _____
 - 5.2 Company Name: _____
Address: _____
Phone: _____
Contact: _____
Type of work or contract: _____
 - 5.3 Company Name: _____
Address: _____
Phone: _____
Contact: _____
Type of work or contract: _____

I hereby certify that all of the information provided is true and answered to the best of my ability.

Signed: _____ Name: _____
(type or print)
Title: _____ Date: _____

CITY OF KALAMAZOO EX-OFFENDER POLICY CHECKLIST

As part of the City's commitment to reducing unacceptable poverty, encouraging rehabilitation, reducing recidivism and strengthening families in Kalamazoo, the City has updated its Purchasing Policy to ensure that firms with whom the City does business share in this commitment by utilizing hiring practices that do not unfairly deny people with arrest and conviction records gainful employment. *(Important: This requirement also extends to any subcontractors the bidder intends to use to fulfill the contract for goods or services being sought from the City.)*

Part I: Proof that the bidder does not inquire about an individual's past arrest or criminal history on the bidders employment application form

- Attach a copy of the current application for employment being used by the bidder

Part II: Certification that the bidder does not use an individual's past arrest or criminal history to unlawfully discriminate against them by checking *one or more* of the following:

- That pursuant to federal or state law bidder is precluded from hiring persons with certain criminal records from holding particular positions or engaging in certain occupations by providing a cite to the applicable statute or regulation; if checking this box, provide a citation to the applicable statute or rule upon which the bidder is relying:_____
- That bidder conducts criminal history background checks only as necessary, and only after making a conditional offer of employment; that any withdrawal of an offer of employment to an individual because of a past criminal history is job-related and consistent with business necessity after the individual has been provided an individualized assessment opportunity to review and challenge or supplement the history of past criminal conduct being relied upon by the bidder;
- That the use by bidder of criminal history background checks complies with the U.S. Equal Employment Opportunity Commission's Enforcement Guidance on the Consideration of Arrest and Conviction Records in Employment Decisions and that the bidder has not had a determination rendered against it in past 7 years that it discriminated against a person through the use of an individual's arrest or criminal history

I CERTIFY THAT THE ABOVE STATEMENTS ARE TRUE.

Date

Signature

Printed Name

Position

CITY OF KALAMAZOO – INVITATION FOR BID
Demolition of 3 Houses & 1 Garage

Page 9
Bid Reference No: 91240-023.0

I hereby state that all of the information I have provided is true, accurate and complete. I hereby state that I have the authority to submit this bid which will become a binding contract if accepted by the City of Kalamazoo. I hereby state that I have not communicated with nor otherwise colluded with any other bidder, nor have I made any agreement with nor offered/accepted anything of value to/from an official or employee of the City of Kalamazoo that would tend to destroy or hinder free competition.

The firm's identification information provided will be used by the City for purchase orders, payment and other contractual purposes. If the contractual relationship is with, or the payment made to, another firm please provide a complete explanation on your letterhead and attach to your bid. Please provide for accounts payable purposes:

Tax Identification Number (Federal ID): _____

Remittance Address: _____

Financial Contact Name: _____ Financial Contact Phone Number: _____

Financial Contact Email Address: _____

I hereby state that I have read, understand and agree to be bound by all terms and conditions of this bid document.

SIGNED: _____ NAME: _____
(Type or Print)

TITLE: _____ DATE: _____

FIRM NAME: _____
(if any)

ADDRESS: _____
(Street address) (City) (State) (Zip)

PHONE: _____ FAX: _____

EMAIL ADDRESS: _____

FOR CITY USE ONLY - DO NOT WRITE BELOW

SECTION III
SPECIAL INSTRUCTIONS FOR RESIDENTIAL & LIGHT COMMERCIAL DEMOLITIONS

1. All demolition work shall comply with Chapter 9, Article VI, subsections 9-251 through 9-313 of the City of Kalamazoo Code of Ordinances, and all laws, rules and regulations as now written and as amended from time to time. In addition, all demolitions shall conform to the following general specifications. Additional specifications and requirement details are shown on the bid and award page.
2. The City will make reasonable efforts to close all included buildings and structures and to maintain them closed to casual entry from the time of Pre-Bid Inspection until issuance of the Notice To Proceed. Once the Notice to Proceed has been issued, it shall be the responsibility of the Contractor to provide and maintain site security.
3. All fixtures, fittings, furnishings, trash, and other materials in or upon the demolition site and all specified structures become the property of the successful bidder at the time of issuance of the Notice to Proceed.
4. All demolitions shall include removal of all structures (including detached accessory structures) at each site as well as poles, posts, interior fences, slabs on grade, private sidewalks and drives.
5. All demolitions shall include removal of all basement wall, floor, and footing materials and all sub-grade masonry structures (e.g. cisterns, dry wells, vaults, etc.) as specified or encountered during work.
6. Contractors shall **prevent migration of demolition dust** into areas adjacent to the project site by **continuous, generous, and effective application of water** or other effective measures during on-site demolition work **regardless of air temperature**. Any amending agents added to water used to control dust shall be listed as inert or non-polluting. Water used for dust control shall not migrate into or otherwise physically impact areas adjacent to the project site unless prior written approval is obtained from owners of that adjacent property after agreement on mitigating measures to prevent and/or reverse damage to that adjacent property. A copy of any such approval/agreement shall be presented to the City of Kalamazoo Project Manager prior to the commencement of demolition activity. No public water source will be available at the demolition site. Use of City hydrant water is very unlikely. Contractors may contact the Water Division of Public Services (269-337-8729) to discuss availability of bulk water at a central public tap.
7. Unless otherwise specified herein, all residential demolitions shall include all costs to remove any asbestos-containing materials (ACM) or other hazardous waste material present at each site. All removal shall be performed in strict conformance with Michigan Dept. of Public Health regulations, EPA regulations, DNRE regulations, OSHA regulations, the attached Special Demolition Requirements for Asbestos and Hazardous Material/Waste, and all other relevant laws, ordinances, and regulations as adopted and effective prior to the NOTICE OF AWARD. **Copies of all associated notices and required documentation shall be provided to the City prior to final invoicing.**

8. Trees, bushes, and other plantings on site having trunks measuring six (6) inches or less diameter at five (5) feet vertical distance above existing grade, may be removed to facilitate demolition. No other vegetation may be removed except as specified in the SCOPE OF WORK/PROJECT DESCRIPTION in Section III, or after other written authorization.
9. Unless instructed otherwise, trees marked by the City for removal by the demolition contractor shall be felled within the boundaries of project property. Trunks shall be cut no higher than two (2) feet above grade as needed to allow stump removal. Prior to any stump removal, a barricade shall be installed surrounding the stump sufficient to prevent flying debris from leaving the project site and to contain all wood chips to be generated. All wood chips shall be removed from the project site and disposed of properly. Stumps shall be removed to a depth of at least twelve (12) inches below final grade. The resulting depression/excavation shall be filled with top dirt and seeded as detailed below for the balance of the site.
10. Once demolition has begun and any site will be left unsupervised, a secure fence of at least four (4) feet in height shall be installed and maintained around the entire perimeter of that site so as to prevent unauthorized access to the site when left unsupervised until excavations have been substantially filled. The fence must be sufficiently visible in any light condition. NOTE: A site free of debris where the excavated area has been partially filled and there is no slope greater than a natural slope (45 degrees) need not be fenced when left unsupervised.
11. Adjacent sidewalks and other public areas shall be properly blocked and protected during demolition as needed by means of substantial barricades, fences, and signage. Barricades remaining during periods of darkness shall have lights.
12. Public streets shall not be blocked except as specifically approved in writing prior to such blockage by the Department of Public Works (269-337-8612).
13. Private streets or shared drives shall not be blocked except that the blockage is approved by each property owner in interest prior to the blockage. Written verification of all approvals shall be provided to the City prior to the blockage.
14. Prior to and during demolition and site restoration activities, public utility lines and equipment and other public improvements shall be protected to prevent damage or interruption of service.
15. The City of Kalamazoo will photo-document the condition of all public walks, curbs, and other public improvements in the vicinity of the demolition site immediately prior to issuance of the Notice To Proceed and will share those images and discuss conditions at the request of the contractor. Public sidewalks, curbs, or other improvements damaged by Contractor's equipment or otherwise as a result of demolition activities shall be promptly repaired or replaced at contractor's expense. Replacement sidewalks and curbs shall be constructed in accordance with standards and regulations of the Department of Public Works.
16. All materials shall be handled, stored, moved, removed and disposed of systematically as the demolition progresses to prevent the creation of a fire hazard or danger to the public. **Contractor shall list the site(s) that will be used for disposal of waste from each site on the required Application for Permit to Wreck. Copies of disposal tickets must be supplied to the City. Failure to provide this information will delay payment until received.**

17. All portions of buildings and property improvements shall be demolished and removed from the site unless otherwise agreed in writing. Prior to filling, Contractor shall arrange for an inspection of the site by the City to verify that all demolition materials have been removed and any utility lines have been properly capped and marked.
18. Water and sewer leads shall be properly capped or plugged in accord with the requirements of the Department of Public Works. Sewer lines shall be permanently sealed/plugged at least five (5) feet outside the perimeter of the building foundation. Water utility lines shall be sealed/capped at least five (5) feet outside the perimeter of the building foundation and marked by placement of a ferrous rod at least four feet in length extending vertically from the capped end of the water pipe to no more than six (6) inches below final grade.
19. Excavations shall be promptly filled with clean inorganic fill, compacted in lifts not exceeding eighteen (18) inches. The final (top) six (6) inches of fill shall consist of clean top soil neatly graded to match the existing perimeter topography of the site and raked in preparation for seeding.
20. All imported fill soil(s) shall be subject to the approval of the Demolition Project Manager.
21. All exposed earth shall be thoroughly seeded with grass seed consisting of approximately 70% tall fescue, 20% perennial rye, and 10% Kentucky blue grass applied at a rate of 100 pounds per acre, then covered with straw or other equivalent approved natural material sufficient to minimize soil erosion.
22. All bonds, permits, licenses, or certificates of insurance required for the performance of the work specified herein shall be obtained and paid for by the Contractor and proof of same provided to the Code Administration Division no later than ten (10) calendar days after Notice of Award. No work shall commence until all required permits, licenses have been obtained by the Contractor and, when required, approved by the City, and/or until all required fees have been paid. **NO PERMIT SHALL BE ISSUED UNTIL ALL DOCUMENTS REQUIRED BY THIS CONTRACT OR BY GOVERNING STATUTE, ORDINANCE, LAW, RULE OR REGULATION HAVE BEEN OBTAINED AND ALL REQUIRED FEES PAID.** Failure to meet any one or more of these requirements shall constitute breach of contract and justify cancellation of the contract by the City of Kalamazoo.

SECTION IV
SPECIAL REQUIREMENTS - DEMOLITION

1. ASBESTOS AND HAZARDOUS MATERIAL/WASTE

- 1.1 The City will provide information documenting the nature, amount(s), and location(s) of any asbestos or other hazardous waste or substances confirmed through professional inspection and analysis to be present at the project site.
- 1.2 During inspection of work site(s) by the bidder(s), each shall confirm presence of any asbestos or other hazardous waste material in, on, or near the building to be demolished that is included in the survey documents and shall make allowance for its abatement and/or removal in the lump sum price bid and state any and all sub-contractor(s) that may be required, see Bid & Award page(s).
- 1.3 In the event that unforeseen hazardous waste material is encountered by the contractor, work in that general area shall cease until a Demolition Change Order has been completed that details scope, method, and terms for its treatment.
- 1.4 Whether asbestos or any other hazardous material was included in the survey documents or discovered subsequent to Notice of Award, items 2 through 7 below must be followed.

2. SCOPE - HAZARDOUS WASTE MATERIAL

This project includes supplying all labor, materials, tools, equipment, supplies, permits, notices, receipts, disposal fees and all other incidental fees and costs associated with the lawful removal, transportation and disposal of hazardous waste material.

3. PRECAUTION

The Contractor shall use all due precaution in handling, removal, transportation, storage and disposal of all hazardous material to avoid any possibility of accident or harm to domestic animals, wildlife, air, water soils, the environment and to humans whatsoever.

4. TRANSPORTATION

The Contractor shall lawfully transport the hazardous material to the disposal site and to the temporary storage site, if needed. All licenses, fees and other incidental costs associated with transportation shall be the responsibility of the Contractor. The Contractor shall abide by all applicable load restrictions, traffic regulations and ordinances to ensure safe and proper transportation. The Contractor shall cover all of the hazardous material during transport to disposal site.

5. TEMPORARY STORAGE

The Contractor shall provide for lawful disposal of the hazardous material if needed. It is the responsibility of the Contractor to acquire any and all necessary approvals from all governmental units having jurisdiction over the temporary storage site. The temporary storage site selected by the Contractor shall be subject to the approval of the City.

6. DISPOSAL

The Contractor shall provide for lawful disposal of the hazardous material. All required notices shall be filed and all applicable state, federal, and local permits shall be secured by the Contractor prior to loading, unloading and disposal of the hazardous material at the earliest possible date without delay. The Contractor shall be required by the City to participate in a manifest system with the purpose of accounting for each load of hazardous material removed. The manifest forms will be supplied by the Contractor and will require the Contractor to secure the signature of the transporter and disposal site operator verifying that the hazardous material has been properly transported, received and disposed of. **Copies of all hazardous waste disposal manifests associated with this project must be submitted to the City by the demolition contractor prior to or along with final request for payment.** Any failure of the Contractor to account for each and every load of hazardous material shall be deemed to be a violation of the terms of this contract and just cause for default of contract and prosecution to the fullest extent possible under the law.

7. CONTAINERS

The Contractor shall supply containers for use in the temporary storage and/or transport of the hazardous material when required. Any container lining deemed necessary by the Contractor or the City for effective disposal shall be supplied by the Contractor. The Contractor shall furnish and use container covers for use in the transport and temporary storage if deemed necessary by the City or required by law and ordinance.

Any and all containers, as may be required by law, shall conform, be labeled, placed, moved, handled and transported in accordance with all local, state and federal laws, rules and regulations.

8. WAIVERS OF LIEN

Upon completion of all work and request for final payment, the Contractor shall furnish a 100% waiver of lien from each supplier and sub-contractor covering all items of the work. Failure to supply waivers of lien for the entire job upon completion and final payment request will be considered grounds for withholding final payment.

9. SUBCONTRACTORS

Contractors shall state on the Bid and Award pages any and all subcontractors to be associated with their bid, including the type work to be performed. Any and all subcontractors shall be bound by all of the terms, conditions and requirements of the contract; however, the prime Contractor shall be responsible for the performance of the total work requirements.

GENERAL CONDITIONS

1. PROJECT MANAGER

- 1.1 The Project Manager or his/her duly authorized representative shall have the duties and responsibilities as provided in the contract.
- 1.2 The Project Manager shall have the authority to reject any work or materials that do not conform to the contract and to decide questions or make interpretations that may arise from the contract documents.
- 1.3 The Contractor shall immediately report to the Project Manager any questionable or obvious error or omission that may be apparent in the contract documents and shall not proceed with work until the Project Manager or his/her representative has resolved the error or omission.
- 1.4 The Project Manger shall have authority to stop work whenever such stoppage may be necessary to ensure the proper execution of the contract.

2. DEMOLITION SCHEDULE AND COORDINATION

- 2.1 TIME IS OF THE ESSENCE in respect to the work contemplated herein, and the Contractor agrees to do the work covered by the contract in conformity with the provisions set forth herein. Failure on the part of the Contractor to complete the work within the stated time he/she has set for and agreed to herein, shall constitute default by the Contractor. Regardless of any other provision of this contract, if Contractor fails to complete the work within the time he/she has set forth and agreed to herein, the Contractor may be liable to the owners(s) for any damages incurred by the owner(s).
- 2.2 The Contractor shall supply the City with an agreeable work schedule before commencing work on this contract. This schedule shall detail beginning and completion dates for each major component of the project.
- 2.3 The Contractor shall coordinate and cooperate with all other contractors who may be working on the site in order to allow for the orderly progress of work being done.
- 2.4 The Contractor is required to keep the Project Manager fully informed of any proposed work that will tend to interfere with the existing operations at the site.
- 2.5 The Contractor shall schedule all work to accommodate the Homeowner and City's schedule. In the event Contractor's schedule falls on weekends, nights or overtime work is required, no additional compensation will be allowed. All work shall be part of this contract without regard to when it is done.
- 2.6 The Contractor is responsible to schedule all work to accommodate each individual homeowner. Please be sure to check all electrical connections to each garage, which also includes disconnecting any live charges. ***Note: This is for demolition of garages only and owners currently reside in each house.***

3. PROTECTION OF WORK

The Contractor shall maintain adequate protection of all his/her work from damage and shall protect all public and private abutting property from injury or loss arising in connection with this contract. He/She shall provide and maintain all barricades, lights, fences, watchpersons or other facilities necessary to protect all persons from danger or hazardous conditions resulting from the work in the contract.

4. PROTECTION OF PROPERTY

4.1 The Contractor shall confine his/her equipment and operations to those areas of the work site necessary for the completion of the work, or as authorized by the Project Manager. The Contractor shall protect and preserve from damage any facilities, utilities or features including trees, shrubs and turf that are not required to be disturbed by the scope of work.

4.2 The Contractor shall be responsible for determining the location of and for protecting from damage any utilities or other improvements.

5. REMOVAL OF RUBBISH

The Contractor shall daily remove all rubbish and accumulated materials due to his/her construction.

6. RESPONSIBILITY OF CONTRACTOR

6.1 Contractor shall be responsible for his/her own work and every part thereof and all work of every description used in connection with this contract. He/She shall specifically and distinctly assume and does assume all risk of damage from any action or operations under the contract or in connection with his/her work. He/She undertakes and promises to protect and defend the owner(s) against all claims on account any such damage or injury.

6.2 The contractor shall be held responsible for the satisfactory and complete execution of the work in accordance with the true intent of the specifications. He/She shall provide, without extra cost incidental items required as a part of his/her work even though not particularly specified or indicated.

6.3 The contractor shall personally superintend the work or shall have a competent person at the site at all times to act for him/her.

7. SITE SECURITY

The Contractor shall be responsible for job site security of all materials and tools provided by him/her and no claim for loss or damage will be considered by the City.

8. SITE ACCESS

The City will provide fair and reasonable access to the job site within the working schedules of both parties.

9. MATERIALS INSPECTION AND RESPONSIBILITY

- 9.1 The Project Manager shall have the right to inspect any materials to be used in carrying out the terms of the contract.
- 9.2 Any materials, equipment, components or completed work which does not comply with contract specifications or applicable city and state codes may be rejected by the City, and shall be replaced by the Contractor at no cost to the City.
- 9.3 Any reference in these documents to standard specifications shall mean the latest revisions of these specifications and shall become a part of this contract. Any part of the work not completely detailed in these documents, or referenced to a standard specification, shall be governed by the latest edition of the proper industry document.

10. GUARANTEE

The Contractor shall guarantee all of his/her work for a period of one (1) year following the date of final acceptance of the completed work and shall repair, replace or make good any materials or work that fail to function or perform or be found defective, without cost to the city.

11. SAFETY

The Contractor shall comply with all applicable OSHA and MIOSHA regulations.

12. UNDERGROUND UTILITIES

For protection of underground utilities, the Contractor shall dial Miss Dig at 1-800-482-7171 a minimum of 72 hours prior to excavating in the vicinity of utility lines. All “Miss Dig” participating members will thus be routinely notified. This does not relieve the Contractor of notifying utility owners who may not be part of the “Miss Dig” alert system.

13. FOR DEMOLITION CONTRACTS

- 13.1 All protection and control devices within the area of demolition shall be considered as incidental to the completion of the work and no extra payment, therefore, will be made. For purposes of this contract, the area of demolition shall be considered any area in which work is in such a stage of demolition so that safe travel of the public is affected.
- 13.2 Streets/roads shall remain open for access to frontage properties, as much as practicable, where such will not unduly interfere with the prosecution of the work. The portion of the streets open to through traffic shall be maintained in a passable condition. The procedures shall follow MDOT 6.31 Maintaining Traffic, except that City supplied signs shall be limited to detours. Maintaining traffic is considered to be incidental to the work and no extra payment, therefore, shall be made.

14. DOCUMENT FEES AND NUMBER OF DAYS

All bonds, permits, licenses or certifications of insurance required for the performance of the work specified herein shall be obtained and paid for by the Contractor, and proof of same provided to the Purchasing Director within ten (10) days after notification of the contract award; all work under the contract shall be completed in compliance with the Kalamazoo City Code within ninety (90) days of when all permits, licenses and certificates should have been obtained and all fees paid as stated above.

15. ORDINANCE

ALL DEMOLITION WORK SHALL COMPLY WITH CHAPTER 9, ARTICLE VI, Subsections 9-251 through 9-313 of the Kalamazoo Code, statutes, ordinances, laws, rules and regulations as now written and amended from time to time.

16. VIRTUAL PRE-BID MEETING & INSPECTION OF PROJECT SITE

Before submitting bids for his/her work, the Contractor shall be responsible for examining the work site and satisfying himself/herself as to the existing conditions under which he/she will be obligated to operate, or that in any way affects the work under this contract. No allowance shall be made subsequently, on behalf of the Contractor, for any negligence on his/her part. A virtual pre-bid meeting is scheduled for **September 27, 2023 @ 11:00 a.m.** Then proceed to project sites at your own pace, open until 4:00 p.m. Click [here](#) to register in advance for this Zoom meeting. Questions may be emailed to Roger Iveson at ivesonr@kalamazoo.org by **3:00 p.m. on October 3, 2023.**

17. QUESTIONS

Questions concerning the building(s) to be demolished, the demolition site, SCOPE OF WORK/PROJECT DESCRIPTION, SPECIAL INSTRUCTIONS FOR RESIDENTIAL & LIGHT COMMERCIAL DEMOLITIONS, or SPECIAL REQUIREMENTS-DEMOLITION or laws and ordinances governing the demolition work may be directed to Roger Iveson, City Building Official at ivesonr@kalamazoo.org or (269) 337-8560. Questions regarding the bid or award process may be directed to Nicole Kling, Buyer at klingn@kalamazoo.org or (269) 337-8746.

**SECTION V
INDEMNITY AND INSURANCE**

Contractor, or any of their subcontractors, shall not commence work under this contract until they have obtained the insurance required under this paragraph, and shall keep such insurance in force during the entire life of this contract. All coverage shall be with insurance companies licensed and admitted to do business in the State of Michigan and acceptable to the City of Kalamazoo within ten (10) days of the Notice of Award. The requirements below should not be interpreted to limit the liability of the Contractor. All deductibles and SIR's are the responsibility of the Contractor.

The Contractor shall procure and maintain the following insurance coverage:

Workers' Compensation Insurance including Employers' Liability Coverage, in accordance with all applicable statutes of the State of Michigan.

Commercial General Liability Insurance on an "Occurrence Basis" with limits of liability not less than \$1,000,000 per occurrence and aggregate. Coverage shall include the following extensions: (A) Contractual Liability; (B) Products and Completed Operations; (C) Independent Contractors Coverage; (D) Broad Form General Liability Extensions or equivalent, if not already included and (E) XCU coverage if the nature of the contract requires XC or U work.

Automobile Liability in accordance with all applicable statutes of the State of Michigan, with limits of liability not less than \$1,000,000 per occurrence, combined single limit for Bodily Injury, and Property Damage. Coverage shall include all owned vehicles, all non-owned vehicles, and all hired vehicles.

Additional Insured: Commercial General Liability and Automobile Liability, as described above, shall include an endorsement stating that the following shall be *Additional Insureds*: The City of Kalamazoo, all elected and appointed officials, all employees and volunteers, all boards, commissions, and/or authorities and board members, including employees and volunteers thereof. It is understood and agreed that by naming the City of Kalamazoo as additional insured, coverage afforded is considered to be primary and any other insurance the City of Kalamazoo may have in effect shall be considered secondary and/or excess.

To the fullest extent permitted by law the Contractor agrees to defend, pay on behalf of, indemnify, and hold harmless the City of Kalamazoo, its elected and appointed officials, employees, agents and volunteers, and others working on behalf of the City of Kalamazoo against any and all claims, demands, suits, or loss, including all costs connected therewith, and for any damages which may be asserted, claimed, or recovered against or from the City of Kalamazoo, by reason of personal injury, including bodily injury or death and/or property damage, including loss of use thereof, which arises out of, or is in any way connected or associated with this contract.

Cancellation Notice: All policies, as described above, shall include an endorsement stating that it is understood and agreed that thirty (30) days, or ten (10) days for non-payment of premium, Advance Written Notice of Cancellation, Non-Renewal, Reduction, and/or Material Change shall be sent to: City of Kalamazoo, Purchasing Division, 241 W. South Street, Kalamazoo, MI 49007.

Proof of Insurance Coverage: The Contractor shall provide the City of Kalamazoo at the time that the contracts are returned by him/her for execution, or within 10 days of Notice of Award, whichever is earlier, a Certificate of Insurance as well as the required endorsements. In lieu of required endorsements, if applicable, a copy of the policy sections where coverage is provided for additional insured and cancellation notice would be acceptable. Copies or certified copies of all policies mentioned above shall be furnished, if so requested.

SECTION V
INDEMNITY AND INSURANCE
(Continued)

If any of the above coverages expire during the term of this contract, the Contractor shall deliver renewal certificates and/or policies to City of Kalamazoo at least ten (10) days prior to the expiration date.

Scope of Coverage: The above requirements and conditions shall not be interpreted to limit the liability of the Contractor under this Contract, but shall be interpreted to provide the greatest benefit to the City and its officers and employees. The above listed coverages shall protect the Contractor, its employees, agents, representatives and subcontractors against claims arising out of the work performed. It shall be the Contractor's responsibility to provide similar insurance for each subcontractor or to provide evidence that each subcontractor carries such insurance in like amount prior to the time such subcontractor proceeds to perform under the contract.

SECTION VI
TERMS AND CONDITIONS

1. AWARD OF CONTRACT

- A. This contract will be awarded to that responsible bidder whose bid, conforming to this solicitation, will be most advantageous to the City, price and other factors considered. The City reserves the right to accept or reject any or all bids and waive informalities and minor irregularities in bids received. Other factors include, as an example but not limited to, delivery time, conformance to specifications, incidental costs such as demurrage and deposits, etc.

Notification of award will be in writing by the Purchasing Director. Upon notification, the Contractor shall submit to the Purchasing/Risk Management Division all required insurance certificates (if required) and such other documentation as may be requested or required hereunder. Upon their receipt and subsequent approval by the City, the Purchasing Director will forward to the Contractor a written **NOTICE TO PROCEED**. Work shall **NOT** be started until such **NOTICE TO PROCEED** is received by the Contractor.

- B. Unilateral changes in bid prices by the bidder shall not be allowed. However, the City, at its sole option, reserves the right to negotiate with bidders in the event of, but not limited to:
- 1) No bids received;
 - 2) A single bid being received; or
 - 3) Prices quoted are over budget and/or unreasonable.

2. COMPLETE CONTRACT

This bid document together with its addenda, amendments, attachments and modifications, when executed, becomes the complete contract between the parties hereto, and no verbal or oral promises or representations made in conjunction with the negotiation of this contract shall be binding on either party.

3. SUBCONTRACTORS - NON-ASSIGNMENT

Bidders shall state in writing any and all sub-contractors to be associated with this bid, including the type of work to be performed. The Contractor shall cooperate with the City of Kalamazoo in meeting its commitments and goals with regard to maximum utilization of minority and women-owned business enterprises.

The Contractor hereby agrees and understands that the contract resulting from this solicitation shall not be transferred, assigned or sublet without prior written consent of the City of Kalamazoo.

4. TAXES

The City of Kalamazoo is exempt from all federal excise tax and state sales and use taxes. However, depending upon the situation, the vendor or contractor may not be exempt from said taxes and the City of Kalamazoo is making no representation as to any such exemption.

5. **INVOICING**

All original invoice(s) will be sent to the Finance Division, 241 W. South Street, Kalamazoo, MI 49007 or via email at apinvoice@kalamazoocity.org. Faxed copy of invoice(s) will not be accepted, unless it is to replace an original invoice that was lost in the mail. The Finance Division processes payments after receipt of an original invoice from the Contractor and approval by the department.

The City of Kalamazoo policy is to pay invoice(s) within 30 days from the receipt of the original invoice, if the services or supplies are satisfactory and the proper paperwork and procedures have been followed. In order to guarantee payment to the vendor on a timely basis, the vendor needs to receive a purchase order number before supplying the City of Kalamazoo with goods or services. All original, and copies of original invoice(s), will clearly state which purchase order they are being billed against.

The City of Kalamazoo is a government municipality and therefore is tax exempt from all sales tax. Our tax-exempt number is 38-6004627.

The vendor is responsible for supplying the Finance Division with a copy of their W-9 if they are providing a service to the City of Kalamazoo.

6. **PAYMENTS**

Unless otherwise specified by the City in this contract, the Contractor will be paid in not more than thirty (30) days after receipt of a properly executed invoice, the sum stipulated herein for supplies delivered and accepted, or service rendered and accepted. Payments are processed by the Budget & Accounting Division after receipt of an original invoice from the Contractor and approval by the department.

7. **CHANGES AND/OR CONTRACT MODIFICATIONS**

The City reserves the right to increase or decrease quantities, service or requirements, or make any changes necessary at any time during the term of this contract, or any negotiated extension thereof. Price adjustments due to any of the foregoing changes shall be negotiated and mutually agreed upon by the Contractor and the City.

Changes of any nature after contract award which reflect an increase or decrease in requirements or costs shall not be permitted without prior approval by the Purchasing Director. City Commission approval may also be required. **SUCH CHANGES, IF PERFORMED IN ADVANCE OF PURCHASING DIRECTOR APPROVAL, MAY BE SUBJECT TO DENIAL AND NON-PAYMENT.**

8. **LAWS, ORDINANCES AND REGULATIONS**

The Contractor shall keep himself/herself fully informed of all local, state and federal laws, ordinances and regulations in any manner affecting those engaged or employed in the work and the equipment used. Contractor and/or employees shall, at all times, serve and comply with such laws, ordinances and regulations.

Any permits, licenses, certificates or fees required for the performance of the work shall be obtained and paid for by the Contractor.

This contract shall be governed by the laws of the State of Michigan.

9. RIGHT TO AUDIT

The City or its designee shall be entitled to audit all of the Contractor's records, and shall be allowed to interview any of the Contractor's employees, throughout the term of this contract and for a period of three years after final payment or longer if required by law to the extent necessary to adequately permit evaluation and verification of:

- A. Contractor compliance with contract requirements,
- B. Compliance with provisions for pricing change orders, invoices or claims submitted by the Contractor or any of his payees.

10. HOLD HARMLESS

If the acts or omissions of the Contractor/Vendor or its employees, agents or officers, cause injury to person or property, the Contractor/Vendor shall defend, indemnify and save harmless the City of Kalamazoo, its agents, officials, and employees against all claims, judgments, losses, damages, demands, and payments of any kind to persons or property to the extent occasioned from any claim or demand arising therefrom.

11. DEFAULT

The City may at any time, by written notice to the Contractor, terminate this contract and the Contractor's right to proceed with the work, for just cause, which shall include, but is not limited to the following:

- A. Failure to provide insurance and bonds (when called for), in the exact amounts and within the time specified or any extension thereof.
- B. Failure to make delivery of the supplies, or to perform the services within the time specified herein, or any extension thereof.
- C. The unauthorized substitution of articles for those bid and specified.
- D. Failure to make progress if such failure endangers performance of the contract in accordance with its terms.
- E. Failure to perform in compliance with any provision of the contract.
- F. **Standard of Performance** - Contractor guarantees the performance of the commodities, goods or services rendered herein in accordance with the accepted standards of the industry or industries concerned herein, except that if this specification calls for higher standards, then such higher standards shall be provided.

Upon notice by the City of Contractor's failure to comply with such standards or to otherwise be in default of this contract in any manner following the Notice to Proceed, Contractor shall immediately remedy said defective performance in a manner acceptable to the City. Should Contractor fail to immediately correct said defective performance, said failure shall be considered a breach of this contract and grounds for termination of the same by the City.

In the event of any breach of this contract by Contractor, Contractor shall pay any cost to the City caused by said breach including but not limited to the replacement cost of such goods or services with another Contractor.

Standard of Performance (*cont.*)

The City reserves the right to withhold any or all payments until any defects in performance have been satisfactorily corrected.

In the event the Contractor is in breach of this contract in any manner, and such breach has not been satisfactorily corrected, the City may bar the Contractor from being awarded any future City contracts.

- G. All remedies available to the City herein are cumulative and the election of one remedy by the City shall not be a waiver of any other remedy available to the City either listed in this contract or available by operation of law.

12. INDEPENDENT CONTRACTOR

At all times, the Contractor, any of his/her employees, or his/her sub-contractors and their subsequent employees shall be considered independent contractors and not as City employees. The Contractor shall exercise all supervisory control and general control over all workers' duties, payment of wages to Contractor's employees and the right to hire, fire and discipline their employees and workers. As an independent contractor, payment under this contract shall not be subject to any withholding for tax, social security or other purposes, nor shall the Contractor or his/her employees be entitled to sick leave, pension benefit, vacation, medical benefits, life insurance or workers' unemployment compensation or the like.

13. PROJECT SUPERVISOR

The Contractor shall employ an individual to act as Project Supervisor. The Project Supervisor shall be available to the Contractor's workers and the Project Manager at all times by use of a cell phone, pager or other reliable means. The Project Supervisor shall prepare daily work plans for the employees, monitor employee performance, attendance and punctuality; and work closely with the City's Project Manager in assuring contract compliance.

14. MEETINGS

The Contractor and/or Project Supervisor shall be available to meet with the Department Head or Project Manager at a mutually agreeable time to discuss problems, issues or concerns relative to the contract. Either party may call a meeting at any time. When such a request for a meeting is made, the meeting date shall, in no case exceed five (5) working days after the request; and, if in the sole opinion of the Department Head, the severity of the circumstance warrants, no more than one (1) working day.

APPENDIX A
NON-DISCRIMINATION CLAUSE FOR ALL CITY OF KALAMAZOO CONTRACTS

The Contractor agrees to comply with the Federal Civil Rights Act of 1964 as amended; the Federal Civil Rights Act of 1991 as amended; the Americans With Disabilities Act of 1990 as amended; the Elliott-Larson Civil Rights Act, Act. No. 453, Public Act of 1976 as amended; the Michigan Handicappers Civil Rights Act, Act No. 220, Public Act of 1976 as amended, City Ordinance 1856 and all other applicable Federal and State laws. The Contractor agrees as follows:

1. The Contractor will not discriminate against any employee or applicant for employment because of race, color, religion, national origin, sex, age, height, weight, marital status, physical or mental disability, family status, sexual orientation or gender identity that is unrelated to the individual's ability to perform the duties of the particular job or position. Such action shall include, but not be limited to the following: employment, upgrading, demotion or transfer, recruitment advertising, layoff or termination; rates of pay or other forms of compensations; and selection for training, including apprenticeship.
2. The Contractor will, in all solicitations or advertisements for employees placed by or on behalf of the Contractor, state that all qualified applicants will receive consideration for employment without regard to race, color, religion, national origin, sex, age, height, weight, marital status, physical or mental disability family status, sexual orientation or gender identity that is unrelated to the individuals ability to perform the duties of the particular job or position.
3. If requested by the City, the Contractor shall furnish information regarding practices, policies and programs and employment statistics for the Contractor and subcontractors. The Contractor and subcontractors shall permit access to all books, records and accounts regarding employment practices by agents and representatives of the City duly charged with investigative duties to assure compliance with this clause.
4. Breach of the covenants herein may be regarded as a material breach of the contract or purchasing agreement as provided in the Elliott-Larsen Civil Rights Act and City Ordinance 1856.
5. The Contractor will include or incorporate by reference the provisions of the foregoing paragraphs 1 through 4 in every subcontract or purchase order unless exempted by the rules, regulations or orders of the Michigan Civil Rights Commission* and will provide in every subcontract or purchase order that said provision will be binding upon each subcontractor or seller.
6. The Contractor will not preclude a person with a criminal conviction from being considered for employment unless otherwise precluded by federal or state law. (for contracts over \$25,000)

The Elliott-Larson Civil Rights Act, Sec. 202 of Act. No. 453 of 1976 reads in part as follows:

Sec. 202. (1) An employer shall not:

- (a) Fail or refuse to hire, or recruit, or discharge or otherwise discriminate against an individual with respect to employment, compensation, or a term condition or privilege of employment because of religion, race, color, national origin, age, sex, height, weight or marital status.
- (b) Limit, segregate or classify an employee or applicant for employment in a way which deprives or tends to deprive the employee or applicant of an employment opportunity or otherwise adversely affects the status of an employee or applicant because of religion, race, color, national origin, age, sex, height, weight or marital status.
- (c) Segregate, classify or otherwise discriminate against a person on the basis of sex with respect to a term, condition or privilege of employment, including a benefit plan or system.

* Except for contracts entered into with parties employing less than three employees. 1-2010

APPENDIX C
FEDERAL PROVISIONS FOR CDBG PROJECTS

1. EQUAL EMPLOYMENT OPPORTUNITY

The contractor and any subcontractors shall comply with E.O. 11246, "Equal Employment Opportunity," as amended by E.O. 11375, "Amending Executive Order 11246 Relating to Equal Employment Opportunity," and as supplemented by regulations at 41 CFR part 60, "Office of Federal Contract Compliance Programs, Equal Employment Opportunity, Department of Labor."

2. RIGHTS TO INVENTIONS MADE UNDER A CONTRACT OR AGREEMENT

Contracts or agreements for the performance of experimental, developmental, or research work shall provide for the rights of the Federal Government and the recipient in any resulting invention in accordance with 37 CFR part 401, "Rights to Invention Made by Nonprofit Organizations and Small Business Firms Under Government Grants, Contracts and Cooperative Agreements," and any implementing regulations issued by the awarding agency.

3. CLEAN AIR ACT (42 U. S.C. 7401 ET SEQ.) AND THE FEDERAL WATER POLLUTION CONTROL ACT (33 U.S.C. 1251 et seq.), as amended

For contracts and subcontracts of amounts in excess of \$100,000 the contractor or subcontractor shall comply with all applicable standards, orders, or regulations issued pursuant to the Clean Air Act (42 U.S.C. 7401 et seq.). Violations shall be reported to the Federal awarding agency and the Regional Agency (EPA).

4. BYRD ANTI-LOBBYING AMENDMENT (31 U.S.C. 1352)

Contractors who apply or bid for an award of \$100,000 or more shall file the required certification. Each tier certifies to the tier above that it will not and has not used Federal appropriated funds to pay any person or organization for influencing or attempting to influence an officer or employee of any agency, a member of Congress, officer or employee of Congress, or an employee of a member of Congress in connection with obtaining any Federal contract, grant or any other award covered by 31 U.S.C. 1352. Each tier shall also disclose any lobbying with non-Federal funds that takes place in connection with obtaining any Federal award. Such disclosures are forwarded from tier to tier up to the recipient.

5. DEBARMENT AND SUSPENSION (E.O.S 12549 AND 12689)

No contract shall be made to parties listed on the General Services Administration's List of Parties Excluded from Federal Procurement or Non-procurement Programs in accordance with E.O.s 12549 and 12689, "Debarment and Suspension." This list contains the names of parties debarred, suspended or otherwise excluded by agencies, and contractors declared ineligible under statutory or regulatory authority other than E.O. 12549. Contractors with awards that exceed the small purchase threshold shall provide the required certification regarding its exclusion status and that of its principal employees.

6. CONFLICT OF INTEREST

The bidder certifies by their signature on the bid form that they have not participated in any arrangement or agreement with; nor offered anything of value to or received anything from an official or employee of the City that would tend to destroy or hinder free competition.

7. DRUG FREE WORKPLACE

The Contractor will continue to provide a drug-free workplace by:

- 7.1 Publishing a statement notifying employees that the unlawful manufacture, distribution, dispensing, possession, or use of a controlled substance is prohibited in the grantee's workplace and specifying the actions that will be taken against employees for violation of such prohibition;
- 7.2 Establishing an ongoing drug-free awareness program to inform employees about –
 - (a) The dangers of drug abuse in the workplace;
 - (b) The grantee's policy of maintaining a drug-free workplace;
 - (c) Any available drug counseling, rehabilitation, and employee assistance programs; and
 - (d) The penalties that may be imposed upon employees for drug abuse violations occurring in the workplace;
- 7.3 Making it a requirement that each employee to be engaged in the performance of the grant be given a copy of the statement required by paragraph 1;
- 7.4 Notifying the employee in the statement required by paragraph 1 that, as a condition of employment under the grant, the employee will -
 - (a) Abide by the terms of the statement; and
 - (b) Notify the employer in writing of his or her conviction for a violation of a criminal drug statute occurring in the workplace no later than five calendar days after such conviction;
- 7.5 Notifying the agency in writing, within ten calendar days after receiving notice under subparagraph 4(b) from an employee or otherwise receiving actual notice of such conviction. Employers of convicted employees must provide notice, including position title, to every grant officer or other designee on whose grant activity the convicted employee was working, unless the Federal agency has designated a central point for the receipt of such notices. Notice shall include the identification number(s) of each affected grant;
- 7.6 Taking one of the following actions, within 30 calendar days of receiving notice under subparagraph 4(b), with respect to any employee who is so convicted:
 - (a) Taking appropriate personnel action against such an employee, up to and including termination, consistent with the requirements of the Rehabilitation Act of 1973, as amended; or
 - (b) Requiring such employee to participate satisfactorily in a drug abuse assistance or rehabilitation program approved for such purposes by a Federal, State, or local health, law enforcement, or other appropriate agency;
- 7.7 Making a good faith effort to continue to maintain a drug-free workplace through implementation of paragraphs 8.1 - 8.6.

8. **THE CONTRACTOR AND ITS CONTRACT WORK HOURS AND SAFETY STANDARDS ACT—OVERTIME COMPENSATION (JULY 2005)**

(a) *Overtime requirements.* No Contractor or subcontractor employing laborers or mechanics (see Federal Acquisition Regulation [22.300](#)) shall require or permit them to work over 40 hours in any workweek unless they are paid at least 1 and 1/2 times the basic rate of pay for each hour worked over 40 hours.

(b) *Violation; liability for unpaid wages; liquidated damages.* The responsible Contractor and subcontractor are liable for unpaid wages if they violate the terms in paragraph (a) of this clause. In addition, the Contractor and subcontractor are liable for liquidated damages payable to the Government. The Contracting Officer will assess liquidated damages at the rate of \$10 per affected employee for each calendar day on which the employer required or permitted the employee to work in excess of the standard workweek of 40 hours without paying overtime wages required by the Contract Work Hours and Safety Standards Act.

(c) *Withholding for unpaid wages and liquidated damages.* The Contracting Officer will withhold from payments due under the contract sufficient funds required to satisfy any Contractor or subcontractor liabilities for unpaid wages and liquidated damages. If amounts withheld under the contract are insufficient to satisfy Contractor or subcontractor liabilities, the Contracting Officer will withhold payments from other Federal or federally assisted contracts held by the same Contractor that are subject to the Contract Work Hours and Safety Standards Act.

(d) Payrolls and basic subcontractors shall maintain payrolls and basic payroll records for all laborers and mechanics working on the contract during the contract and shall make them available to the Government until 3 years after contract completion. The records shall contain the name and address of each employee, social security Davis-Bacon Act.

(2) The Contractor and its subcontractors shall allow authorized representatives of the Contracting Officer or the Department of Labor to inspect, copy, or transcribe records maintained under paragraph (d)(1) of this clause. The Contractor or subcontractor also shall allow authorized representatives of the Contracting Officer or Department of number, labor classifications, hourly rates of wages paid, daily and weekly number of hours worked, deductions made, and actual wages paid. The records need not duplicate those required for construction work by Department of Labor regulations at 29 CFR 5.5(a)(3) implementing the Davis Labor to interview employees in the workplace during working hours.

(e) *Subcontracts.* The Contractor shall insert the provisions set forth in paragraphs (a) through (d) of this clause in subcontracts that may require or involve the employment of laborers and mechanics and require subcontractors to include these provisions in any such lower tier subcontracts. The Contractor shall be responsible for compliance by any subcontractor or lower-tier subcontractor with the provisions set forth in paragraphs (a) through (d) of this clause.

9. **ACCESS TO RECORDS**

All records shall be accessible to the City at reasonable times and under reasonable conditions for the purpose of determining compliance with this Agreement. If the City desires to audit the Sub-recipient's books, it may do so and may, at its discretion, retain an independent certified public accountant (CPA) to audit the Sub-recipient's books to determine whether there is compliance with this Agreement and with federal, state, and local laws and regulations.

10. **COPELAND "ANTI-KICKBACK" ACT CLAUSE**

The Copeland "Anti-Kickback" Act prohibits federal contractors or subcontractors engaged in building construction or repair from inducing an employee to give up any part of the compensation to which he or she is entitled under his or her employment contract and requires such contractors and subcontractors to submit weekly statements of compliance.

CITY OF KALAMAZOO

HUD SECTION 3 POLICY

GENERAL INFORMATION

What is the purpose of Section 3?

To ensure that employment and other economic opportunities generated by certain HUD financial assistance shall, to the greatest extent feasible, and consistent with existing Federal, State and local laws and regulations, be directed to low- and very low-income persons, particularly those who are recipients of government assistance for housing, and to businesses which provide economic opportunities to low- and very low-income persons.

Funding Programs Impacted

Most Housing and Urban Development (HUD) funded programs must meet the requirements of Section 3. Each program should be carefully reviewed to determine if Section 3 is applicable.

Who does it apply to?

- Recipient (City of Kalamazoo HUD funded activities)
- City Contractors and/or Subcontractors for HUD funded construction
- Subrecipients/developers receiving HUD grant funds from the City

Who will enforce it?

City of Kalamazoo

When does it apply (triggers)?

The requirements of Section 3 apply:

- To the entire project that is funded, regardless of whether the activity is fully or partially funded, with Section 3 covered assistance.
- If it is necessary to hire new workers or contract work out to complete the contracted job.

What is a Section 3 Resident?

A Section 3 Resident must:

- Reside in the metropolitan area or non-metropolitan area in which the Section 3 covered assistance is expended.
- Be low income with a gross household income less than 80% of the area median income as established by HUD.

Income limits can be found at: <http://www.huduser.org/portal/datasets/pdrdatas.html>

What is a Section 3 Business?

A Section 3 Business is one of the following:

- Businesses that are 51 percent or more owned by Section 3 Residents;
- Businesses whose permanent, full-time employees include persons, at least 30 percent of whom are currently Section 3 Residents, or within three years of the date of first employment with the firm were Section 3 Residents; or
- Businesses that provide evidence of a commitment to subcontract in excess of 25 percent of the dollar amount of all subcontracts to be awarded to businesses that meet the qualifications described above.

NUMERICAL GOALS

The City of Kalamazoo will make every effort to meet the following goals established by HUD through 24 CFR 135.30 when contracting for projects or hiring positions that are funded by HUD and for which Section 3 is applicable:

1. New hires – 30 percent of all new hires funded with HUD grant monies will be Section 3 Residents.
2. Contracts
 - 10 percent of total dollar amount of all Section 3 covered construction contracts.
 - 3 percent of total dollar amount of all other Section 3 non-construction covered contracts.

PREFERENCE POLICY (*pending Commissioner Approval*)

Preference shall be given to Section 3 Businesses when awarding contracts, funded in whole or in part, by HUD grant monies according to the following system:

1. When a Section 3 covered contract is to be awarded based upon the lowest price of a responsive and responsible bidder, the following shall apply in order of preference:
 - a. The contract shall be awarded to the lowest bid of the most responsive and responsible Section 3 Business located in one of the CDBG eligible Census tracts and if their bid is no more than 10 percent higher than the lowest accepted bid.
 - b. The contract shall be awarded to the lowest bid of the most responsive and responsible Section 3 Business if their bid is no more than 10 percent higher than the lowest accepted bid.
 - c. If no responsive bid by a qualified Section 3 Business is within 10 percent of the lowest accepted bid, the award shall be made to the lowest bid.
2. Where a Section 3 contract is to be awarded based on factors other than price:
 - a. The request for proposals must clearly define the professional services needed, identifying all qualifications to be considered including price.
 - b. A rating system for the assignment of points shall be included in the request for proposals to evaluate the qualifications of the proposal.
 - c. 10 percent of the total number of rating points will be set aside for Section 3 Businesses located within an eligible CDBG Census tract and five percent shall be set aside for Section 3 Businesses located outside eligible Census tracts.
 - d. The contract shall be awarded to the most responsive and responsible firm whose proposal is the most advantageous considering price and all other factors specified in the rating system.

ADDITIONAL REQUIREMENTS

1. Section 3 Businesses:

- a. The opportunity to register and apply as a Section 3 Business will be a part of the initial pre-bid meeting as well a part of the bid package. Section 3 certification forms for both the business and resident will be a part of the bid package.
- b. Organizations claiming to be a Section 3 Business are required to complete the necessary certifications and include them with their bid package to be considered for the preference policy. *Certification as a Section 3 Business must be notarized.*

2. Section 3 Residents:

Section 3 Residents must fill out the required resident form and be able to provide proof, if requested.

3. Requirements of the Contractor/Business:

- a. Actively recruit Section 3 Residents for positions required to fulfill their contract.
- b. Verify eligibility of potential employees.
- c. Report to City the total number of employees working on the HUD-assisted project.
- d. Report to City the total number of employees working on the HUD-assisted project that meet Section 3 requirements.
- e. Report to City the total number of new hires/trainees hired to work on the HUD-assisted project and grant that meet Section 3 requirements.
- f. Report to City the efforts made to direct employment and other economic opportunities generated by HUD funding to Section 3 Residents and Businesses.

4. Filing Complaints:

Any Section 3 Resident, Business or City of Kalamazoo resident may file a complaint alleging noncompliance with Section 3. Complaints should be filed with the Assistant Secretary for Fair Housing and Equal Opportunity, Department of Housing and Urban Development, Washington, DC 20410.

5. Failure to Comply:

The City of Kalamazoo will not enter into an agreement with a contractor found to be in violation of applicable statutes and /or HUD regulations

Sanctions include:

- a. Debarment (if contractor)
- b. Suspension of funds
- c. Limited denial of participation in HUD funded programs

6. City of Kalamazoo Reporting Requirements:

The City of Kalamazoo Community Planning and Development Department is required to provide the Section 3 Summary Report (form 60002) to the U. S. Department of Housing and Urban Development on an annual basis.

City of Kalamazoo
HUD SECTION 3 BUSINESS AFFIDAVIT
Businesses Claiming Status as a Section 3 Business

NAME OF BUSINESS:

ADDRESS OF BUSINESS:

CONTACT PERSON:

TELEPHONE NUMBER/ E-MAIL ADDRESS:

LOCAL JURISDICTION AND PROJECT

NAME _____

DEFINITIONS:

Section 3 Business is a business that meets one of the following criteria:

- a) A business where at least 51 percent is owned by Section 3 residents; or
- b) A business where at least 30 percent of the permanent, full-time employees are currently Section 3 residents, or within three years of the date of first employment with the business were Section 3 residents; or
- c) A business that provides evidence of a commitment to subcontract in excess of 25 percent of the dollar award of all subcontracts to businesses that meet the qualifications set forth in paragraphs (a) or (b) above.

Section 3 Area Resident is defined as follows:

- a) A public housing resident; or
- b) An individual who resides in the project area (local jurisdiction) and who is considered a low-income person as defined by HUD (any person with a gross household income less than 80 percent of the area median income, which is adjusted for household size).

FY2019 Income Limits

FY 2019 Income Limits Summary

Selecting any of the buttons labeled "Explanation" will display detailed calculation steps for each of the various parameters.

FY 2019 Income Limit Area	Median Family Income Explanation	FY 2019 Income Limit Category	Persons in Family							
			1	2	3	4	5	6	7	8
Kalamazoo-Portage, MI MSA	\$73,900	Very Low (50%) Income Limits (\$) Explanation	25,900	29,600	33,300	36,950	39,950	42,900	45,850	48,800
		Extremely Low Income Limits (\$)* Explanation	15,550	17,750	21,330	25,750	30,170	34,590	39,010	43,430
		Low (80%) Income Limits (\$) Explanation	41,400	47,300	53,200	59,100	63,850	68,600	73,300	78,050

SECTION 3 BUSINESS STATUS:

1. Type of Business:
 - Corporation
 - Partnership
 - Sole Proprietorship
 - Joint Venture

2. Type of Section 3 Business:
 - 51 percent owned by Section 3 residents
 - 30 percent of employees are Section 3 residents
 - 25 percent of subcontracts will go to Section 3 businesses

3. For business claiming Section 3 status where 51 percent is owned by Section 3 residents attach a list of Section 3 owners and their percentage of ownership in the business.

4. For business claiming Section 3 status where at least 30 percent of their workforce are currently Section 3 residents or were Section 3 eligible residents within 3 years of date of first employment with the business attached the following:
 - a. List of all current full-time employees
 - b. List of all employees claiming Section 3 status and date of employment

5. For business claiming Section 3 status by subcontracting 25 percent of the dollar awarded to qualified Section 3 business attach a list of subcontracted Section 3 businesses, how they qualify as a Section 3 business and the subcontract amount.

VERIFICATION:

Under penalty of perjury, I certify that I am the _____ (Title)
of the Company, that I am authorized by the Company to execute this affidavit on its behalf, that I have
personal knowledge of the certifications made in this affidavit and that the same are true.

Name (*signature*)

Name (*printed*)

State of _____ County of _____

Subscribed and sworn to before me this _____ day of _____,

Notary Public

My Commission Expires: _____



ASBESTOS REPORTS

(1423 N Edwards, 518 W North, 750 Skinner, 1011 Cobb)

Demolition of 3 Houses & 1 Garage

BID REFERENCE# 91240-023.0



46555 Humboldt Dr. Ste. 100
Novi, MI 48377
(248) 669-5140 | oneatlas.com



Client Name:	City of Kalamazoo
Project Name:	Commercial Building Asbestos Survey
Project Number:	188BS23419
Project Site Address (Subject Property):	1423 N Edwards, Kalamazoo, MI 49700
Date of Site Visit:	May 24, 2023
Asbestos Inspection Performed by:	Corey Pruitt (A57116)
Asbestos Inspector's Signature:	
Areas Not Accessible:	Portion of Basement & Entire 2 nd Floor
Number of Floors:	2 floors plus basement
Asbestos Present (Yes/No/Other):	Yes, additional asbestos may be present in inaccessible areas.

On the date indicated above, State of Michigan Asbestos Inspector, Corey Pruitt (A57116) from Atlas Technical Consultants, conducted a pre-demolition asbestos and other regulated materials inspection of the subject unoccupied commercial property.

Table I identifies materials that were found to contain asbestos in concentrations greater than 1% and therefore are regulated under the rules of asbestos in the State of Michigan.

TABLE I
Asbestos-Containing Materials

ID#	MATERIAL	LOCATION	QUANTITY	RESULT	NESHAP CATEGORY
6-WG-A,B,C	Window Glaze	EA 7,8,9	3 WINDOWS	PLM 3% Chrysotile	Cat II
15-PI-A,B,C	Pipe Insulation	FS 1	10 SF	PLM 40% Chrysotile	RACM

The purpose of this inspection was to task an accredited asbestos inspector to complete a pre-demolition asbestos and hazardous material survey of the subject site, and provide recommendation options for removal and disposal of identified hazardous/regulated materials prior to demolition of the building(s). The asbestos inspection consisted of the following three basic procedures: conducting a visual inspection of the structure, identifying homogeneous areas (HAs) of suspect surfacing, thermal system insulation, and miscellaneous materials; and sampling identified friable and non-friable suspect materials.

Bulk samples of suspect ACMs were collected and placed into individual containers for transport under Chain of Custody (COC) to a National Voluntary Lab Accreditation Program (NVLAP)-accredited laboratory for analysis. Materials typically known as non-asbestos items (i.e. fibrous glass, foam rubber, wood, etc.) were not sampled.

Laboratory Reports and associated COC's are provided in **Attachment A**. Photographs of the site are included in **Attachment B**. The following sections summarize Atlas' findings.

Table II below identifies the suspect asbestos-containing materials identified during the survey, their locations, approximate quantity, type and percentage of asbestos.

TABLE II
Suspect Asbestos-Containing Materials

HA/ID#	MATERIAL	LOCATION	RESULT
1-RM-A,B,C	Roofing Material	EA 5	ND
2-RM-A,B,C	Roofing Material	EA 10	ND
3-AS-A,B,C	Asphalt Siding	EA 1,2,3,4	ND
4-VP-A,B,C	Vapor Paper (Under wood siding)	EA 1,2,3,4	ND
5-EC-A,B,C	Exterior Caulk (White around house and windows)	EA 1,2,3,4	ND
6-WG-A,B,C	Window Glaze	EA 7,8,9	PLM 3% Chrysotile
7-WG-A,B,C	Window Glaze	EA 1,2,3,4	ND
8-PL-A,B,C,D,E	Plaster on Lath	FS 1-11	ND
9-TPL-A,B,C	Textured Plaster (Blue)	FS 4	ND
10-TPL-A,B,C	Textured Plaster (White)	FS 5	ND
11-TPL-A,B,C	Textured Plaster (Green)	FS 9	ND
12-WBS-A,B,C	Wallboard System	FS 7	ND
13-SC-A,B,C	Stack Cement		ND
14-HS-A,B,C	Heat Shield		ND
15-PI-A,B,C	Pipe Insulation	FS 1	PLM 40% Chrysotile

16-DW-A,B,C	Duct Wrap (Around furnace)	FS 1	ND
17-MLF-A,B,C	Multi Layered Floor	FS 7	ND
18-CA-A,B,C	Construction Adhesive (on Panels)	FS 7	ND
19-BM-A,B,C	Block Mortar (White)	EA 1,2,3,4	ND
20-BM-A,B,C	Block Mortar (Chimney)	EA 2	ND
21-BM-A,B,C	Brick Mortar (Red)	EA 1,2,4	ND
22-BM-A,B,C	Block Mortar (Garage)	EA 6,7,8,9	ND
23-CC-A,B,C	Concrete Chip (Exterior)	EA 2	ND
24-CC-A,B,C	Concrete Chip (Garage)	FS 12	ND
25-CC-A,B,C	Concrete Chip (Basement Floor)	FS 1	ND
26-RI-A,B,C	Rolled-in-Insulation (Pink)	FS 12	ND
27-IC-A,B,C	Interior Caulk (Kitchen Counter)	FS 9	ND
28-IC-A,B,C	Interior Caulk (Wood Trim)	FS 3-11	ND
29-IC-A,B,C	Interior Caulk (Bathroom)	FS 7	ND
30-BM-A,B,C	Brick Mortar	FS 2	ND
31-PL-A,B,C	Plaster on Brick	EA 1,2,4	ND
32-BM-A,B,C	Brick Mortar (Gray)		ND

ND = No asbestos detected, NA = Not applicable, UNQ = Unquantified; PC = Point Count

No other suspect ACMs were observed on the site. Although not anticipated based on surface observations, underground structures that could contain ACM may be present and should be managed accordingly if encountered during site redevelopment.

Asbestos is a hazardous substance. Its condition, handling and disposal are regulated by federal, state, and local agencies. ACMs generally do not pose a health threat unless the asbestos fibers are disturbed, become airborne and are inhaled.

Contractors working in an area where asbestos is present must be informed of the type and location of ACMs. Abatement of ACMs, including non-friable ACMs, must be performed by a Michigan licensed, certified and registered asbestos abatement contractor in accordance with state and federal Occupational Safety and Health Administration (OSHA) and local air quality management regulations.

Table III below lists Other Regulated Materials/Universal Wastes identified during the survey.

TABLE III
Other Regulated Materials/Universal Wastes

MATERIAL	LOCATION	APPROXIMATE QUANTITY
CFC's Air Conditioners/Refrigerators/Freezers/Dehumidifiers	FS-2,5,9,11	4
CRTs/TV Screens/Monitors/Electronics	FS-12	2
Misc. Items (Glue, Solvents, Cleaners, etc.)	FS-1, FS-12	140
Natural Gas Regulator	FS-1	1

Table IV below lists the functional spaces identified during the survey.

**Table IV
Functional Space/ Exterior Area Designations**

DESCRIPTION	DESIGNATION
Interior Functional Spaces	
Ground Level	FS- 3,4,5,6,7,8,9
2 nd Floor	FS-6,11
Basement	FS-2, 10
Garage	FS-12
Exterior Areas	
Roof	EA-5
Outside Surrounding	EA- 1,2,3,4

RECOMMENDATIONS:

Except for the following items listed below, Section 61.145(c) of the Asbestos NESHAP requires that each owner or operator of a demolition or demolition activity involving RACM remove all such material from a facility being demolished or renovated before any activity begins that would break up, dislodge, or similarly disturb the material or preclude access to the material for subsequent removal.

ACM need not be removed before demolition if it:

- (i) Is a Category I non-friable ACM that is not friable.
- (ii) Is on a facility component that is encased in concrete or other similarly hard material and is adequately wet whenever exposed during demolition.
- (iii) Was not accessible for testing and therefore was not discovered until after demolition began and, as a result of the demolition, cannot be safely removed. If not removed for safety reasons, the exposed RACM and any asbestos-contaminated debris must be treated as asbestos-containing waste material and kept adequately wet at all times until disposed of.
- (iv) Is a Category II non-friable ACM and the probability is low that the material will become crumbled, pulverized, or reduced to powder during demolition.

Demolition with Roofing Materials in place is covered under the NESHAP regulations (40 CFR Part 61 Subpart M).

Roofing materials that were not tested during this inspection should be assumed to be Category I asbestos-containing roofing materials.

Since demolition activities do not include sanding, grinding, cutting, or abrading, Category I asbestos-containing roofing materials not in poor condition and not friable are not considered RACM, and are allowed to remain in place during demolition.

If the asbestos-containing roofing material is not in poor condition and is not friable, it may be disposed of in a

landfill which accepts ordinary demolition waste.

The asbestos-containing roofing material may not be ground up for recycling into other products.

*If joint compound within the drywall system is identified as positive, a composite sample was analyzed per NESHAP. If the drywall system as a composite sample is less than 1% asbestos, the material is not considered RACM per NESHAP. However, OSHA requirements regarding materials containing less than 1% asbestos still apply, and contractors performing work should ensure they comply with the requirements if the material is not removed prior to demolition.

In addition, contractors should ensure they follow all OSHA regulations pertaining to demolition / demolition of Category I Asbestos-containing materials. Category I or II non-friable ACM that is not subject to 61.150(a)(3) would still have to be disposed of in a landfill that accepts building debris, in a landfill that operates in accordance with 61.154, or at a facility that operates in accordance with 61.155.

Prior to demolition, the following is recommended:

An asbestos abatement company, licensed in the State of Michigan should remove the materials identified as asbestos containing in Table I in accordance with all applicable Local, State, and Federal Requirements prior to demolition.

Other Regulated Materials/Universal Wastes, identified in Table III, must be transported and disposed in accordance with all applicable Local, State, and Federal Requirements prior to demolition.

LIMITATIONS:

The results, findings, conclusions, and recommendations expressed in the report are based only on conditions that were noted during Atlas' inspection of the vacant above-referenced property located in Kalamazoo, Michigan.

Any conditions or materials that could not be visually identified through limited destructive sampling were not inspected and may differ from those conditions or materials noted. The user of this report should keep in mind that conditions may change with time and observations made by Atlas at the time of the site reconnaissance may not be consistent with future observations made by others.

Additional materials may be encountered during the demolition process and may require further sampling to determine disposal criteria.

The report is designed to aid the building owner, architect, construction manager, general contractors, and potential asbestos abatement contractors in locating asbestos building materials and Other Regulated Materials/Universal Wastes to be removed prior to demolition activities.

Under no circumstances is the report to be utilized as a bidding document or as a project specification document. Contractors bidding the demolition of this site should field-verify project information.

Atlas appreciates the opportunity to be of service to the City of Kalamazoo on this project. In the meantime, if you have questions regarding the information in this report or if we can be of further assistance do not hesitate to contact our office at (248) 669-5140.

ATTACHMENT A

LABORATORY REPORTS AND CHAIN OF CUSTODY



ENVIRONMENTAL TESTING LABORATORIES, INC.

37575 W HURON RIVER DRIVE
ROMULUS, MICHIGAN 48174
(734) 955-6600
FAX: (734) 955-6604

To: Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job: 258031
Client Project: 2788BS23418

Attention: Robert Smith
Project Location: 1423 N Edwards , Kalamazoo , MI

Lab Sample Number	Client Sample Number	Sample Type	Completed
1515244	1-RM-A	Asbestos	06/06/2023
1515245	1-RM-B	Asbestos	06/06/2023
1515246	1-RM-C	Asbestos	06/06/2023
1515247	2-RM-A	Asbestos	06/06/2023
1515248	2-RM-B	Asbestos	06/06/2023
1515249	2-RM-C	Asbestos	06/06/2023
1515250	3-AS-A	Asbestos	06/06/2023
1515251	3-AS-B	Asbestos	06/06/2023
1515252	3-AS-C	Asbestos	06/06/2023
1515253	4-VP-A	Asbestos	06/06/2023
1515254	4-VP-B	Asbestos	06/06/2023
1515255	4-VP-C	Asbestos	06/06/2023
1515256	5-EC-A	Asbestos	06/06/2023
1515257	5-EC-B	Asbestos	06/06/2023
1515258	5-EC-C	Asbestos	06/06/2023
1515259	6-WG-A	Asbestos	06/06/2023

Lab Sample Number	Client Sample Number	Sample Type	Completed
1515260	6-WG-B	Asbestos	06/06/2023
1515261	6-WG-C	Asbestos	06/06/2023
1515262	7-WG-A	Asbestos	06/06/2023
1515263	7-WG-B	Asbestos	06/06/2023
1515264	7-WG-C	Asbestos	06/06/2023
1515265	8-PL-A	Asbestos	06/06/2023
1515266	8-PL-B	Asbestos	06/06/2023
1515267	8-PL-C	Asbestos	06/06/2023
1515268	8-PL-D	Asbestos	06/06/2023
1515269	8-PL-E	Asbestos	06/06/2023
1515270	9-TPL-A	Asbestos	06/06/2023
1515271	9-TPL-B	Asbestos	06/06/2023
1515272	9-TPL-C	Asbestos	06/06/2023
1515273	10-TPL-A	Asbestos	06/06/2023
1515274	10-TPL-B	Asbestos	06/06/2023
1515275	10-TPL-C	Asbestos	06/06/2023
1515276	11-TPL-A	Asbestos	06/06/2023
1515277	11-TPL-B	Asbestos	06/06/2023
1515278	11-TPL-C	Asbestos	06/06/2023
1515279	12-WBS-A	Asbestos	06/06/2023
1515280	12-WBS-B	Asbestos	06/06/2023
1515281	12-WBS-C	Asbestos	06/06/2023
1515282	15-PI-A	Asbestos	06/06/2023
1515283	15-PI-B	Asbestos	06/06/2023
1515284	15-PI-C	Asbestos	06/06/2023
1515285	16-DW-A	Asbestos	06/06/2023

Lab Sample Number	Client Sample Number	Sample Type	Completed
1515286	16-DW-B	Asbestos	06/06/2023
1515287	16-DW-C	Asbestos	06/06/2023
1515288	17-MLF-A	Asbestos	06/06/2023
1515289	17-MLF-B	Asbestos	06/06/2023
1515290	17-MLF-C	Asbestos	06/06/2023
1515291	18-CA-A	Asbestos	06/06/2023
1515292	18-CA-B	Asbestos	06/06/2023
1515293	18-CA-C	Asbestos	06/06/2023
1515294	19-BM-A	Asbestos	06/06/2023
1515295	19-BM-B	Asbestos	06/06/2023
1515296	19-BM-C	Asbestos	06/06/2023
1515297	20-BM-A	Asbestos	06/06/2023
1515298	20-BM-B	Asbestos	06/06/2023
1515299	20-BM-C	Asbestos	06/06/2023
1515300	21-BM-A	Asbestos	06/06/2023
1515301	21-BM-B	Asbestos	06/06/2023
1515302	21-BM-C	Asbestos	06/06/2023
1515303	22-BM-A	Asbestos	06/06/2023
1515304	22-BM-B	Asbestos	06/06/2023
1515305	22-BM-C	Asbestos	06/06/2023
1515306	23-CC-A	Asbestos	06/06/2023
1515307	23-CC-B	Asbestos	06/06/2023
1515308	23-CC-C	Asbestos	06/06/2023
1515309	24-CC-A	Asbestos	06/06/2023
1515310	24-CC-B	Asbestos	06/06/2023
1515311	24-CC-C	Asbestos	06/06/2023

Lab Sample Number	Client Sample Number	Sample Type	Completed
1515312	25-CC-A	Asbestos	06/06/2023
1515313	25-CC-B	Asbestos	06/06/2023
1515314	25-CC-C	Asbestos	06/06/2023
1515315	26-RI-A	Asbestos	06/06/2023
1515316	26-RI-B	Asbestos	06/06/2023
1515317	26-RI-C	Asbestos	06/06/2023
1515318	27-IC-A	Asbestos	06/06/2023
1515319	27-IC-B	Asbestos	06/06/2023
1515320	27-IC-C	Asbestos	06/06/2023
1515321	28-IC-A	Asbestos	06/06/2023
1515322	28-IC-B	Asbestos	06/06/2023
1515323	28-IC-C	Asbestos	06/06/2023
1515324	29-IC-A	Asbestos	06/06/2023
1515325	29-IC-B	Asbestos	06/06/2023
1515326	29-IC-C	Asbestos	06/06/2023
1515327	30-BM-A	Asbestos	06/06/2023
1515328	30-BM-B	Asbestos	06/06/2023
1515329	30-BM-C	Asbestos	06/06/2023
1515330	31-PL-A	Asbestos	06/06/2023
1515331	31-PL-B	Asbestos	06/06/2023
1515332	31-PL-C	Asbestos	06/06/2023
1517764	13-SC-A	Asbestos	06/06/2023
1517765	13-SC-B	Asbestos	06/06/2023
1517766	13-SC-C	Asbestos	06/06/2023
1517767	14-HS-A	Asbestos	06/06/2023
1517768	14-HS-B	Asbestos	06/06/2023

Lab Sample Number	Client Sample Number	Sample Type	Completed
1517769	14-HS-C	Asbestos	06/06/2023
1517771	32-BM-A	Asbestos	06/06/2023
1517772	32-BM-B	Asbestos	06/06/2023
1517773	32-BM-C	Asbestos	06/06/2023

Reviewed by: 
 Jessica Dilworth

<u>Summary</u>			
Method	Sample	Layer	Mastic
PLM	115	23	3



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031

Client Project : 2788BS23418

Date Collected : 05/24/2023

Date Received : 05/31/2023

Location :

1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515244 1-RM-A	Roofing Material -Shingle	Green Non-Fibrous Homogenous	PLM 35% Cellulose	PLM 65% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumpfer Date Analyzed : 06/06/2023					
1515244 1-RM-A	Shingle	Black Non-Fibrous Homogenous	PLM 2% Fiberglass	PLM 98% Other	PLM None Detected
Layer-2 Analyst: Rachel Gumpfer Date Analyzed : 06/06/2023					
1515244 1-RM-A	Shingle	Gray Non-Fibrous Homogenous	PLM 2% Fiberglass PLM 23% Cellulose	PLM 75% Other	PLM None Detected
Layer-3 Analyst: Rachel Gumpfer Date Analyzed : 06/06/2023					
1515245 1-RM-B	Roofing Material -Shingle	Green Non-Fibrous Homogenous	PLM 28% Cellulose	PLM 72% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumpfer Date Analyzed : 06/06/2023					
1515245 1-RM-B	Shingle	Black Non-Fibrous Homogenous	PLM 3% Fiberglass	PLM 97% Other	PLM None Detected
Layer-2 Analyst: Rachel Gumpfer Date Analyzed : 06/06/2023					
1515245 1-RM-B	Shingle	Gray Non-Fibrous Homogenous	PLM Trace Fiberglass PLM 20% Cellulose	PLM 80% Other	PLM None Detected
Layer-3 Analyst: Rachel Gumpfer Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.
 37575 W Huron River Drive
 Romulus, Michigan 48174
 (734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 258031
 Client Project : 2788BS23418
 Date Collected : 05/24/2023
 Date Received : 05/31/2023

Location :
 1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515246 1-RM-C	Roofing Material -Shingle	Green Non-Fibrous Homogenous	PLM 30% Cellulose	PLM 70% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumpper Date Analyzed : 06/06/2023					
1515246 1-RM-C	Shingle	Black Non-Fibrous Homogenous	PLM 4% Fiberglass	PLM 96% Other	PLM None Detected
Layer-2 Analyst: Rachel Gumpper Date Analyzed : 06/06/2023					
1515246 1-RM-C	Shingle	Gray Non-Fibrous Homogenous	PLM Trace Fiberglass PLM 20% Cellulose	PLM 80% Other	PLM None Detected
Layer-3 Analyst: Rachel Gumpper Date Analyzed : 06/06/2023					
1515247 2-RM-A	Roofing Material -Shingle	Black Non-Fibrous Homogenous	PLM Trace Cellulose PLM 10% Fiberglass	PLM 90% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumpper Date Analyzed : 06/06/2023					
1515247 2-RM-A	Shingle	Gray Non-Fibrous Homogenous	PLM 15% Fiberglass	PLM 85% Other	PLM None Detected
Layer-2 Analyst: Rachel Gumpper Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 800/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.
 37575 W Huron River Drive
 Romulus, Michigan 48174
 (734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 258031
 Client Project : 2788BS23418
 Date Collected : 05/24/2023
 Date Received : 05/31/2023

Location :
 1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515248 2-RM-B	Roofing Material -Shingle	Black Non-Fibrous Homogenous	PLM Trace Cellulose PLM 20% Fiberglass	PLM 80% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumper Date Analyzed : 06/06/2023					
1515248 2-RM-B	Shingle	Gray Non-Fibrous Homogenous	PLM 10% Fiberglass	PLM 90% Other	PLM None Detected
Layer-2 Analyst: Rachel Gumper Date Analyzed : 06/06/2023					
1515249 2-RM-C	Roofing Material -Shingle	Black Non-Fibrous Homogenous	PLM Trace Cellulose PLM 23% Fiberglass	PLM 77% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumper Date Analyzed : 06/06/2023					
1515249 2-RM-C	Shingle	Gray Non-Fibrous Homogenous	PLM 15% Fiberglass	PLM 85% Other	PLM None Detected
Layer-2 Analyst: Rachel Gumper Date Analyzed : 06/06/2023					
1515250 3-AS-A	Asphalt Siding	Green Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumper Date Analyzed : 06/06/2023					
1515250 3-AS-A	Fiber Backing	Brown/Black Fibrous Non-Homogenous	PLM 90% Cellulose	PLM 10% Other	PLM None Detected
Layer-2 Analyst: Rachel Gumper Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.
37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031
Client Project : 2788BS23418
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515251 3-AS-B	Asphalt Siding	Green Non-Fibrous Homogenous	PLM 5% Cellulose	PLM 95% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumpfer Date Analyzed : 06/06/2023					
1515251 3-AS-B	Fiber Backing	Brown/Black Fibrous Non-Homogenous	PLM 90% Cellulose	PLM 10% Other	PLM None Detected
Layer-2 Analyst: Rachel Gumpfer Date Analyzed : 06/06/2023					
1515252 3-AS-C	Asphalt Siding	Green Non-Fibrous Homogenous	PLM 5% Cellulose	PLM 95% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumpfer Date Analyzed : 06/06/2023					
1515252 3-AS-C	Fiber Backing	Brown/Black Fibrous Non-Homogenous	PLM 90% Cellulose	PLM 10% Other	PLM None Detected
Layer-2 Analyst: Rachel Gumpfer Date Analyzed : 06/06/2023					
1515253 4-VP-A	Vapor Paper (Under Wood Siding)	Brown Fibrous Homogenous	PLM 96% Cellulose	PLM 4% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumpfer Date Analyzed : 06/06/2023					
1515254 4-VP-B	Vapor Paper (Under Wood Siding)	Brown Fibrous Homogenous	PLM 96% Cellulose	PLM 4% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumpfer Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.
 37575 W Huron River Drive
 Romulus, Michigan 48174
 (734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 258031
 Client Project : 2788BS23418
 Date Collected : 05/24/2023
 Date Received : 05/31/2023

Location :
 1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515255 4-VP-C	Vapor Paper (Under Wood Siding)	Brown Fibrous Homogenous	PLM 96% Cellulose	PLM 4% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumpper Date Analyzed : 06/06/2023					
1515256 5-EC-A	Exterior Caulk	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumpper Date Analyzed : 06/06/2023					
1515257 5-EC-B	Exterior Caulk	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumpper Date Analyzed : 06/06/2023					
1515258 5-EC-C	Exterior Caulk	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumpper Date Analyzed : 06/06/2023					
1515259 6-WG-A	Window Glaze	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 97% Other	PLM 3% Chrysotile
Layer-1 Analyst: Rachel Gumpper Date Analyzed : 06/06/2023					
1515260 6-WG-B		Positive Stop			
Analyst: Rachel Gumpper Date Analyzed : 06/06/2023 Sample Not Analyzed					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031
Client Project : 2788BS23418
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515261 6-WG-C		Positive Stop			
Analyst: Rachel Gumpper Date Analyzed : 06/06/2023 Sample Not Analyzed					
1515262 7-WG-A	Window Glaze	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumpper Date Analyzed : 06/06/2023					
1515263 7-WG-B	Window Glaze	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumpper Date Analyzed : 06/06/2023					
1515264 7-WG-C	Window Glaze	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumpper Date Analyzed : 06/06/2023					
1515265 8-PL-A	Plaster	Gray Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-1 Analyst: Zach Pousak Date Analyzed : 06/06/2023					
1515265 8-PL-A	Skim Coat	White Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-2 Analyst: Zach Pousak Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.
37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031
Client Project : 2788BS23418
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515266 8-PL-B	Plaster	Gray Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-1 Analyst: Zach Pousak Date Analyzed : 06/06/2023					
1515266 8-PL-B	Skim Coat	White Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-2 Analyst: Zach Pousak Date Analyzed : 06/06/2023					
1515267 8-PL-C	Plaster	Gray Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-1 Analyst: Zach Pousak Date Analyzed : 06/06/2023					
1515267 8-PL-C	Skim Coat	White Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-2 Analyst: Zach Pousak Date Analyzed : 06/06/2023					
1515268 8-PL-D	Plaster	Gray Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-1 Analyst: Zach Pousak Date Analyzed : 06/06/2023					
1515268 8-PL-D	Skim Coat	White Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-2 Analyst: Zach Pousak Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP Item 198.1 and/or 198.6 was used to analyze all samples. Matrix Interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.
37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031
Client Project : 2788BS23418
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515269 8-PL-E	Plaster	Gray Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-1 Analyst: Zach Pousak Date Analyzed : 06/06/2023					
1515269 8-PL-E	Skim Coat	White Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-2 Analyst: Zach Pousak Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.
37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031
Client Project : 2788BS23418
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515270 9-TPL-A	Textured Plaster	Blue Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515270 9-TPL-A	Cementitious Material	Gray Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-2 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515270 9-TPL-A	Textured Plaster	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-3 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515270 9-TPL-A	Skim Coat	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-4 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515270 9-TPL-A	Plaster	Gray Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-5 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 800/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.
37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031
Client Project : 2788BS23418
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515271 9-TPL-B	Textured Plaster	Blue Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515271 9-TPL-B	Cementitious Material	Gray Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-2 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515271 9-TPL-B	Textured Plaster	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-3 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515271 9-TPL-B	Skim Coat	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-4 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515271 9-TPL-B	Plaster	Gray Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-5 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.
 37575 W Huron River Drive
 Romulus, Michigan 48174
 (734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 258031
 Client Project : 2788BS23418
 Date Collected : 05/24/2023
 Date Received : 05/31/2023

Location :
 1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515272 9-TPL-C	Textured Plaster	Blue Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515272 9-TPL-C	Cementitious Material	Gray Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-2 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515272 9-TPL-C	Textured Plaster	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-3 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515272 9-TPL-C	Skim Coat	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-4 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515272 9-TPL-C	Plaster	Gray Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-5 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031

Client Project : 2788BS23418

Date Collected : 05/24/2023

Date Received : 05/31/2023

Location :

1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515273 10-TPL-A	Textured Plaster	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515273 10-TPL-A	Plaster	Gray Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-2 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515273 10-TPL-A	Skim Coat	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-3 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515274 10-TPL-B	Textured Plaster	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515274 10-TPL-B	Plaster	Gray Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-2 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515274 10-TPL-B	Skim Coat	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-3 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.
 37575 W Huron River Drive
 Romulus, Michigan 48174
 (734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 258031
 Client Project : 2788BS23418
 Date Collected : 05/24/2023
 Date Received : 05/31/2023

Location :
 1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515275 10-TPL-C	Textured Plaster	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515275 10-TPL-C	Plaster	Gray Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-2 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515275 10-TPL-C	Skim Coat	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-3 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515276 11-TPL-A	Textured Plaster	Green Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515277 11-TPL-B	Textured Plaster	Green Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515278 11-TPL-C	Textured Plaster	Green Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP Item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.
37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031

Client Project : 2788BS23418

Date Collected : 05/24/2023

Date Received : 05/31/2023

Location :

1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515279 12-WBS-A	Wallboard System- Wallboard	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515279 12-WBS-A	Wallboard System- Tape	White Fibrous Homogenous	PLM 99% Cellulose	PLM 1% Other	PLM None Detected
Layer-2 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515279 12-WBS-A	Wallboard System- Mud	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-3 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515280 12-WBS-B	Wallboard System- Wallboard	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515280 12-WBS-B	Wallboard System- Tape	White Fibrous Homogenous	PLM 99% Cellulose	PLM 1% Other	PLM None Detected
Layer-2 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515280 12-WBS-B	Wallboard System- Mud	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-3 Analyst: Daniel Agnew Date Analyzed : 06/08/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 800/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP Item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031
Client Project : 2788BS23418
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515281 12-WBS-C	Wallboard System- Wallboard	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515281 12-WBS-C	Wallboard System- Tape	White Fibrous Homogenous	PLM 99% Cellulose	PLM 1% Other	PLM None Detected
Layer-2 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515281 12-WBS-C	Wallboard System- Mud	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-3 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515282 15-PI-A	Pipe Insulation	Gray Fibrous Homogenous	PLM 40% Cellulose	PLM 20% Other	PLM 40% Chrysotile
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515283 15-PI-B		Positive Stop			
Analyst: Daniel Agnew Date Analyzed : 06/06/2023 Sample Not Analyzed					
1515284 15-PI-C		Positive Stop			
Analyst: Daniel Agnew Date Analyzed : 06/06/2023 Sample Not Analyzed					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031
Client Project : 2788BS23418
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515285 16-DW-A	Duct Wrap	Silver Non-Fibrous Homogenous		PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515286 16-DW-B	Duct Wrap	Silver Non-Fibrous Homogenous		PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515287 16-DW-C	Duct Wrap	Silver Non-Fibrous Homogenous		PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515288 17-MLF-A	Multi Layered Floor- Tile	Tan Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515288 17-MLF-A	Multi Layered Floor- Mastic	Yellow Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-2 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031
Client Project : 2788BS23418
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515289 17-MLF-B	Multi Layered Floor- Tile	Tan Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515289 17-MLF-B	Multi Layered Floor- Mastic	Beige Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-2 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515290 17-MLF-C	Multi Layered Floor- Tile	Tan Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515290 17-MLF-C	Multi Layered Floor- Mastic	Beige Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-2 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515291 18-CA-A	Construction Adhesive	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515292 18-CA-B	Construction Adhesive	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031
Client Project : 2788BS23418
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515293 18-CA-C	Construction Adhesive	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515294 19-BM-A	Brick Mortar	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515294 19-BM-A	Brick Mortar	Gray Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-2 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515295 19-BM-B	Brick Mortar	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515295 19-BM-B	Brick Mortar	Gray Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-2 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031
Client Project : 2788BS23418
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515296 19-BM-C	Brick Mortar	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515298 19-BM-C	Brick Mortar	Gray Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-2 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1515297 20-BM-A	Block Mortar	Gray Non-Fibrous Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515298 20-BM-B	Block Mortar	Gray Non-Fibrous Homogenous	PLM 4% Cellulose	PLM 96% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515299 20-BM-C	Block Mortar	Gray Non-Fibrous Homogenous	PLM 4% Cellulose	PLM 96% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515300 21-BM-A	Brick Mortar	Gray Non-Fibrous Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031
Client Project : 2788BS23418
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515301 21-BM-B	Brick Mortar	Gray Non-Fibrous Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515302 21-BM-C	Brick Mortar	Gray Non-Fibrous Homogenous	PLM 4% Cellulose	PLM 96% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515303 22-BM-A	Block Mortar	Gray Non-Fibrous Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515304 22-BM-B	Block Mortar	Gray Non-Fibrous Homogenous	PLM 5% Cellulose	PLM 95% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515305 22-BM-C	Block Mortar	Gray Non-Fibrous Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515306 23-CC-A	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031
Client Project : 2788BS23418
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515307 23-CC-B	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515308 23-CC-C	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 4% Cellulose	PLM 96% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515309 24-CC-A	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515310 24-CC-B	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515311 24-CC-C	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515312 25-CC-A	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP (item 198.1 and/or 198.5) was used to analyze all samples. Melix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031
Client Project : 2788BS23418
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515313 25-CC-B	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515314 25-CC-C	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515315 26-RI-A	Rolled-In Insulation	Pink Fibrous Homogenous	PLM 1% Cellulose PLM 20% Fiberglass	PLM 79% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515316 26-RI-B	Rolled-In Insulation	Pink Fibrous Homogenous	PLM 3% Cellulose PLM 20% Fiberglass	PLM 77% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515317 26-RI-C	Rolled-In Insulation	Pink Fibrous Homogenous	PLM 4% Cellulose PLM 20% Fiberglass	PLM 76% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515318 27-IC-A	Interior Caulk	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.
37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031
Client Project : 2788BS23418
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515319 27-IC-B	Interior Caulk	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515320 27-IC-C	Interior Caulk	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515321 28-IC-A	Interior Caulk	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515322 28-IC-B	Interior Caulk	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515323 28-IC-C	Interior Caulk	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515324 29-IC-A	Interior Caulk	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.
37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031
Client Project : 2788BS23418
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515325 29-IC-B	Interior Caulk	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515326 29-IC-C	Interior Caulk	White Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515327 30-BM-A	Brick Mortar	Gray Non-Fibrous Non-Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515328 30-BM-B	Brick Mortar	Gray Non-Fibrous Non-Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515329 30-BM-C	Brick Mortar	Gray Non-Fibrous Non-Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 06/06/2023					
1515330 31-PL-A	Plaster on Brick	Gray Non-Fibrous Non-Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumpfer Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031

Client Project : 2788BS23418

Date Collected : 05/24/2023

Date Received : 05/31/2023

Location :

1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515331 31-PL-B	Plaster on Brick	Gray Non-Fibrous Non-Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumpfer Date Analyzed : 06/06/2023					
1515332 31-PL-C	Plaster on Brick	Gray Non-Fibrous Non-Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumpfer Date Analyzed : 06/06/2023					
1517764 13-SC-A	Stack Cement	Gray Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1517765 13-SC-B	Stack Cement	Gray Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1517766 13-SC-C	Stack Cement	Gray Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1517767 14-HS-A	Heat Shield	White Fibrous Homogenous	PLM Trace Cellulose PLM 98% Fiberglass	PLM 2% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP Item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031
Client Project : 2788BS23418
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1517768 14-HS-B	Heat Shield	White Fibrous Homogenous	PLM Trace Cellulose PLM 98% Fiberglass	PLM 2% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1517769 14-HS-C	Heat Shield	White Fibrous Homogenous	PLM Trace Cellulose PLM 98% Fiberglass	PLM 2% Other	PLM None Detected
Layer-1 Analyst: Daniel Agnew Date Analyzed : 06/06/2023					
1517771 32-BM-A	Brick Mortar	Gray Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumpfer Date Analyzed : 06/06/2023					
1517772 32-BM-B	Brick Mortar	Gray Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected
Layer-1 Analyst: Rachel Gumpfer Date Analyzed : 06/06/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258031
Client Project : 2788BS23418
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
1423 N Edwards , Kalamazoo , MI

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1517773 32-BM-C	Brick Mortar	Gray Non-Fibrous Homogenous	PLM Trace Cellulose	PLM 100% Other	PLM None Detected

Layer-1 Analyst: Rachel Gumper
Date Analyzed : 06/06/2023

Elm Wilkins
Lab Supervisor/Other Signatory

Analyst:

Rachel Gumper

Rachel Gumper

Shelby Fogelsong

Shelby Fogelsong

Zachary Pousak

Zach Pousak

Daniel Agnew

Daniel Agnew

400 Point Count Results by EPA 600/R-93/116 PLM (denoted by "PC")
Item 198.1: PLM Methods for Identifying and Quantitating Asbestos in Bulk Samples
Item 198.6: PLM Methods for Identifying and Quantitating Asbestos in Non-Friable Organically Bound Bulk Samples
EPA 600/R-93/116: Method for Determination of Asbestos in Bulk Building Materials
EPA 600/M4-82-020: Interim Method for Determination of Asbestos in Bulk Insulation Samples
A % Asbestos result of "Trace" indicates that the analyzed material was found to contain less than 1% asbestos and would not be considered an Asbestos Containing Material (ACM).

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Bulk Asbestos
 Chain of Custody

ETL Project #: 258031

Client: Atlas Technical Consultants	Contact: Rob Smith	Project Location/name: 1423 N EDWARDS KALAMAZOO, MI 49
Address: 46555 Humboldt Dr. Ste. 100 Novi, MI 48377	Phone: 248-669-5140 Fax: 248-669-5147 E-mail:	Client Project #: <u>27886523418</u>
Please Provide Results: <input checked="" type="checkbox"/> Email <input type="checkbox"/> Fax <input type="checkbox"/> Verbal <input type="checkbox"/> Other		Date Sampled: 5/24/2023

Turnaround Time (TAT): RUSH Same Day 24 hr 48 hr Standard (3-5 days) Other 72 hours

PLM Instructions
 (Check all that apply)

PLM EPA600/R-93/116, 1993 (Standard method) Stop at 1st Positive - *Clearly mark Homogenous Group*

Point Counting: 400 Points* NYSDOH ELAP 198.1, 2002*

Gravimetric Reduction* NYSDOH ELAP 198.6, 2010*

PLM Non-Building Material (Dust, Wipe, Tape) Soil or Vermiculite Analysis*

* Additional charge and turnaround may be required

1515

Lab ID	Sample ID	Material Description	Sample Location	Quantity
244 245 246	1-RM-A,B,C	Roofing Material	EA 5	
247 248 249	2-RM-A,B,C	Roofing Material	EA 10	
250 251 252	3-AS-A,B,C	Asphalt Siding	EA 1,2,3,4	
253 254 255	4-VP-A,B,C	Vapor paper (under wood siding)	EA 1,2,3,4	
256 257 258	5-EC-A,B,C	Exterior Caulk (white around house and windows)	EA 1,2,3,4	
259 260 261	6-WG-A,B,C	Window Glaze	EA 7,8,9	
262 263 264	7-WG-A,B,C	Window Glaze	EA 1,2,3,4	
265 266 267 268 269	8-PL-A,B,C,D,E	Plaster on Lath	FS 1-11	
270 271 272	9-TPL-A,B,C	Textured Plaster (Blue)	FS 4	
273 274 275	10-TPL-A,B,C	Textured Plaster (White)	FS 5	
276 277 278	11-TPL-A,B,C	Textured Plaster (Green)	FS 9	
279 280 281	12-WBS-A,B,C	Wallboard System	FS 7	

	Date	Time	
Relinquished (Name/Organization): Corey Pruitt	5/26/2023	12:00 PM	am/pm
Received (Name/ETL):	5/31/23	3:43	am/pm
Sample Login (Name/ETL):	5/31/23	3:43	am/pm
Stereoscopic/Sample Analysis (Name/ETL): <i>O. by Paul...</i>	6:23	1230	am/pm
Results (Name/ETL): <i>O. by Paul...</i>	6:23	1230	am/pm
QA/QC Review (Name/ETL):	6:23	1230	am/pm

Special Instructions: • 1st Positive Stop;
 • Composite all drywall/joint compound samples if any layer of system is greater than 1% asbestos;
 • Point Count ALL PLASTER samples Trace to 3% asbestos content
 • Point Count ALL SAMPLES Trace to 1% asbestos content

Remarks

**IN ORDER TO ENSURE RESULTS BY SPECIFIED TAT, THE LAB MUST BE EMAILED/CALLED WITH THE QUANTITY OF SAMPLES TO BE SHIPPED OR DROPPED OFF

ATTACHMENT B
PHOTOGRAPHS

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
1423 N EDWARDS ST.
KALAMAZOO, MI 49007




Street view of the house located at 1423 N Edwards (EA-1)/(EA-5)



View of the left side of the house (EA-2)

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
1423 N EDWARDS ST.
KALAMAZOO, MI 49007

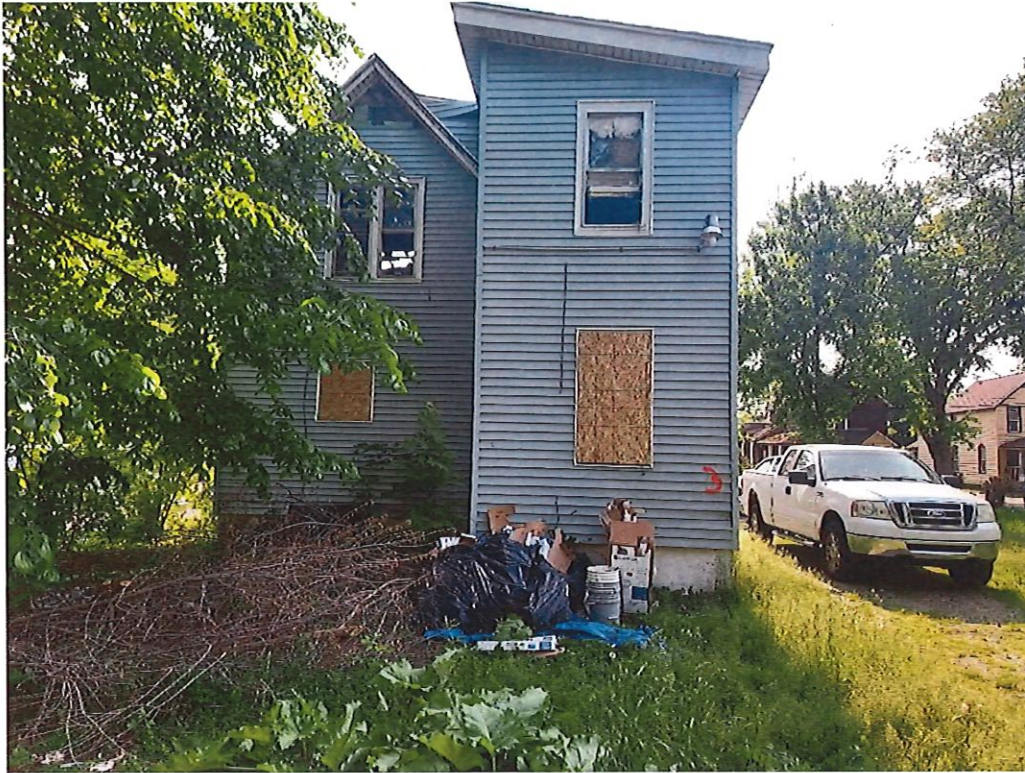

View of the rear of the house (EA-3)



View of the right side of the house (EA-4)

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
1423 N EDWARDS ST.
KALAMAZOO, MI 49007



View of EA-6/EA-10



View of EA-7

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
1423 N EDWARDS ST.
KALAMAZOO, MI 49007



View of EA-8



View of EA-9

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
1423 N EDWARDS ST.
KALAMAZOO, MI 49007



View of FS-1



View of FS-2

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
1423 N EDWARDS ST.
KALAMAZOO, MI 49007



View of FS-3

View of FS -4

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
1423 N EDWARDS ST.
KALAMAZOO, MI 49007




View of FS-5



View of FS-6

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
1423 N EDWARDS ST.
KALAMAZOO, MI 49007

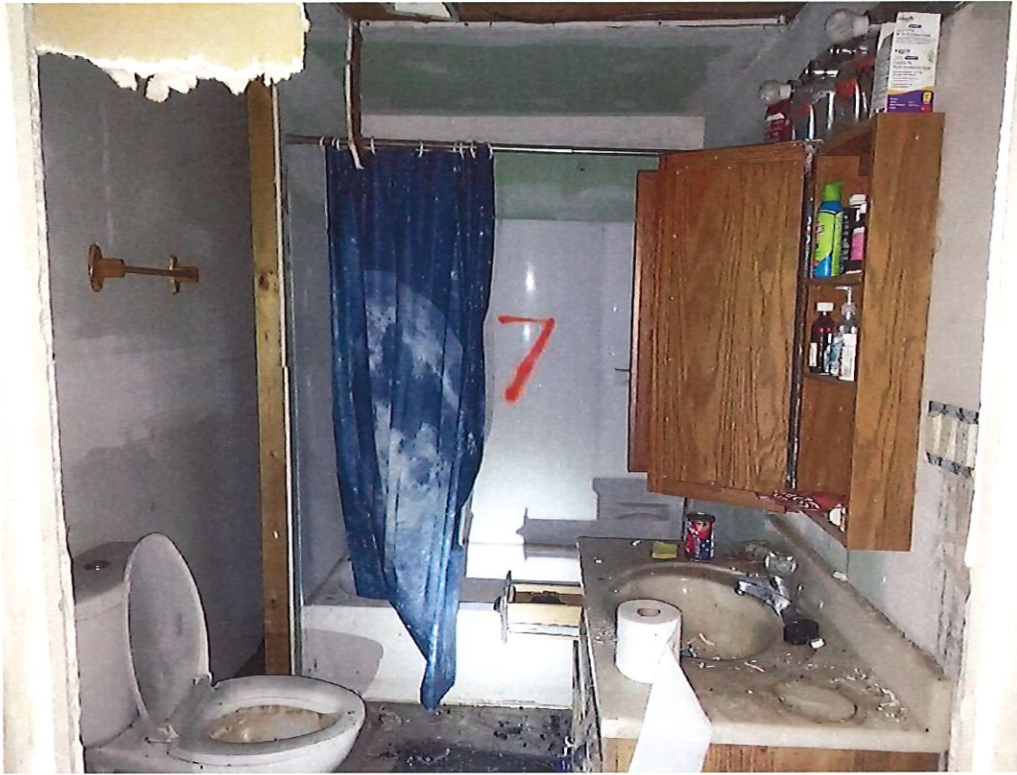


View of FS-7



View of FS-8

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
1423 N EDWARDS ST.
KALAMAZOO, MI 49007

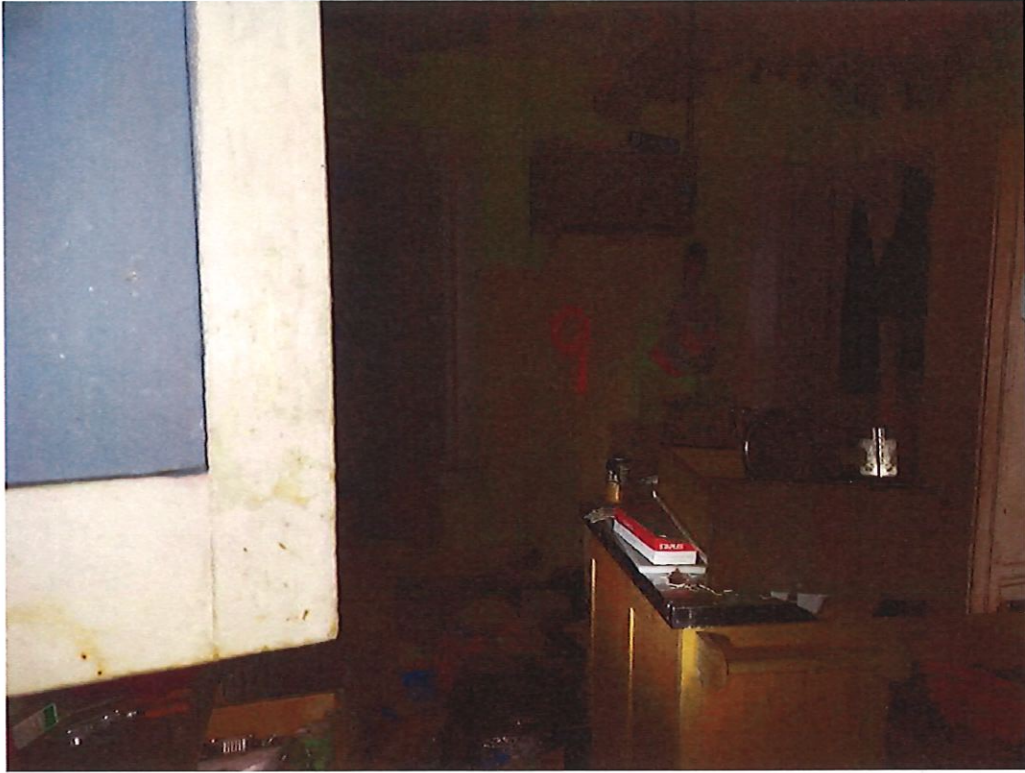

View of FS-9



View of FS-10

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
1423 N EDWARDS ST.
KALAMAZOO, MI 49007





View of FS-11 (Stairs leading to 2nd floor have collapsed into the basement)



View of FS-12

ATTACHMENT C
FUNCTIONAL SPACE MAPS

Circle: (Attic) (1st Floor) (2nd Floor) (Basement) (Garage)

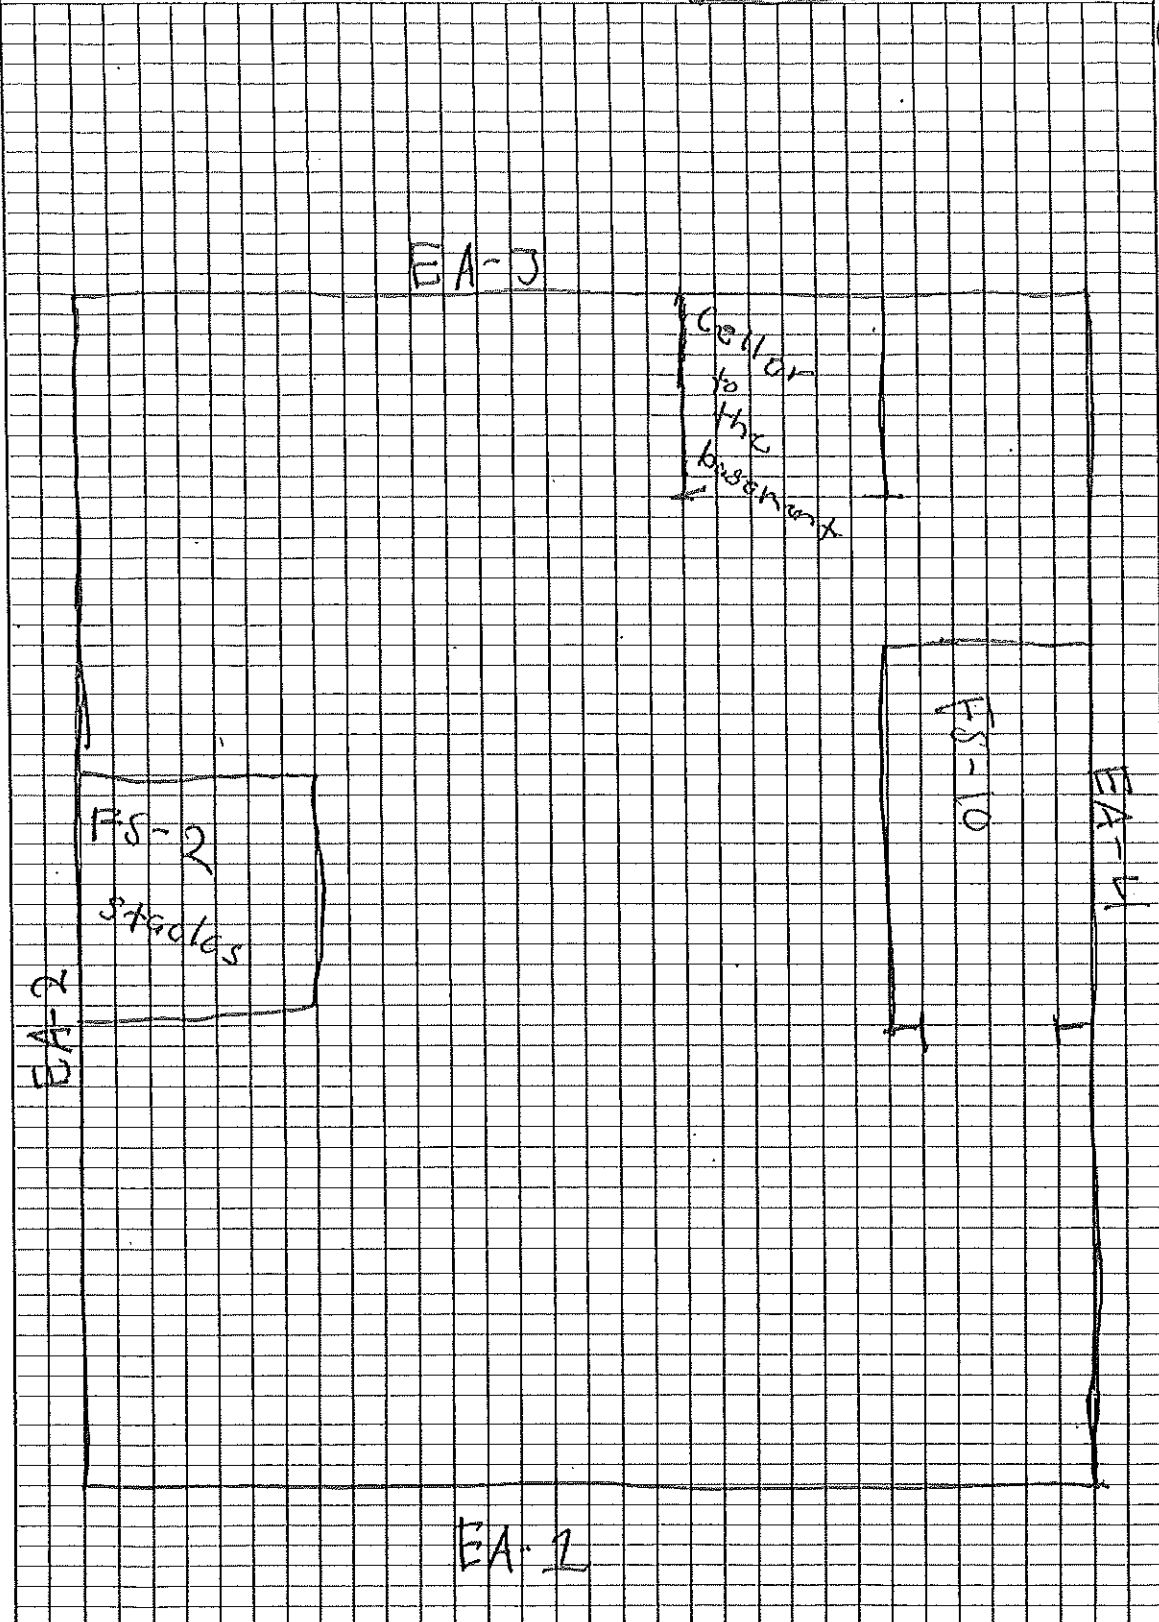

EA-5
ROOF



36

Street Address: 1423 N Edwards St

14




Circle: (Attic) (1st Floor) (2nd Floor) (Basement) (Garage)

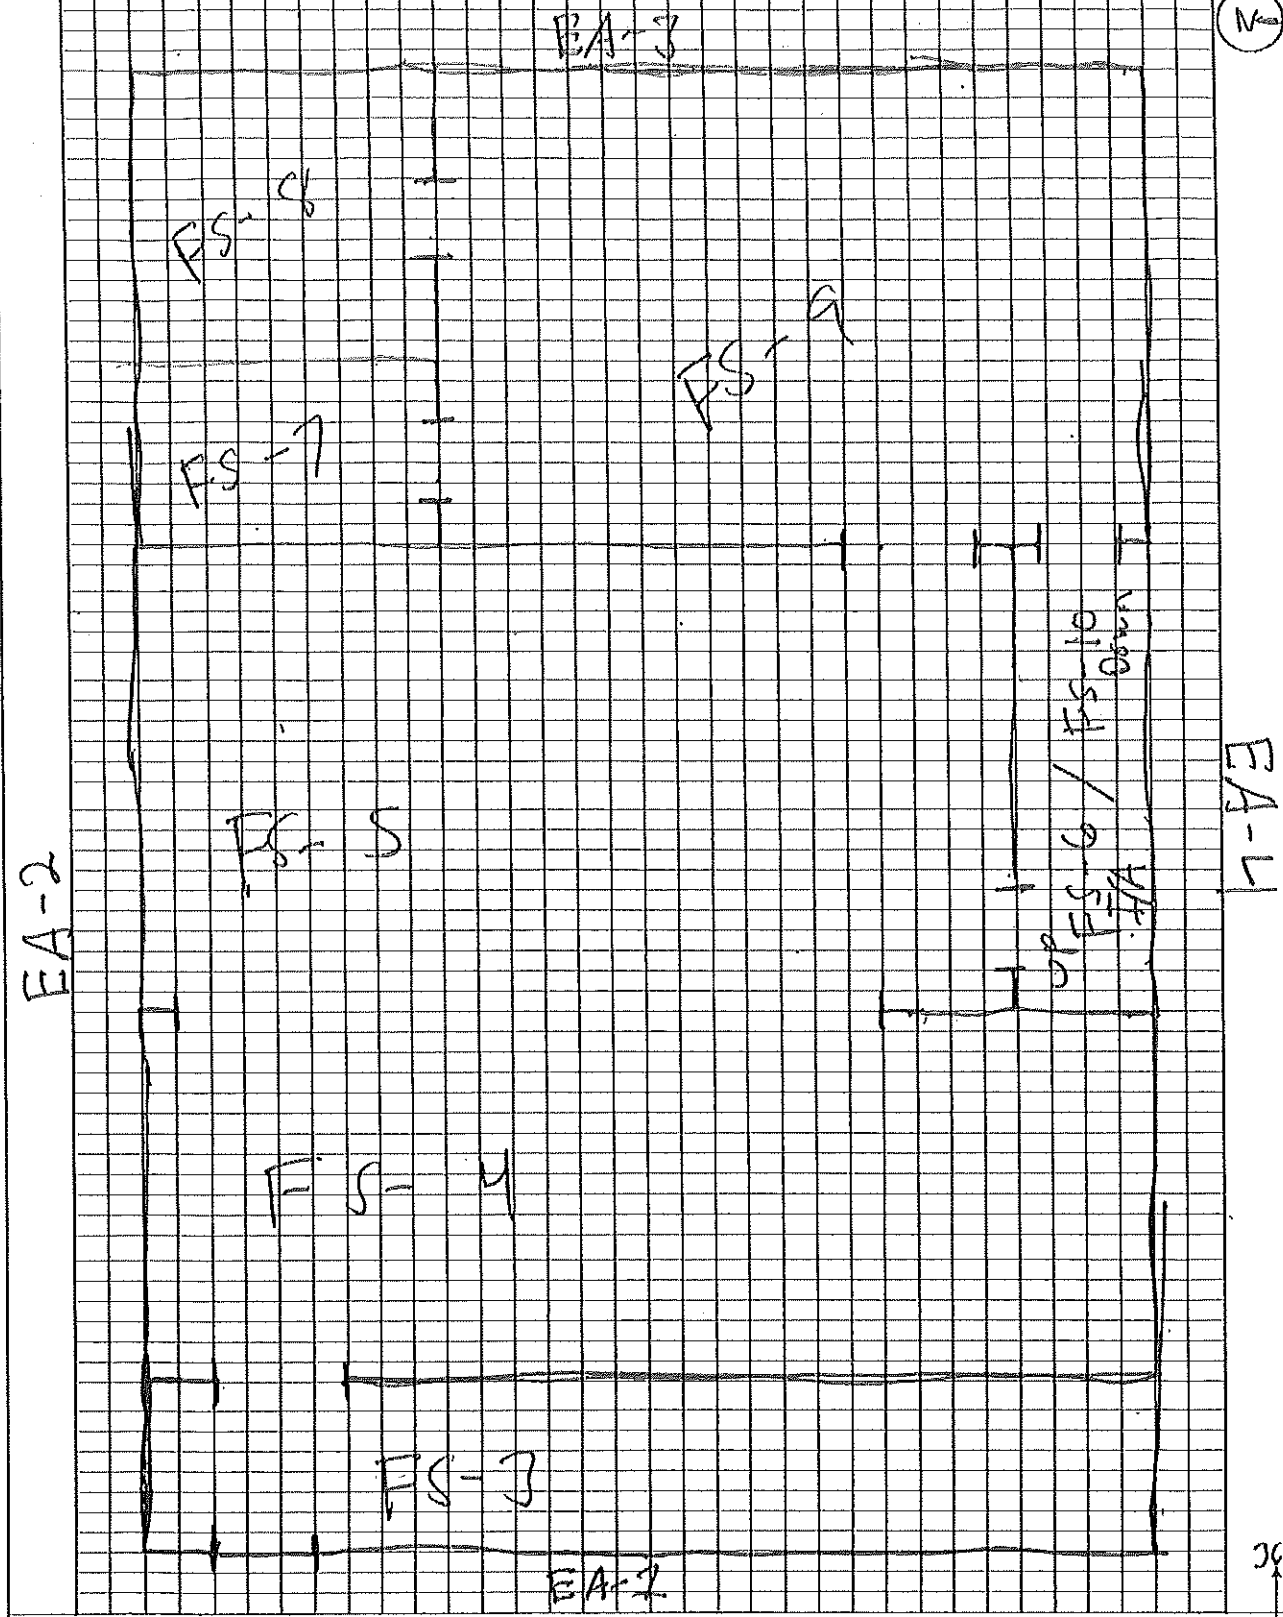


Street Address: 1423 N Edwards St

14

36



Circle: (Attic) (1st Floor) (2nd Floor) (Basement) (Garage)



EA 5
RWF

EA-2

EA-3

FS-11

EA-4

EA-1

36

19

Street Address: 1427 N Edwards st

Inaccessible



Circle: (Attic) (1st Floor) (2nd Floor) (Basement) (Garage)



EA-10

Roof

EA-8

EA-9

EA-7

FS-12

EA-6

19

20

Street Address: 1423 N Edwards

Inaccessible





46555 Humboldt Dr. Ste. 100
Novi, MI 48377
(248) 669-5140 | oneatlas.com



Client Name:	City of Kalamazoo
Project Name:	Residential Asbestos Survey
Project Number:	188BS23234
Project Site Address (Subject Property):	518 W. North Street, Kalamazoo, MI 49007
Date of Site Visit:	March 31, 2023
Asbestos Inspection Performed by:	Andrew DeLodder (A48677)
Asbestos Inspector's Signature:	<i>Andrew DeLodder</i>
Areas Not Accessible:	All Areas Accessible
Number of Floors:	2 Floors with Basement and Attic
Asbestos Present (Yes/No/Other):	Yes

On the date indicated above, State of Michigan Asbestos Inspector, Andrew DeLodder (A48677) from Atlas Technical Consultants, conducted a pre-demolition asbestos and other regulated materials inspection of the subject unoccupied residential property.

Table I identifies materials that were found to contain asbestos in concentrations greater than 1% and therefore are regulated under the rules of asbestos in the State of Michigan.

**TABLE I
Asbestos-Containing Materials**

ID#	MATERIAL	LOCATION	QUANTITY	RESULT	NESHAP CATEGORY
2-TS-A,B,C	Transite Siding- Exterior walls & pipe under rear porch	EA-1,2,3,4	1,890 SF	PLM 10% Chrysotile	MM
7-EC-A,B,C	Exterior Caulk- Gray, on transite (patches, seams, roofline)	EA-1,2,3,4	155 LF	PLM 4% Chrysotile	MM
34-DW-A,B,C	Duct Wrap- Over duct in attic ductwork, directly to the right after attic void door, may be located on risers in walls	FS-15	10 SF	PLM 50% Chrysotile	TSI

The purpose of this inspection was to task an accredited asbestos inspector to complete a pre-demolition asbestos and hazardous material survey of the subject site, and provide recommendation options for removal and disposal of identified hazardous/regulated materials prior to demolition of the building(s). The asbestos inspection consisted of the following three basic procedures: conducting a visual inspection of the structure, identifying homogeneous areas (HAs) of suspect surfacing, thermal system insulation, and miscellaneous materials; and sampling identified friable and non-friable suspect materials.

Bulk samples of suspect ACMs were collected and placed into individual containers for transport under Chain of Custody (COC) to a National Voluntary Lab Accreditation Program (NVLAP)-accredited laboratory for analysis. Materials typically known as non-asbestos items (i.e. fibrous glass, foam rubber, wood, etc.) were not sampled.

Laboratory Reports and associated COC's are provided in **Attachment A**. Photographs of the site are included in **Attachment B**. The following sections summarize Atlas' findings. Table II below identifies the suspect asbestos-containing materials identified during the survey, their locations, approximate quantity, type and percentage of asbestos.

**TABLE II
Suspect Asbestos-Containing Materials**

HA/ID#	MATERIAL	LOCATION	RESULT
1-RM-A,B,C	Roofing Material- House asphalt shingle roof	EA-10	ND
2-TS-A,B,C	Transite Siding- Exterior walls & pipe under rear porch	EA-1,2,3,4	PLM 10% Chrysotile
3-VP-A,B,C	Vapor Paper- under wood siding (under transite siding)	EA-1,2,3,4	ND
4-VP-A,B,C	Vapor Paper- Black, under transite siding	EA-1,2,3,4	ND
5-VP-A,B,C	Vapor Paper- Black, under transite siding seam	EA-1,2,3,4	ND
6-EC-A,B,C	Exterior Caulk- Gray, on front porch wood siding/trim	EA-1	ND
7-EC-A,B,C	Exterior Caulk- Gray, on transite (patches, seams, roofline)	EA-1,2,3,4	PLM 4% Chrysotile
8-EC-A,B,C	Exterior Caulk- Beige, Perimeter of basement windows	EA-2, 4	ND

HA/ID#	MATERIAL	LOCATION	RESULT
9-WG-A,B,C	Window Glaze- Basement windows	EA-2, 4	ND
10-WG-A,B,C	Window Glaze- Multi-pane window (rear porch window)	EA-3	ND
11-PL-A,B,C	Plaster- on lath, in closets of bedrooms	FS-11,13	ND
12-WBS-A,B,C	Wallboard System- Wall	EA-1	ND
13-WBS-A,B,C	Wallboard System- Walls/ceiling	FS-4,5,7,8,9,10,11,12,13,14	ND
14-SC-A,B,C	Stack Cement- on stack	FS-2	ND
15-HS-A,B,C	Heat Shield- Light fixture	FS-4	ND
16-FS-A,B,C	Floor Sheeting- Kitchen	FS-7	ND
17-MLF-A,B,C	Multi-layer Floor- Rear porch	FS-16	ND
18-MLF-A,B,C	Multi-layer Floor- Dining room/ Living room	FS-9, 10	ND
19-FT-A,B,C	Floor Tile- Stack of 12" Blue & beige with rectangle pattern stick-on	FS-14	ND
20-BM-A,B,C	Brick Mortar- Red brick debris	EA-1	ND
21-BM-A,B,C	Brick Mortar- Exterior foundation, concrete block	EA-1,2,3,4	ND
22-BM-A,B,C	Brick Mortar- Stack	FS-2	ND
23-CC-A,B,C	Concrete Chip- Exterior	EA-1	ND
24-CC-A,B,C	Concrete Chip- Basement wall skim coat	FS-1	ND
25-CC-A,B,C	Concrete Chip- Basement floor	FS-1	ND
26-CC-A,B,C	Concrete Chip- Basement wall (Under skim coat)	FS-1	ND
27-BI-A,B,C	Blown-in-Insulation- Cellulose, attic & attic voids	FS-3, 15	ND
28-RI-A,B,C	Rolled-in-Insulation- White, packed in rat-wall, no backing paper	FS-1	ND
29-RI-A,B,C	Rolled-in-Insulation- White with backing paper black backing paper, attic voids	FS-3, 15	ND
30-RI-A,B,C	Rolled-in-Insulation- (1 st & 2 nd Floor) Red with brown backing paper- in exterior walls	EA-1,2,3,4	ND
31-IC-A,B,C	Interior Caulk- Gray, seams of HVAC ducts	FS-1	ND
32-IC-A,B,C	Interior Caulk- White, on interior wood trim	FS-4,5,6,7,8,9,10,11,13,14	ND
33-RI-A,B,C	Rolled-in-Insulation- Hot water heated tank insulation, Yellow with white vinyl wrap	FS-1	ND
34-DW-A,B,C	Duct Wrap- Over duct in attic ductwork, directly to the right after attic void door, may be located on risers in walls	FS-15	PLM 50% Chrysotile

ND = No asbestos detected, **NA** = Not applicable, **UNQ** = Unquantified; **PC** = Point Count

No other suspect ACMs were observed on the site. Although not anticipated based on surface observations, underground structures that could contain ACM may be present and should be managed accordingly if encountered during site redevelopment.

Asbestos is a hazardous substance. Its condition, handling and disposal are regulated by

federal, state, and local agencies. ACMs generally do not pose a health threat unless the asbestos fibers are disturbed, become airborne and are inhaled.

Contractors working in an area where asbestos is present must be informed of the type and location of ACMs. Abatement of ACMs, including non-friable ACMs, must be performed by a Michigan licensed, certified and registered asbestos abatement contractor in accordance with state and federal Occupational Safety and Health Administration (OSHA) and local air quality management regulations.

Table III below lists Other Regulated Materials/Universal Wastes identified during the survey.

**TABLE III
Other Regulated Materials/Universal Wastes**

MATERIAL	LOCATION	APPROXIMATE QUANTITY
CFCS Air Conditioners/ Refrigerators/Freezers/ Dehumidifiers	FS-1 Furnace & Hot Water Heater	2
CRTs TV Screens/ Monitors/ Electronics	FS-1	1
*Automobile, Lawn Mower, Snow Blower	FS-9 Lawn Mower	1
Misc. Items (Glue, Solvents, Cleaners, etc.)	FS-1	15
Paint Cans	FS- 1, 14, 15	7
Security Alarms/ Systems	FS-1	1
Smoke Detectors	FS- 9, 10, 13, 14	5
Thermostats	FS-10	1
Natural Gas Regulator	FS-1	1
Tires	FS-1, EA-3	3

Table IV below lists the functional spaces identified during the survey.

**Table IV
Functional Space/ Exterior Area Designations**

DESCRIPTION	DESIGNATION
Interior Functional Spaces	
First Floor	FS 4,5,6,7,8,9,10 &15
2 nd Floor	FS 6,11,12,13,14 &15
Attic	FS 3
Stairs to Basement	FS 8
Basement	FS 1, 2 & 8
Stack	FS-2
Exterior Areas	
House Front	EA- 1
House Left Side	EA- 2
House Rear	EA- 3
House Right Side	EA- 4
House Roof	EA- 5

RECOMMENDATIONS:

Except for the following items listed below, Section 61.145(c) of the Asbestos NESHAP requires that each owner or operator of a demolition or demolition activity involving RACM remove all such material from a facility being demolished or renovated before any activity begins that would break up, dislodge, or similarly disturb the material or preclude access to the material for subsequent removal.

ACM need not be removed before demolition if it:

(i) Is a Category I non-friable ACM that is not friable.

(ii) Is on a facility component that is encased in concrete or other similarly hard material and is adequately wet whenever exposed during demolition.

(iii) Was not accessible for testing and therefore was not discovered until after demolition began and, as a result of the demolition, cannot be safely removed. If not removed for safety reasons, the exposed RACM and any asbestos-contaminated debris must be treated as asbestos-containing waste material and kept adequately wet at all times until disposed of.

(iv) Is a Category II non-friable ACM and the probability is low that the material will become crumbled, pulverized, or reduced to powder during demolition.

Demolition with Roofing Materials in place is covered under the NESHAP regulations (40 CFR Part 61 Subpart M).

Roofing materials that were not tested during this inspection should be assumed to be Category I asbestos-containing roofing materials.

Since demolition activities do not include sanding, grinding, cutting, or abrading, Category I asbestos-containing roofing materials not in poor condition and not friable are not considered RACM, and are allowed to remain in place during demolition.

If the asbestos-containing roofing material is not in poor condition and is not friable, it may be disposed of in a landfill which accepts ordinary demolition waste.

The asbestos-containing roofing material may not be ground up for recycling into other products.

*If joint compound within the drywall system is identified as positive, a composite sample was analyzed per NESHAP. If the drywall system as a composite sample is less than 1% asbestos, the material is not considered RACM per NESHAP. However, OSHA requirements regarding materials containing less than 1% asbestos still apply, and contractors performing work should ensure they comply with the requirements if the material is not removed prior to demolition.

In addition, contractors should ensure they follow all OSHA regulations pertaining to demolition / demolition of Category I Asbestos-containing materials. Category I or II non-friable ACM that is not subject to 61.150(a)(3) would still have to be disposed of in a landfill that accepts building debris, in a landfill that operates in accordance with 61.154, or at a facility that operates in

accordance with 61.155.

Prior to demolition, the following is recommended:

An asbestos abatement company, licensed in the State of Michigan should remove the materials identified as asbestos containing in Table I in accordance with all applicable Local, State, and Federal Requirements prior to demolition.

Other Regulated Materials/Universal Wastes, identified in Table III, must be transported and disposed in accordance with all applicable Local, State, and Federal Requirements prior to demolition.

LIMITATIONS:

The results, findings, conclusions, and recommendations expressed in the report are based only on conditions that were noted during Atlas' inspection of the vacant above-referenced property located in Kalamazoo, Michigan.

Any conditions or materials that could not be visually identified through limited destructive sampling were not inspected and may differ from those conditions or materials noted. The user of this report should keep in mind that conditions may change with time and observations made by Atlas at the time of the site reconnaissance may not be consistent with future observations made by others.

Additional materials may be encountered during the demolition process and may require further sampling to determine disposal criteria.

The report is designed to aid the building owner, architect, construction manager, general contractors, and potential asbestos abatement contractors in locating asbestos building materials and Other Regulated Materials/Universal Wastes to be removed prior to demolition activities.

Under no circumstances is the report to be utilized as a bidding document or as a project specification document. Contractors bidding the demolition of this site should field-verify project information.

Atlas appreciates the opportunity to be of service to the City of Kalamazoo on this project. In the meantime, if you have questions regarding the information in this report or if we can be of further assistance do not hesitate to contact our office at (248) 669-5140.

ATTACHMENT A

LABORATORY REPORTS AND CHAIN OF CUSTODY



To: Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job: 256487
Client Project: 188BS23234

Attention: Robert Smith
Project Location: 518 W North St.

Lab Sample Number	Client Sample Number	Sample Type	Completed
1483675	1-RM-A	Asbestos	04/07/2023
1483676	1-RM-B	Asbestos	04/07/2023
1483677	1-RM-C	Asbestos	04/07/2023
1483678	2-TS-A	Asbestos	04/07/2023
1483679	2-TS-B	Asbestos	04/07/2023
1483680	2-TS-C	Asbestos	04/07/2023
1483681	3-VP-A	Asbestos	04/07/2023
1483682	3-VP-B	Asbestos	04/07/2023
1483683	3-VP-C	Asbestos	04/07/2023
1483684	4-VP-A	Asbestos	04/07/2023
1483685	4-VP-B	Asbestos	04/07/2023
1483686	4-VP-C	Asbestos	04/07/2023
1483687	5-VP-A	Asbestos	04/07/2023
1483688	5-VP-B	Asbestos	04/07/2023
1483689	5-VP-C	Asbestos	04/07/2023
1483690	6-EC-A	Asbestos	04/07/2023

Lab Sample Number	Client Sample Number	Sample Type	Completed
1483691	6-EC-B	Asbestos	04/07/2023
1483692	6-EC-C	Asbestos	04/07/2023
1483693	7-EC-A	Asbestos	04/07/2023
1483694	7-EC-B	Asbestos	04/07/2023
1483695	7-EC-C	Asbestos	04/07/2023
1483696	8-EC-A	Asbestos	04/07/2023
1483697	8-EC-B	Asbestos	04/07/2023
1483698	8-EC-C	Asbestos	04/07/2023
1483699	9-WG-A	Asbestos	04/07/2023
1483700	9-WG-B	Asbestos	04/07/2023
1483701	9-WG-C	Asbestos	04/07/2023
1483702	10-WG-A	Asbestos	04/07/2023
1483703	10-WG-B	Asbestos	04/07/2023
1483704	10-WG-C	Asbestos	04/07/2023
1483705	11-PL-A	Asbestos	04/07/2023
1483706	11-PL-B	Asbestos	04/07/2023
1483707	11-PL-C	Asbestos	04/07/2023
1483708	12-WBS-A	Asbestos	04/07/2023
1483709	12-WBS-B	Asbestos	04/07/2023
1483710	12-WBS-C	Asbestos	04/07/2023
1483711	13-WBS-A	Asbestos	04/07/2023
1483712	13-WBS-B	Asbestos	04/07/2023
1483713	13-WBS-C	Asbestos	04/07/2023
1483714	14-SC-A	Asbestos	04/07/2023
1483715	14-SC-B	Asbestos	04/07/2023
1483716	14-SC-C	Asbestos	04/07/2023

Lab Sample Number	Client Sample Number	Sample Type	Completed
1483717	15-HS-A	Asbestos	04/07/2023
1483718	15-HS-B	Asbestos	04/07/2023
1483719	15-HS-C	Asbestos	04/07/2023
1483720	16-FS-A	Asbestos	04/07/2023
1483721	16-FS-B	Asbestos	04/07/2023
1483722	16-FS-C	Asbestos	04/07/2023
1483723	17-MLF-A	Asbestos	04/07/2023
1483724	17-MLF-B	Asbestos	04/07/2023
1483725	17-MLF-C	Asbestos	04/07/2023
1483726	18-MLF-A	Asbestos	04/07/2023
1483727	18-MLF-B	Asbestos	04/07/2023
1483728	18-MLF-C	Asbestos	04/07/2023
1483729	19-FT-A	Asbestos	04/07/2023
1483730	19-FT-B	Asbestos	04/07/2023
1483731	19-FT-C	Asbestos	04/07/2023
1483732	20-BM-A	Asbestos	04/07/2023
1483733	20-BM-B	Asbestos	04/07/2023
1483734	20-BM-C	Asbestos	04/07/2023
1483735	21-BM-A	Asbestos	04/07/2023
1483736	21-BM-B	Asbestos	04/07/2023
1483737	21-BM-C	Asbestos	04/07/2023
1483738	22-BM-A	Asbestos	04/07/2023
1483739	22-BM-B	Asbestos	04/07/2023
1483740	22-BM-C	Asbestos	04/07/2023
1483741	23-CC-A	Asbestos	04/07/2023
1483742	23-CC-B	Asbestos	04/07/2023

Lab Sample Number	Client Sample Number	Sample Type	Completed
1483743	23-CC-C	Asbestos	04/07/2023
1483744	24-CC-A	Asbestos	04/07/2023
1483745	24-CC-B	Asbestos	04/07/2023
1483746	24-CC-C	Asbestos	04/07/2023
1483747	25-CC-A	Asbestos	04/07/2023
1483748	25-CC-B	Asbestos	04/07/2023
1483749	25-CC-C	Asbestos	04/07/2023
1483750	26-CC-A	Asbestos	04/07/2023
1483751	26-CC-B	Asbestos	04/07/2023
1483752	26-CC-C	Asbestos	04/07/2023
1483753	27-BI-A	Asbestos	04/07/2023
1483754	27-BI-B	Asbestos	04/07/2023
1483755	27-BI-C	Asbestos	04/07/2023
1483756	28-RI-A	Asbestos	04/07/2023
1483757	28-RI-B	Asbestos	04/07/2023
1483758	28-RI-C	Asbestos	04/07/2023
1483759	29-RI-A	Asbestos	04/07/2023
1483760	29-RI-B	Asbestos	04/07/2023
1483761	29-RI-C	Asbestos	04/07/2023
1483762	30-RI-A	Asbestos	04/07/2023
1483763	30-RI-B	Asbestos	04/07/2023
1483764	30-RI-C	Asbestos	04/07/2023
1483765	31-IC-A	Asbestos	04/07/2023
1483766	31-IC-B	Asbestos	04/07/2023
1483767	31-IC-C	Asbestos	04/07/2023
1483768	32-IC-A	Asbestos	04/07/2023

Lab Sample Number	Client Sample Number	Sample Type	Completed
1483769	32-IC-B	Asbestos	04/07/2023
1483770	32-IC-C	Asbestos	04/07/2023
1483771	33-RI-A	Asbestos	04/07/2023
1483772	33-RI-B	Asbestos	04/07/2023
1483773	33-RI-C	Asbestos	04/07/2023
1483774	34-DW-A	Asbestos	04/07/2023
1483775	34-DW-B	Asbestos	04/07/2023
1483776	34-DW-C	Asbestos	04/07/2023

Reviewed by: 
Eleni Kiliaris

<u>Summary</u>			
Method	Sample	Layer	Mastic
PLM	114	3	3

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483675 1-RM-A	Roofing Material	Black Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483675 1-RM-A	Roofing Material	Black Fibrous Homogenous	PLM 15% Cellulose	PLM 85% Other	PLM None Detected
Layer-2 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483676 1-RM-B	Roofing Material	Black Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483676 1-RM-B	Roofing Material	Black Fibrous Homogenous	PLM 10% Cellulose	PLM 90% Other	PLM None Detected
Layer-2 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483677 1-RM-C	Roofing Material	Black Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483677 1-RM-C	Roofing Material	Black Fibrous Homogenous	PLM 10% Cellulose	PLM 90% Other	PLM None Detected
Layer-2 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483678 2-TS-A	Transite Siding	Gray Non-Fibrous Homogenous	PLM 25% Cellulose	PLM 65% Other	PLM 10% Chrysotile
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483679 2-TS-B		Positive Stop			
Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023 Sample Not Analyzed					
1483680 2-TS-C		Positive Stop			
Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023 Sample Not Analyzed					
1483681 3-VP-A	Vapor Paper	Black Fibrous Homogenous	PLM 30% Cellulose	PLM 70% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483682 3-VP-B	Vapor Paper	Black Fibrous Homogenous	PLM 30% Cellulose	PLM 70% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483683 3-VP-C	Vapor Paper	Black Fibrous Homogenous	PLM 20% Cellulose	PLM 80% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483684 4-VP-A	Vapor Paper	Black Fibrous Homogenous	PLM 8% Cellulose	PLM 92% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

1483685 4-VP-B	Vapor Paper	Black Fibrous Homogenous	PLM 6% Cellulose	PLM 94% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

1483686 4-VP-C	Vapor Paper	Black Fibrous Homogenous	PLM 5% Cellulose	PLM 95% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

1483687 5-VP-A	Vapor Paper	Black Non-Fibrous Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

1483688 5-VP-B	Vapor Paper	Black Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

1483689 5-VP-C	Vapor Paper	Black Non-Fibrous Homogenous	PLM 4% Cellulose	PLM 96% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483690 6-EC-A	Exterior Caulk	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483691 6-EC-B	Exterior Caulk	Gray Non-Fibrous Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483692 6-EC-C	Exterior Caulk	Gray Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483693 7-EC-A	Exterior Caulk	Gray Non-Fibrous Non-Homogenous	PLM 3% Cellulose	PLM 93% Other	PLM 4% Chrysotile
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483694 7-EC-B		Positive Stop			
Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023 Sample Not Analyzed					
1483695 7-EC-C		Positive Stop			
Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023 Sample Not Analyzed					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483696 8-EC-A	Exterior Caulk	Beige Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483697 8-EC-B	Exterior Caulk	Beige Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483698 8-EC-C	Exterior Caulk	Beige Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483699 9-WG-A	Window Glaze	White Non-Fibrous Non-Homogenous	PLM 4% Cellulose	PLM 96% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483700 9-WG-B	Window Glaze	White Non-Fibrous Non-Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483701 9-WG-C	Window Glaze	White Non-Fibrous Non-Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483702 10-WG-A	Window Glaze	Gray Non-Fibrous Non-Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483703 10-WG-B	Window Glaze	Gray Non-Fibrous Non-Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483704 10-WG-C	Window Glaze	Gray Non-Fibrous Non-Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483705 11-PL-A	Plaster	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483705 11-PL-A	Skim Coat	White Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-2 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483706 11-PL-B	Plaster	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483706 11-PL-B	Skim Coat	White Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-2 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483707 11-PL-C	Plaster	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483707 11-PL-C	Skim Coat	White Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-2 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483708 12-WBS-A	Drywall	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483708 12-WBS-A	Tape	White Fibrous Homogenous	PLM 15% Cellulose	PLM 85% Other	PLM None Detected
Layer-2 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483708 12-WBS-A	Mud	White Fibrous Homogenous	PLM 4% Cellulose	PLM 96% Other	PLM None Detected
Layer-3 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483709 12-WBS-B	Drywall	White Non-Fibrous Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483709 12-WBS-B	Tape	White Fibrous Homogenous	PLM 10% Cellulose	PLM 90% Other	PLM None Detected
Layer-2 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483709 12-WBS-B	Mud	White Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-3 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483710 12-WBS-C	Drywall	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483710 12-WBS-C	Tape	White Fibrous Homogenous	PLM 10% Cellulose	PLM 90% Other	PLM None Detected
Layer-2 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483710 12-WBS-C	Mud	White Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-3 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483711 13-WBS-A	Drywall	White Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483711 13-WBS-A	Tape	White Fibrous Homogenous	PLM 20% Cellulose	PLM 80% Other	PLM None Detected
Layer-2 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483711 13-WBS-A	Mud	White Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-3 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483712 13-WBS-B	Drywall	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483712 13-WBS-B	Tape	White Fibrous Homogenous	PLM 15% Cellulose	PLM 85% Other	PLM None Detected
Layer-2 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483712 13-WBS-B	Mud	White Fibrous Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-3 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483713 13-WBS-C	Drywall	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483713 13-WBS-C	Tape	White Fibrous Homogenous	PLM 10% Cellulose	PLM 90% Other	PLM None Detected
Layer-2 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483713 13-WBS-C	Mud	White Fibrous Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-3 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483714 14-SC-A	Stack Cement	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483715 14-SC-B	Stack Cement	Gray Non-Fibrous Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483716 14-SC-C	Stack Cement	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483717 15-HS-A	Heat Shield	White Fibrous Homogenous	PLM 2% Cellulose PLM 60% Fiberglass	PLM 38% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483718 15-HS-B	Heat Shield	White Fibrous Homogenous	PLM 1% Cellulose PLM 50% Fiberglass	PLM 49% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483719 15-HS-C	Heat Shield	White Fibrous Homogenous	PLM 1% Cellulose PLM 40% Fiberglass	PLM 59% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483720 16-FS-A	Floor Sheeting	Beige Fibrous Homogenous	PLM 4% Cellulose	PLM 96% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483721 16-FS-B	Floor Sheeting	Beige Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483722 16-FS-C	Floor Sheeting	Beige Fibrous Homogenous	PLM 4% Cellulose	PLM 96% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483723 17-MLF-A	Multi-layer Floor	Beige Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483723 17-MLF-A	Floor Sheeting	Brown Fibrous Homogenous	PLM 4% Cellulose	PLM 96% Other	PLM None Detected
Layer-2 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483724 17-MLF-B	Multi-layer Floor	Beige Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483724 17-MLF-B	Floor Sheeting	Brown Fibrous Homogenous	PLM 4% Cellulose	PLM 96% Other	PLM None Detected
Layer-2 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483725 17-MLF-C	Multi-layer Floor	Beige Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483725 17-MLF-C	Floor Sheeting	Brown Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-2 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483726 18-MLF-A	Multi-layer Floor	Black Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483726 18-MLF-A	Mastic	Brown Non-Fibrous Non-Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-2 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483727 18-MLF-B	Multi-layer Floor	Black Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483727 18-MLF-B	Mastic	Brown Non-Fibrous Non-Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-2 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483728 18-MLF-C	Multi-layer Floor	Black Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483728 18-MLF-C	Mastic	Brown Non-Fibrous Non-Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-2 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483729 19-FT-A	Floor Tile	Tan Non-Fibrous Non-Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483730 19-FT-B	Floor Tile	Tan Non-Fibrous Non-Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483731 19-FT-C	Floor Tile	Tan Non-Fibrous Non-Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483732 20-BM-A	Brick Mortar	Black Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483733 20-BM-B	Brick Mortar	Black Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483734 20-BM-C	Brick Mortar	Black Non-Fibrous Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483735 21-BM-A	Brick Mortar	Gray Non-Fibrous Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483736 21-BM-B	Brick Mortar	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483737 21-BM-C	Brick Mortar	Gray Non-Fibrous Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483738 22-BM-A	Brick Mortar	Gray Non-Fibrous Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483739 22-BM-B	Brick Mortar	Gray Non-Fibrous Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483740 22-BM-C	Brick Mortar	Gray Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483741 23-CC-A	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483742 23-CC-B	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483743 23-CC-C	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483744 24-CC-A	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483745 24-CC-B	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483746 24-CC-C	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483747 25-CC-A	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483748 25-CC-B	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483749 25-CC-C	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483750 26-CC-A	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483751 26-CC-B	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483752 26-CC-C	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483753 27-BI-A	Blown-in Insulation	Beige Fibrous Homogenous	PLM 15% Cellulose	PLM 85% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483754 27-BI-B	Blown-in Insulation	Beige Fibrous Homogenous	PLM 15% Cellulose	PLM 85% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483755 27-BI-C	Blown-in Insulation	Beige Fibrous Homogenous	PLM 20% Cellulose	PLM 80% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483756 28-RI-A	Rolled-in Insulation	White Fibrous Homogenous	PLM 2% Cellulose PLM 15% Fiberglass	PLM 83% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483757 28-RI-B	Rolled-in Insulation	White Fibrous Homogenous	PLM 1% Cellulose PLM 15% Fiberglass	PLM 84% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483758 28-RI-C	Rolled-in Insulation	White Fibrous Homogenous	PLM 2% Cellulose PLM 20% Fiberglass	PLM 78% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483759 29-RI-A	Rolled-in Insulation	White Fibrous Homogenous	PLM 6% Cellulose PLM 30% Fiberglass	PLM 64% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483760 29-RI-B	Rolled-in Insulation	White Fibrous Homogenous	PLM 5% Cellulose PLM 40% Fiberglass	PLM 55% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483761 29-RI-C	Rolled-in Insulation	White Fibrous Homogenous	PLM 5% Cellulose PLM 30% Fiberglass	PLM 65% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483762 30-RI-A	Rolled-in Insulation	Pink Fibrous Homogenous	PLM 2% Cellulose PLM 20% Fiberglass	PLM 78% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483763 30-RI-B	Rolled-in Insulation	Pink Fibrous Homogenous	PLM 2% Cellulose PLM 10% Fiberglass	PLM 88% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483764 30-RI-C	Rolled-in Insulation	Pink Fibrous Homogenous	PLM 2% Cellulose PLM 20% Fiberglass	PLM 78% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483765 31-IC-A	Interior Caulk	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483766 31-IC-B	Interior Caulk	Gray Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483767 31-IC-C	Interior Caulk	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483768 32-IC-A	Interior Caulk	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483769 32-IC-B	Interior Caulk	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483770 32-IC-C	Interior Caulk	White Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483771 33-RI-A	Rolled-in Insulation	Yellow Fibrous Homogenous	PLM 2% Cellulose PLM 10% Fiberglass	PLM 88% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483772 33-RI-B	Rolled-in Insulation	Yellow Fibrous Homogenous	PLM 1% Cellulose PLM 10% Fiberglass	PLM 89% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

Polarized Light Microscopy Asbestos Analysis Report


To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 256487
Client Project : 188BS23234
Date Collected : 03/31/2023
Date Received : 04/05/2023

Location :
 518 W North St.

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1483773 33-RI-C	Rolled-in Insulation	Yellow Fibrous Homogenous	PLM 2% Cellulose PLM 10% Fiberglass	PLM 88% Other	PLM None Detected
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483774 34-DW-A	Duct Wrap	Gray Fibrous Homogenous	PLM 1% Cellulose	PLM 49% Other	PLM 50% Chrysotile
Layer-1 Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023					
1483775 34-DW-B		Positive Stop			
Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023 Sample Not Analyzed					
1483776 34-DW-C		Positive Stop			
Analyst: Shelby Fogelsong Date Analyzed : 04/07/2023 Sample Not Analyzed					


 Lab Supervisor/Other Signatory

Analyst:

 Shelby Fogelsong

400 Point Count Results by EPA 600/R-93/116 PLM (denoted by "PC")
 Item 198.1: PLM Methods for Identifying and Quantitating Asbestos in Bulk Samples
 Item 198.6: PLM Methods for Identifying and Quantitating Asbestos in Non-Friable Organically Bound Bulk Samples
 EPA 600/R-93/116: Method for Determination of Asbestos in Bulk Building Materials
 EPA 600/M4-82-020: Interim Method for Determination of Asbestos in Bulk Insulation Samples
 A % Asbestos result of "Trace" indicates that the analyzed material was found to contain less than 1% asbestos and would not be considered an Asbestos Containing Material (ACM).

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

**Bulk Asbestos
 Chain of Custody**

ETL Project #: **2560487**

518 W North St
 LP

Client: ATC Group Services	Contact: Rob Smith Phone: 248-669-5140	Project Location/name: 790 E VINE STREET, KALAMAZOO, MICHIGAN 49007 - CITY OF KALAMAZOO ACM SURVEY
Address: 46555 Humboldt Dr. Ste. 100 Novi, MI 48377	Fax: 248-669-5147 E-mail: robert.smith@atcgs.com	Client Project #: 188523234
Please Provide Results: <input checked="" type="checkbox"/> Email <input type="checkbox"/> Fax <input type="checkbox"/> Verbal <input type="checkbox"/> Other		Date Sampled: 3.31.2023

Turnaround Time (TAT): RUSH Same Day 24 hr 48 hr Standard (3-5 days) Other 72 hours

PLM Instructions
 (Check all that apply)

PLM EPA600/R-93/116, 1993 (Standard method) Stop at 1st Positive -
 Clearly mark Homogenous Group

Point Counting: 400 Points* NYSDOH ELAP 198.1, 2002*
 Gravimetric Reduction* NYSDOH ELAP 198.6, 2010*
 PLM Non-Building Material (Dust, Wipe, Tape) Soil or Vermiculite Analysis*

* Additional charge and turnaround may be required

Lab ID	Sample ID	Material Description	Sample Location	QUANTITY
1483675	1-RM-A,B,C	676,677 Roofing material - house asphalt shingle roof	EA-10	1050 SF
678,679	2-TS-A,B,C	680 Transite siding - on exterior walls and pipe under rear porch	EA-1,2,3,4	1,890 SF
681,682	3-VP-A,B,C	683 Vapor paper - under wood siding (under transite siding)	EA-1,2,3,4	1,890 SF
684,685	4-VP-A,B,C	686 Vapor paper - black, under transite siding	EA-1,2,3,4	1,890 SF
687,688	5-VP-A,B,C	689 Vapor paper - black, under transite siding seam	EA-1,2,3,4	630 SF
690,691	6-EC-A,B,C	692 Exterior caulk - grey, on front porch wood siding/trim	EA-1	15 LF
693,694	7-EC-A,B,C	695 Exterior caulk - grey, on transite (patches, seams, roofline)	EA-1,2,3,4	155 LF
696,697	8-EC-A,B,C	698 Exterior caulk - beige, perimeter of basement windows	EA-2,4	35 LF
699,700	9-WG-A,B,C	701 Window glaze - basement windows	EA-2,4	4 windows
702,703	10-WG-A,B,C	704 Window glaze - multi-pane window (rear porch window)	EA-3	1 window

	Name/Organization	Date	Time
Relinquished (Name/Organization):	Andrew DeLodder / Atlas Technical Consultants	4-4-2023	12:00 PM
Received (Name/ETL):	<i>[Signature]</i>	4-5-23	10:45 am
Sample Login (Name/ETL):	<i>[Signature]</i>	4-5-23	2:45 am
Stereoscopic/Sample Analysis (Name/ETL):	<i>[Signature]</i>	4-7-23	6:00 am
Results (Name/ETL):	<i>[Signature]</i>	4-7-23	6:00 am
QA/QC Review (Name/ETL):	<i>[Signature]</i>	4-10-23	9:00 am

Special Instructions: • 1st Positive Stop;
 • Composite all drywall/joint compound/mud samples if any layer of system is GREATER than 1% asbestos;
 • Point Count ALL PLASTER samples Trace to 3% asbestos content
 • Point Count ALL SAMPLES Trace to 1% asbestos content

Remarks

**IN ORDER TO ENSURE RESULTS BY SPECIFIED TAT, THE LAB MUST BE EMAILED/CALLED WITH THE QUANTITY OF SAMPLES TO BE SHIPPED OR DROPPED OFF

1/2

Bulk Asbestos
 Chain of Custody

ETL Project #: 2560487

Additional Pages of the Chain of Custody are only necessary if needed for additional sample information

Lab ID	Sample ID	Material Description	Sample Location	QUANTITY
148, 305	11-PL-A,B,C	706, 707 Plaster - on lath, in closets of bedrooms	FS-11, 13	150 SF
708, 709	12-WBS-A,B,C	710 Wallboard system - wall	EA-1	150 SF
711, 712	13-WBS-A,B,C	713 Wallboard system - walls/ceiling	FS-4,5,7,8,9,10,11,12,13,14	4,270 SF
714, 715	14-SC-A,B,C	716 Stack cement - on stack	FS-2	5 SF
717, 718	15-HS-A,B,C	719 Heat shield - light fixture	FS-4	1 SF
720, 721	16-FS-A,B,C	722 Floor sheeting - kitchen	FS-7	135 SF
723, 724	17-MLF-A,B,C	725 Multi-layer floor - rear porch	FS-16	60 SF
726, 727	18-MLF-A,B,C	728 Multi-layer floor - dinning room / living room	FS-9,10	340 SF
729, 730	19-FT-A,B,C	731 Floor tile - stack of 12" blue and beige with rectangle pattern stick-on	FS-14	1 stack (50 tiles)
732, 733	20-BM-A,B,C	734 Brick mortar - red brick debris	EA-1	40 SF
735, 736	21-BM-A,B,C	737 Brick mortar - exterior foundation, concrete block	EA-1,2,3,4	810 SF
738, 739	22-BM-A,B,C	740 Brick mortar - Stack	FS-2	150 SF
741, 742	23-CC-A,B,C	743 Concrete chip - exterior	EA-1	30 SF
744, 745	24-CC-A,B,C	746 Concrete chip - basement wall skim coat	FS-1	810 SF
747, 748	25-CC-A,B,C	749 Concrete chip - basement floor	FS-1	980 SF
750, 751	26-CC-A,B,C	752 Concrete chip - basement walls (under skim coat)	FS-1	810 SF
753, 754	27-BI-A,B,C	755 Blown-in insulation -cellulose, attic and attic voids	FS-3, 15	800 SF
756, 757	28-RI-A,B,C	758 Rolled-in insulation - white, packed in rat-wall, no backing paper	FS-1	80 SF
759, 760	29-RI-A,B,C	761 Rolled-in insulation - white with black backing paper, attic voids	FS-3, 15	120 SF
762, 763	30-RI-A,B,C	764 Rolled-in insulation - red with brown backing paper - in exterior walls (1st and 2nd fl)	EA-1,2,3,4	1,890 SF
765, 766	31-IC-A,B,C	767 Interior caulk - grey, seams of HVAC ducts	FS-1	5 SF
768, 769	32-IC-A,B,C	770 Interior caulk - White, on interior wood trim	FS-4,5,6,7,8,9,10,11,13,14	175 LF
771, 772	33-RI-A,B,C	773 Rolled-in insulation - hot water heater tank insulation, yellow with white vinyl wrap	FS-1	60 SF
774, 775	34-DW-A,B,C	776 Duct wrap, over duct in attic ductwork, directly to the right after attic void door, may be located on risers in walls	FS-15	10 SF
	NA	NA	NA	NA
	NA	NA	NA	NA
	NA	NA	NA	NA

212

ATTACHMENT B
PHOTOGRAPHS

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
518 N. WEST STREET
KALAMAZOO, MI 49007



Street view of the house located at 518 N West Street (EA-1) / (EA-5)



View of the left side of the house (EA-2)

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
518 N. WEST STREET
KALAMAZOO, MI 49007



View of the rear of the house (EA-3)



View of the right side of the house (EA-4)

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
518 N. WEST STREET
KALAMAZOO, MI 49007



View of FS-1



View of FS-2

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
518 N. WEST STREET
KALAMAZOO, MI 49007



View of FS-3



View of FS-4

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
518 N. WEST STREET
KALAMAZOO, MI 49007



View of FS-5



View of FS-6

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
518 N. WEST STREET
KALAMAZOO, MI 49007



View of FS-7



View of FS -8

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
518 N. WEST STREET
KALAMAZOO, MI 49007



View of FS-9



View of FS-10

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
518 N. WEST STREET
KALAMAZOO, MI 49007



View of FS-11



View of FS-12

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
518 N. WEST STREET
KALAMAZOO, MI 49007



View of FS-13



View of FS-14

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
518 N. WEST STREET
KALAMAZOO, MI 49007




View of FS-15



View of FS-16

ATTACHMENT C
FUNCTIONAL SPACE MAPS

Circle: (Attic) (1st Floor) (2nd Floor) (Basement) (Garage)

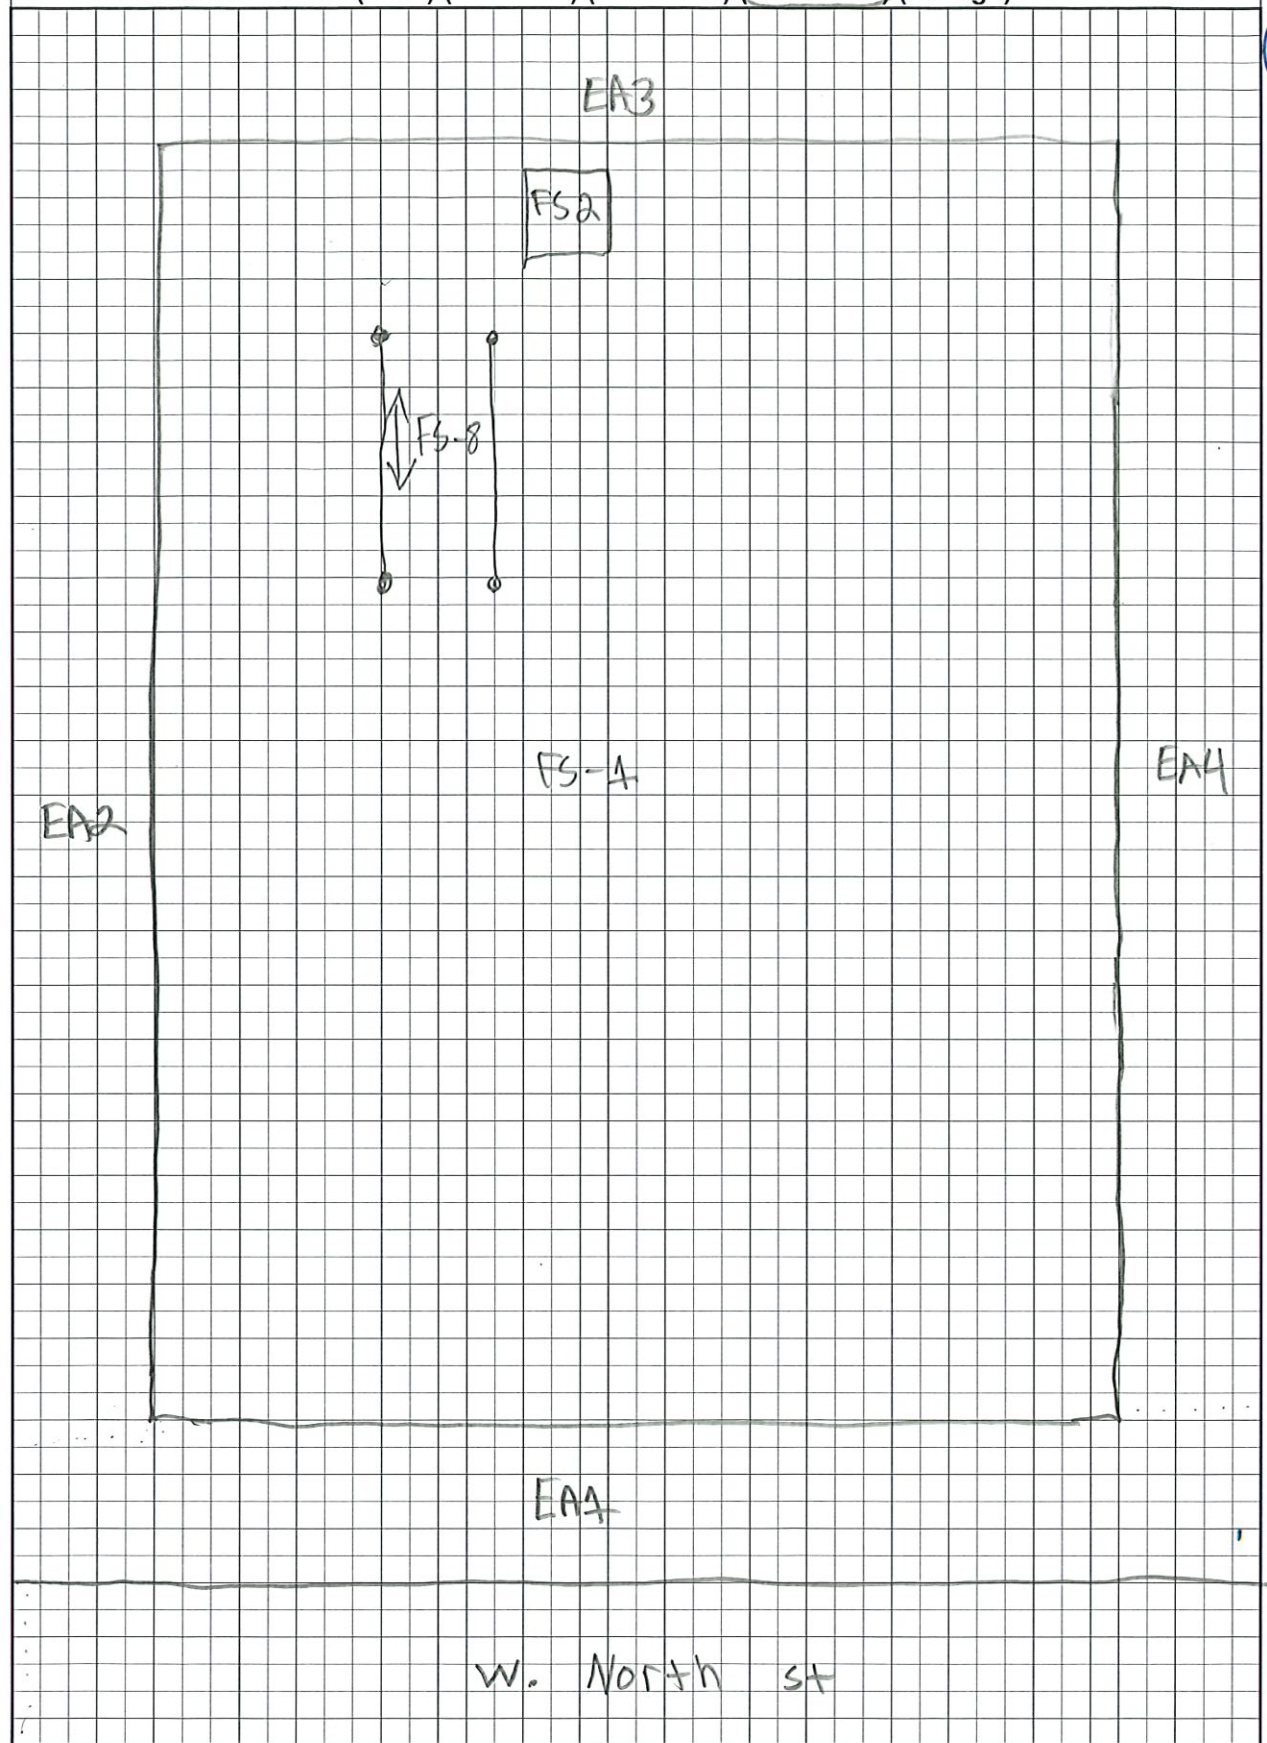


EA3
Roof

Street Address: 518 W North Street, Kalamazoo, Michigan



Circle: (Attic) (1st Floor) (2nd Floor) (Basement) (Garage)

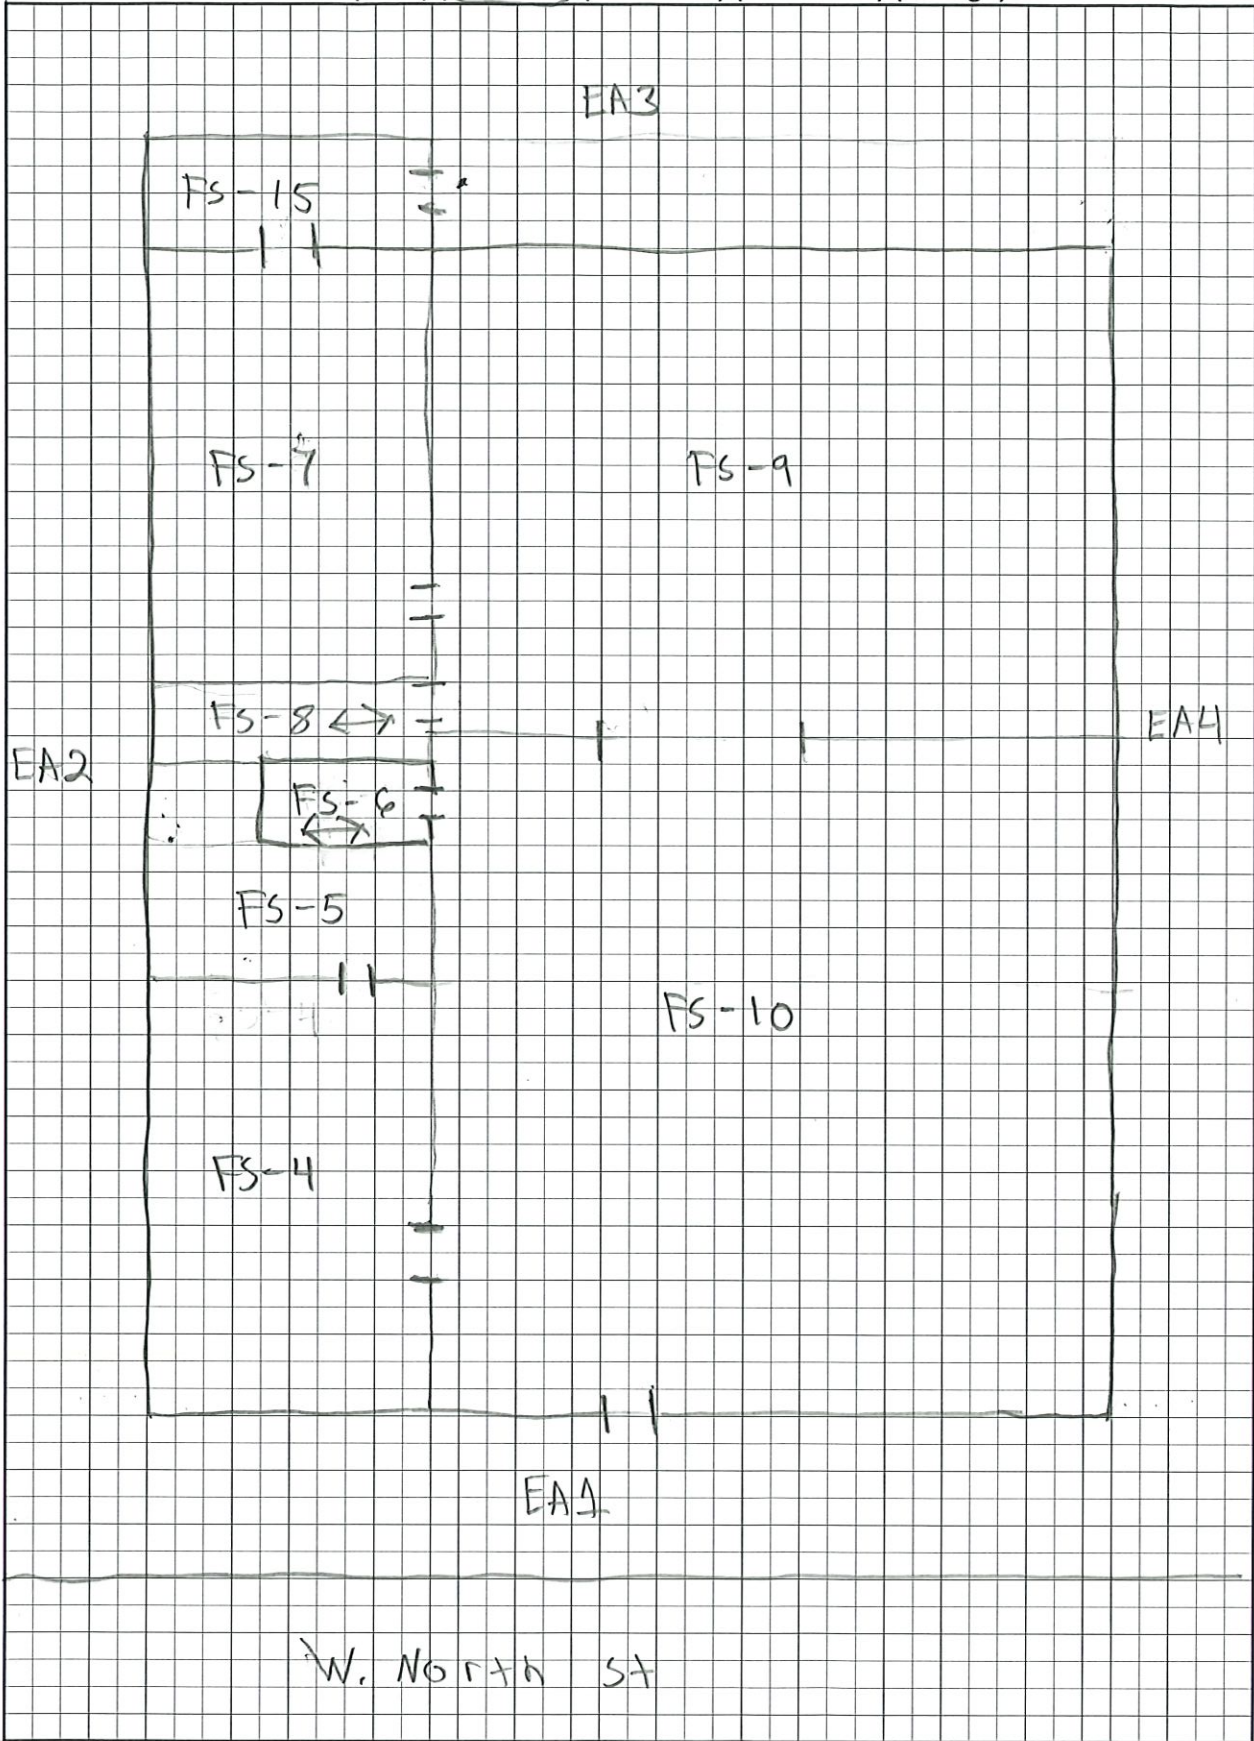

EA5
ROOF


Street Address: 518 W North Street, Kalamazoo, Michigan



Circle: (Attic) (1st Floor) (2nd Floor) (Basement) (Garage)



EAS
Roof

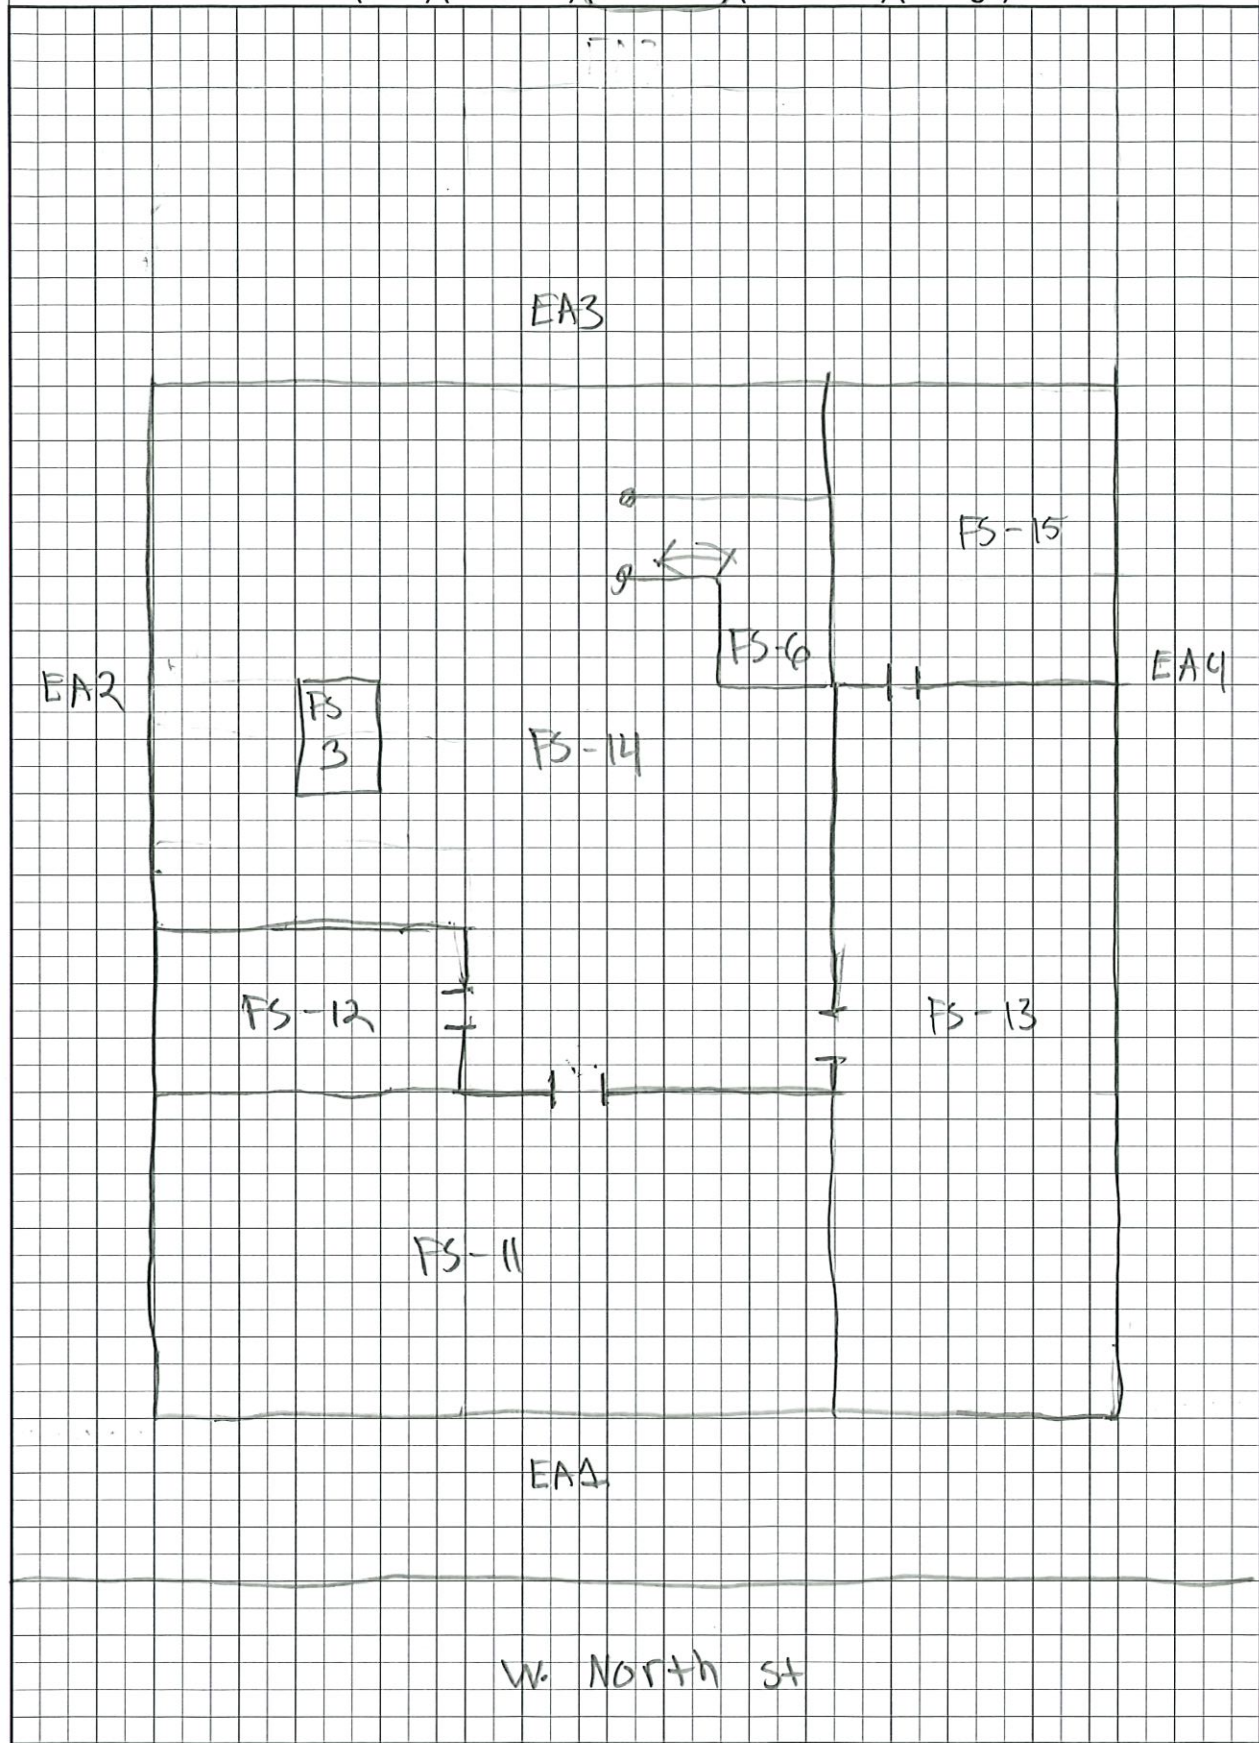


Street Address: 518 W North Street, Kalamazoo, Michigan



26
27

Circle: (Attic) (1st Floor) (2nd Floor) (Basement) (Garage)

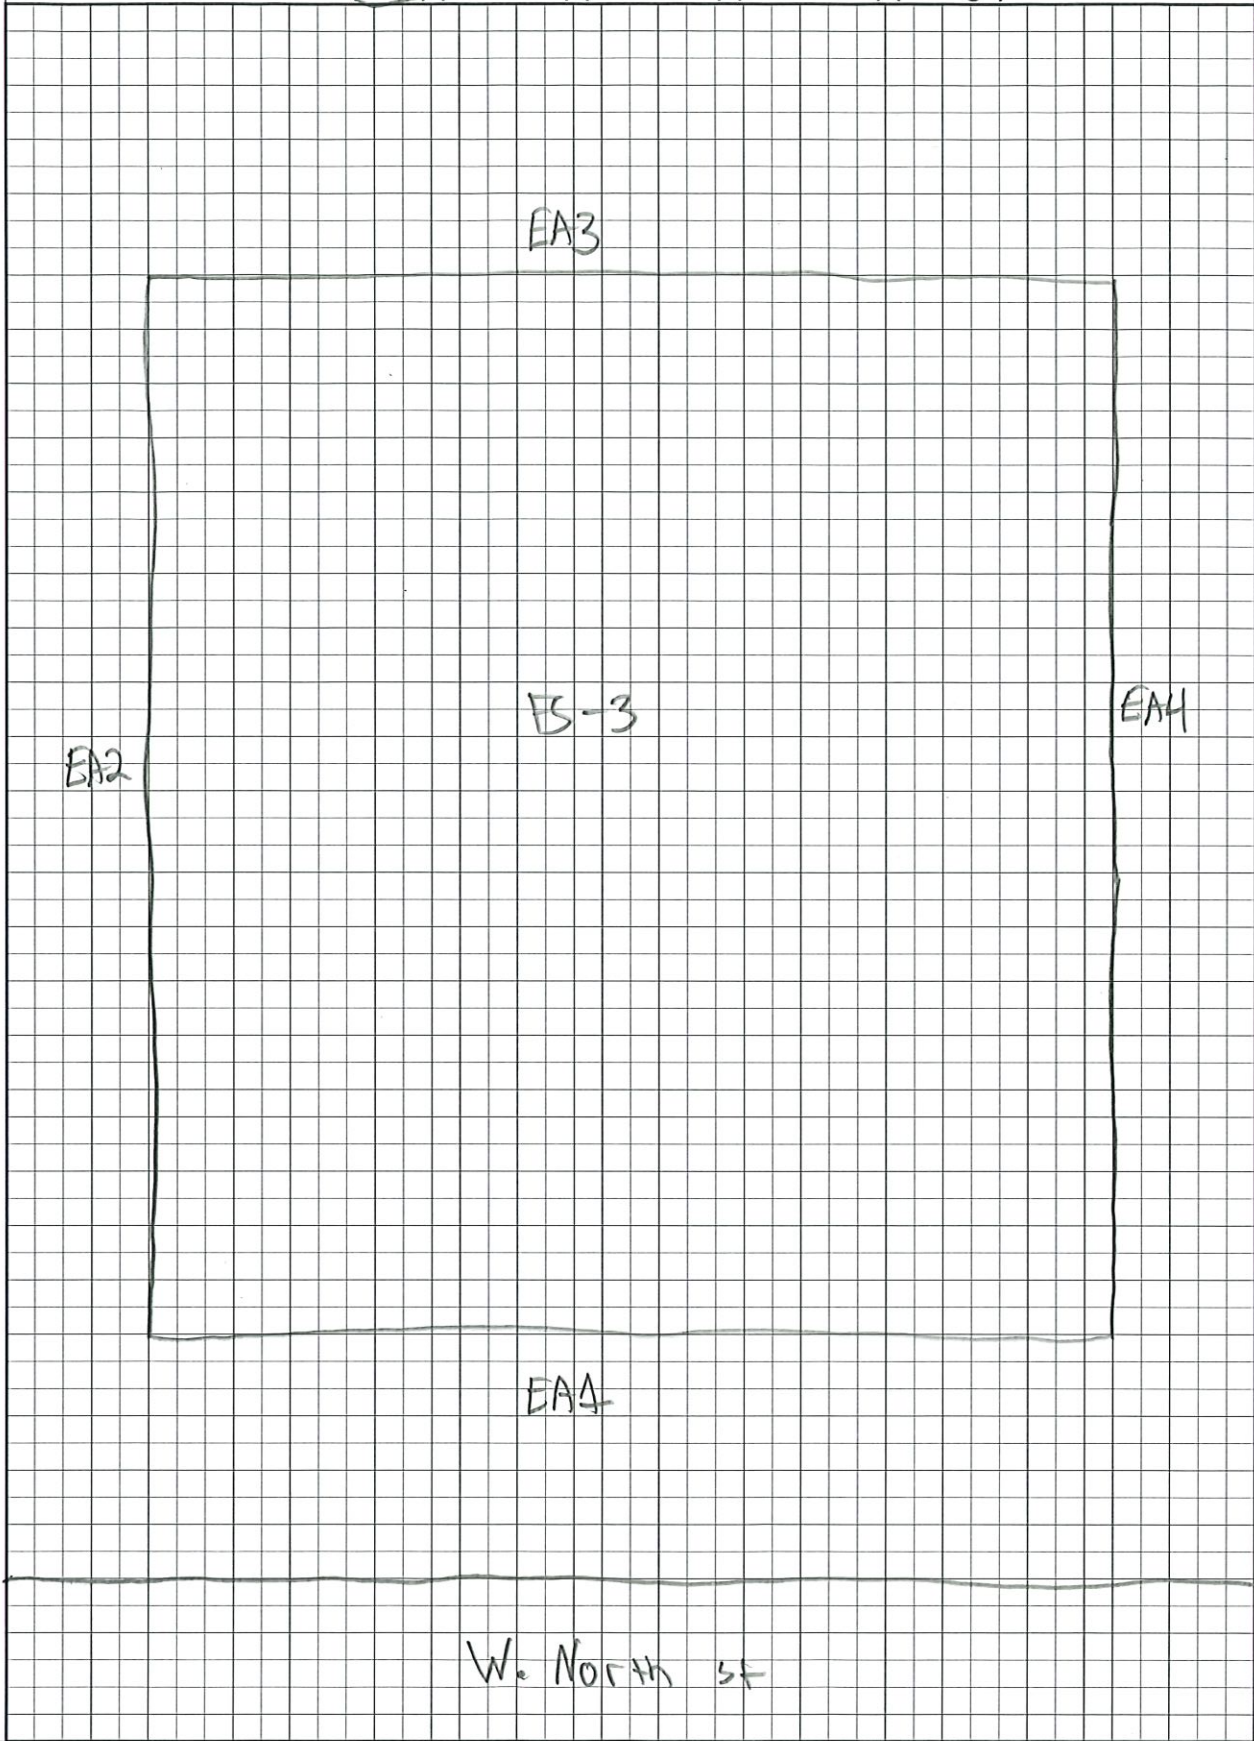

EA6
ROOF

Street Address: 518 W North Street, Kalamazoo, Michigan

26 ←
37 ↑





46555 Humboldt Dr. Ste. 100
Novi, MI 48377
(248) 669-5140 | oneatlas.com



Client Name:	City of Kalamazoo
Project Name:	Commercial Building Asbestos Survey
Project Number:	188BS23419
Project Site Address (Subject Property):	750 Skinner Drive, Kalamazoo, MI 49700
Date of Site Visit:	May 24, 2023
Asbestos Inspection Performed by:	Corey Pruitt (A57116)
Asbestos Inspector's Signature:	
Areas Not Accessible:	Basement, 2 nd Floor and front portion of 1 st floor were inaccessible.
Number of Floors:	2 floors plus basement
Asbestos Present (Yes/No/Other):	Yes, additional ACM may be present in inaccessible areas.

On the date indicated above, State of Michigan Asbestos Inspector, Corey Pruitt (A57116) from Atlas Technical Consultants, conducted a pre-demolition asbestos and other regulated materials inspection of the subject unoccupied commercial property.

Table I identifies materials that were found to contain asbestos in concentrations greater than 1% and therefore are regulated under the rules of asbestos in the State of Michigan.

TABLE I
Asbestos-Containing Materials

ID#	MATERIAL	LOCATION	QUANTITY	RESULT	NESHAP CATEGORY
12-WG-A,B,C	Window Glaze (Basement)	EA 1,2,3,4	5 Windows	PLM 3% Chrysotile	Cat II

The purpose of this inspection was to task an accredited asbestos inspector to complete a pre-demolition asbestos and hazardous material survey of the subject site, and provide recommendation options for removal and disposal of identified hazardous/regulated materials prior to demolition of the building(s). The asbestos inspection consisted of the following three basic procedures: conducting a visual inspection of the structure, identifying homogeneous areas (HAs) of suspect surfacing, thermal system insulation, and miscellaneous materials; and sampling identified friable and non-friable suspect materials.

Bulk samples of suspect ACMs were collected and placed into individual containers for transport under Chain of Custody (COC) to a National Voluntary Lab Accreditation Program (NVLAP)-accredited laboratory for analysis. Materials typically known as non-asbestos items (i.e. fibrous glass, foam rubber, wood, etc.) were not sampled.

Laboratory Reports and associated COC's are provided in **Attachment A**. Photographs of the site are included in **Attachment B**. The following sections summarize Atlas' findings.

Table II below identifies the suspect asbestos-containing materials identified during the survey, their locations, approximate quantity, type and percentage of asbestos.

TABLE II
Suspect Asbestos-Containing Materials

HA/ID#	MATERIAL	LOCATION	RESULT
1-RM-A,B,C	Roofing Material	EA 5	ND
2-VP-A,B,C	Vapor Paper (Under wood siding)	EA 1,2,3,4	ND
3-EC-A,B,C	Exterior Caulk (on Aluminum siding)	EA 1,2,3,4	ND
4-WG-A,B,C	Window Glaze (House)	EA 1,2,3,4	ND
5-PL-A,B,C,D,E	Plaster on Lath	FS 1,2,3	ND
6-TPL-A,B,C	Textured Plaster (on Ceiling)	FS 3	ND
7-WBS-A,B,C	Wallboard System	FS 2	ND
8-BM-A,B,C	Brick Mortar (Exterior)	EA 1,2,3,4	ND
9-CC-A,B,C	Concrete Chip (Exterior)	EA 4	ND
10-CC-A,B,C	Concrete Chip (Slab boat is sitting on)	EA 2	ND
11-ASD-A,B,C	Asphalt driveway (Over concrete)	EA 4	ND
12-WG-A,B,C	Window Glaze (Basement)	EA 1,2,3,4	PLM 3% Chrysotile

ND = No asbestos detected, NA = Not applicable, UNQ = Unquantified; PC = Point Count

No other suspect ACMs were observed on the site. Although not anticipated based on surface observations, underground structures that could contain ACM may be present and should be managed accordingly if encountered during site redevelopment.

Asbestos is a hazardous substance. Its condition, handling and disposal are regulated by federal, state, and local agencies. ACMs generally do not pose a health threat unless the asbestos fibers are disturbed, become airborne and are inhaled.

Contractors working in an area where asbestos is present must be informed of the type and location of ACMs. Abatement of ACMs, including non-friable ACMs, must be performed by a Michigan licensed, certified and registered asbestos abatement contractor in accordance with state and federal Occupational Safety and Health Administration (OSHA) and local air quality management regulations.

Table III below lists Other Regulated Materials/Universal Wastes identified during the survey.

**TABLE III
Other Regulated Materials/Universal Wastes**

MATERIAL	LOCATION	APPROXIMATE QUANTITY
CFC's Air Conditioners/Refrigerators/Freezers/Dehumidifiers	FS-4	1
CRTs/ TV Screens/ Monitors/Electronics	FS-3	2

Table IV below lists the functional spaces identified during the survey.

**Table IV
Functional Space/ Exterior Area Designations**

DESCRIPTION	DESIGNATION
Interior Functional Spaces	
Ground Level	FS- 1,2,3,4,5
2 nd Floor	FS-7
Basement	FS-6
Exterior Areas	
Roof	EA-5
Outside Surrounding	EA- 1,2,3,4

RECOMMENDATIONS:

Except for the following items listed below, Section 61.145(c) of the Asbestos NESHAP requires that each owner or operator of a demolition or demolition activity involving RACM remove all such material from a facility being demolished or renovated before any activity begins that would break up, dislodge, or similarly disturb the material or preclude access to the material for subsequent removal.

ACM need not be removed before demolition if it:

(i) Is a Category I non-friable ACM that is not friable.

(ii) Is on a facility component that is encased in concrete or other similarly hard material and is adequately wet whenever exposed during demolition.

(iii) Was not accessible for testing and therefore was not discovered until after demolition began and, as a result of the demolition, cannot be safely removed. If not removed for safety reasons, the exposed RACM and any asbestos-contaminated debris must be treated as asbestos-containing waste material and kept adequately wet at all times until disposed of.

(iv) Is a Category II non-friable ACM and the probability is low that the material will become crumbled, pulverized, or reduced to powder during demolition.

Demolition with Roofing Materials in place is covered under the NESHAP regulations (40 CFR Part 61 Subpart M).

Roofing materials that were not tested during this inspection should be assumed to be Category I asbestos-containing roofing materials.

Since demolition activities do not include sanding, grinding, cutting, or abrading, Category I asbestos-containing roofing materials not in poor condition and not friable are not considered RACM, and are allowed to remain in place during demolition.

If the asbestos-containing roofing material is not in poor condition and is not friable, it may be disposed of in a landfill which accepts ordinary demolition waste.

The asbestos-containing roofing material may not be ground up for recycling into other products.

*If joint compound within the drywall system is identified as positive, a composite sample was analyzed per NESHAP. If the drywall system as a composite sample is less than 1% asbestos, the material is not considered RACM per NESHAP. However, OSHA requirements regarding materials containing less than 1% asbestos still apply, and contractors performing work should ensure they comply with the requirements if the material is not removed prior to demolition.

In addition, contractors should ensure they follow all OSHA regulations pertaining to demolition / demolition of Category I Asbestos-containing materials. Category I or II non-friable ACM that is not subject to 61.150(a)(3) would still have to be disposed of in a landfill that accepts building debris, in a landfill that operates in accordance with 61.154, or at a facility that operates in accordance with 61.155.

Prior to demolition, the following is recommended:

An asbestos abatement company, licensed in the State of Michigan should remove the materials identified as asbestos containing in Table I in accordance with all applicable Local, State, and Federal Requirements prior

to demolition.

Other Regulated Materials/Universal Wastes, identified in Table III, must be transported and disposed in accordance with all applicable Local, State, and Federal Requirements prior to demolition.

LIMITATIONS:

The results, findings, conclusions, and recommendations expressed in the report are based only on conditions that were noted during Atlas' inspection of the vacant above-referenced property located in Kalamazoo, Michigan.

Any conditions or materials that could not be visually identified through limited destructive sampling were not inspected and may differ from those conditions or materials noted. The user of this report should keep in mind that conditions may change with time and observations made by Atlas at the time of the site reconnaissance may not be consistent with future observations made by others.

Additional materials may be encountered during the demolition process and may require further sampling to determine disposal criteria.

The report is designed to aid the building owner, architect, construction manager, general contractors, and potential asbestos abatement contractors in locating asbestos building materials and Other Regulated Materials/Universal Wastes to be removed prior to demolition activities.

Under no circumstances is the report to be utilized as a bidding document or as a project specification document. Contractors bidding the demolition of this site should field-verify project information.

Atlas appreciates the opportunity to be of service to the City of Kalamazoo on this project. In the meantime, if you have questions regarding the information in this report or if we can be of further assistance do not hesitate to contact our office at (248) 669-5140.

ATTACHMENT A

LABORATORY REPORTS AND CHAIN OF CUSTODY



**ENVIRONMENTAL TESTING
LABORATORIES, INC.**

37575 W HURON RIVER DRIVE
ROMULUS, MICHIGAN 48174
(734) 955-6600
FAX: (734) 955-6604

To: Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job: 258026
Client Project: 188BS23419

Attention: Robert Smith
Project Location: 750 Skinner Dr., Kalamazoo , MI 49700

Lab Sample Number	Client Sample Number	Sample Type	Completed
1515182	1-RM-A	Asbestos	06/02/2023
1515183	1-RM-B	Asbestos	06/02/2023
1515184	1-RM-C	Asbestos	06/02/2023
1515185	2-VP-A	Asbestos	06/02/2023
1515186	2-VP-B	Asbestos	06/02/2023
1515187	2-VP-C	Asbestos	06/02/2023
1515188	3-EC-A	Asbestos	06/02/2023
1515189	3-EC-B	Asbestos	06/02/2023
1515190	3-EC-C	Asbestos	06/02/2023
1515191	4-WG-A	Asbestos	06/02/2023
1515192	4-WG-B	Asbestos	06/02/2023
1515193	4-WG-C	Asbestos	06/02/2023
1515194	5-PL-A	Asbestos	06/02/2023
1515195	5-PL-B	Asbestos	06/02/2023
1515196	5-PL-C	Asbestos	06/02/2023
1515197	5-PL-D	Asbestos	06/02/2023

Lab Sample Number	Client Sample Number	Sample Type	Completed
1515198	5-PL-E	Asbestos	06/02/2023
1515199	6-TPL-A	Asbestos	06/02/2023
1515200	6-TPL-B	Asbestos	06/02/2023
1515201	6-TPL-C	Asbestos	06/02/2023
1515202	7-WBS-A	Asbestos	06/05/2023
1515203	7-WBS-B	Asbestos	06/05/2023
1515204	7-WBS-C	Asbestos	06/05/2023
1515205	8-BM-A	Asbestos	06/05/2023
1515206	8-BM-B	Asbestos	06/05/2023
1515207	8-BM-C	Asbestos	06/05/2023
1515208	9-CC-A	Asbestos	06/05/2023
1515209	9-CC-B	Asbestos	06/05/2023
1515210	9-CC-C	Asbestos	06/05/2023
1515211	10-CC-A	Asbestos	06/05/2023
1515212	10-CC-B	Asbestos	06/05/2023
1515213	10-CC-C	Asbestos	06/05/2023
1515214	11-ASD-A	Asbestos	06/05/2023
1515215	11-ASD-B	Asbestos	06/05/2023
1515216	11-ASD-C	Asbestos	06/05/2023
1515217	12-WG-A	Asbestos	06/05/2023
1515218	12-WG-B	Asbestos	06/05/2023
1515219	12-WG-C	Asbestos	06/05/2023

This report is intended for use solely by the individual or entity to which it is addressed. This report may not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the Federal Government. It may contain information that is privileged, confidential and otherwise exempt by law from disclosure. If the reader of this information is not the intended recipient or an employee of its intended recipient, you are herewith notified that any dissemination, distribution or copying of this information is strictly prohibited. If you have received this information in error, please notify ETL immediately. Thank you.

Reviewed by:



Jessica Dilworth

Summary

Method	Sample	Layer	Mastic
PLM	57	8	



Certificate of Analysis

Environmental Testing Laboratories, Inc.
37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258026
Client Project : 188BS23419
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
750 Skinner Dr., Kalamazoo , MI 49700

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515182 1-RM-A	Roofing Material	Green Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515183 1-RM-B	Roofing Material	Green Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515184 1-RM-C	Roofing Material	Green Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515185 2-VP-A	Vapor Paper	Brown Fibrous Homogenous	PLM 90% Cellulose	PLM 10% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515186 2-VP-B	Vapor Paper	Brown Fibrous Homogenous	PLM 90% Cellulose	PLM 10% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515187 2-VP-C	Vapor Paper	Brown Fibrous Homogenous	PLM 90% Cellulose	PLM 10% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258026
Client Project : 188BS23419
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
750 Skinner Dr., Kalamazoo , MI 49700

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515188 3-EC-A	Exterior Caulk	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515189 3-EC-B	Exterior Caulk	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515190 3-EC-C	Exterior Caulk	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515191 4-WG-A	Window Glaze	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515192 4-WG-B	Window Glaze	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515193 4-WG-C	Window Glaze	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258026
Client Project : 188BS23419
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
750 Skinner Dr., Kalamazoo , MI 49700

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515194 5-PL-A	Plaster	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515194 5-PL-A	Skim Coat	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-2 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515194 5-PL-A	Plaster	Green Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-3 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515194 5-PL-A	Texture	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-4 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 199.1 and/or 199.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.
37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258026
Client Project : 188BS23419
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
750 Skinner Dr., Kalamazoo , MI 49700

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515195 5-PL-B	Plaster	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515195 5-PL-B	Skim Coat	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-2 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515195 5-PL-B	Plaster	Green Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-3 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515195 5-PL-B	Texture	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-4 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258026
Client Project : 188BS23419
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
750 Skinner Dr., Kalamazoo , MI 49700

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515196 5-PL-C	Plaster	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515196 5-PL-C	Skim Coat	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-2 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515196 5-PL-C	Plaster	Green Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-3 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515196 5-PL-C	Texture	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-4 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258026
Client Project : 188BS23419
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
750 Skinner Dr., Kalamazoo , MI 49700

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515197 5-PL-D	Plaster	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515197 5-PL-D	Skim Coat	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-2 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515197 5-PL-D	Plaster	Green Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-3 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515197 5-PL-D	Texture	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-4 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258026
Client Project : 188BS23419
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
750 Skinner Dr., Kalamazoo , MI 49700

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515198 5-PL-E	Plaster	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515198 5-PL-E	Skim Coat	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-2 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515198 5-PL-E	Plaster	Green Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-3 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515198 5-PL-E	Texture	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-4 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP Item 198.1 and/or 199.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.
37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258026
Client Project : 188BS23419
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
750 Skinner Dr., Kalamazoo , MI 49700

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515199 6-TPL-A	Textured Plaster	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515199 6-TPL-A	Skim Coat	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-2 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515199 6-TPL-A	Plaster	Green Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-3 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515199 6-TPL-A	Texture	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-4 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258026

Client Project : 188BS23419

Date Collected : 05/24/2023

Date Received : 05/31/2023

Location :

750 Skinner Dr., Kalamazoo , MI 49700

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515200 6-TPL-B	Textured Plaster	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515200 6-TPL-B	Skim Coat	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-2 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515200 6-TPL-B	Plaster	Green Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-3 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515200 6-TPL-B	Texture	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-4 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP Item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.
37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258026
Client Project : 188BS23419
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
750 Skinner Dr., Kalamazoo , MI 49700

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515201 6-TPL-C	Textured Plaster	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515201 6-TPL-C	Skim Coat	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-2 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515201 6-TPL-C	Plaster	Green Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-3 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					
1515201 6-TPL-C	Texture	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-4 Analyst: Amanda Hanzel Date Analyzed : 06/02/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.
37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258026
Client Project : 188BS23419
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
750 Skinner Dr., Kalamazoo , MI 49700

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515202 7-WBS-A	Wallboard System-Drywall	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Amanda Hanzel Date Analyzed : 06/05/2023					
1515202 7-WBS-A	Mud	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-2 Analyst: Amanda Hanzel Date Analyzed : 06/05/2023					
1515202 7-WBS-A	Tape	White Fibrous Homogenous	PLM 90% Cellulose	PLM 10% Other	PLM None Detected
Layer-3 Analyst: Amanda Hanzel Date Analyzed : 06/05/2023					
1515203 7-WBS-B		Layer Missing			
Layer-1 Analyst: Amanda Hanzel Date Analyzed : 06/05/2023 Layer Not Analyzed					
1515203 7-WBS-B	Mud	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-2 Analyst: Amanda Hanzel Date Analyzed : 06/05/2023					
1515203 7-WBS-B	Tape	White Fibrous Homogenous	PLM 80% Cellulose	PLM 20% Other	PLM None Detected
Layer-3 Analyst: Amanda Hanzel Date Analyzed : 06/05/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258026
Client Project : 188BS23419
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
750 Skinner Dr., Kalamazoo , MI 49700

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515204 7-WBS-C	Wallboard System-Drywall	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-1 Analyst: Amanda Hanzel Date Analyzed : 06/05/2023					
1515204 7-WBS-C	Mud	White Non-Fibrous Homogenous	PLM 10% Cellulose	PLM 90% Other	PLM None Detected
Layer-2 Analyst: Amanda Hanzel Date Analyzed : 06/05/2023					
1515204 7-WBS-C	Tape	White Fibrous Homogenous	PLM 90% Cellulose	PLM 10% Other	PLM None Detected
Layer-3 Analyst: Amanda Hanzel Date Analyzed : 06/05/2023					
1515205 8-BM-A	Brick Mortar	Brown Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/05/2023					
1515206 8-BM-B	Brick Mortar	Brown Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/05/2023					
1515207 8-BM-C	Brick Mortar	Brown Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/05/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258026
Client Project : 188BS23419
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
750 Skinner Dr., Kalamazoo , MI 49700

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515208 9-CC-A	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/05/2023					
1515209 9-CC-B	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/05/2023					
1515210 9-CC-C	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/05/2023					
1515211 10-CC-A	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/05/2023					
1515212 10-CC-B	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/05/2023					
1515213 10-CC-C	Concrete Chip	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/05/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.
37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258026
Client Project : 188BS23419
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
750 Skinner Dr., Kalamazoo , MI 49700

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515214 11-ASD-A	Asphalt Driveway	Black Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/05/2023					
1515215 11-ASD-B	Asphalt Driveway	Black Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/05/2023					
1515216 11-ASD-C	Asphalt Driveway	Black Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: Amanda Hanzel Date Analyzed : 06/05/2023					
1515217 12-WG-A	Window Glaze	White Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 95% Other	PLM 3% Chrysotile
Analyst: Amanda Hanzel Date Analyzed : 06/05/2023					
1515218 12-WG-B		Positive Stop			
Analyst: Amanda Hanzel Date Analyzed : 06/05/2023 Sample Not Analyzed					
1515219 12-WG-C		Positive Stop			
Analyst: Amanda Hanzel Date Analyzed : 06/05/2023 Sample Not Analyzed					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 609/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP Item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive
Romulus, Michigan 48174
(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258026

Client Project : 188BS23419

Date Collected : 05/24/2023

Date Received : 05/31/2023

Location :

750 Skinner Dr., Kalamazoo , MI 49700

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
--------	-------------	------------	-----------	---------------	------------

Analyst:

Madelaine Palmer

Lab Supervisor/Other Signatory

Amanda Hanzel

Amanda Hanzel

400 Point Count Results by EPA 600/R-93/116 PLM (denoted by "PC")
 Item 198.1: PLM Methods for Identifying and Quantitating Asbestos in Bulk Samples
 Item 198.6: PLM Methods for Identifying and Quantitating Asbestos in Non-Friable Organically Bound Bulk Samples
 EPA 600/R-93/116: Method for Determination of Asbestos in Bulk Building Materials
 EPA 600/M4-82-020: Interim Method for Determination of Asbestos in Bulk Insulation Samples
 A % Asbestos result of "Trace" indicates that the analyzed material was found to contain less than 1% asbestos and would not be considered an Asbestos Containing Material (ACM).

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

ENVIRONMENTAL TESTING LABORATORIES, INC



38900 HURON RIVER DRIVE
 ROMULUS, MICHIGAN 48174
 (734) 955-6600
 FAX: (734) 992-2261
 www.2etl.com

**Bulk Asbestos
 Chain of Custody**

ETL Project #: 258026

Client: Atlas Technical Consultants	Contact: Rob Smith Phone: 248-669-5140	Project Location/Name: 750 SKINNER DR. KALAMAZOO, MI 497
Address: 46555 Humboldt Dr. Ste. 100 Novi, MI 48377	Fax: 248-669-5147 E-mail:	Client Project #: 1885523419
Please Provide Results: <input checked="" type="checkbox"/> Email <input type="checkbox"/> Fax <input type="checkbox"/> Verbal <input type="checkbox"/> Other _____		Date Sampled: 5/24/2023

Turnaround Time (TAT): RUSH Same Day 24 hr 48 hr Standard (3-5 days) Other 72 hours

PLM Instructions
(Check all that apply)

<input checked="" type="checkbox"/> PLM EPA600/R-93/116, 1993 (Standard method)	<input checked="" type="checkbox"/> Stop at 1st Positive - <i>Clearly mark Homogenous Group</i>
Point Counting: <input type="checkbox"/> 400 Points* <input type="checkbox"/> NYSDOH ELAP 198.1, 2002*	
<input type="checkbox"/> Gravimetric Reduction* <input type="checkbox"/> NYSDOH ELAP 198.6, 2010*	
<input type="checkbox"/> PLM Non-Building Material (Dust, Wipe, Tape)	<input type="checkbox"/> Soil or Vermiculite Analysis*

* Additional charge and turnaround may be required

515

Lab ID	Sample ID	Material Description	Sample Location	Quantity
182, 183, 184	1-RM-A,B,C	Roofing Material	EA 5	
185, 186, 187	2-VP-A,B,C	Vapor paper (under wood siding)	EA 1,2,3,4	
188, 189, 190	3-EC-A,B,C	Exterior Caulk (on aluminium siding)	EA 1,2,3,4	
191, 192, 193	4-WG-A,B,C	Window Glaze (House)	EA 1,2,3,4	
194, 195, 196, 197, 198	5-PL-A,B,C,D,E	Plaster on Lath	FS 1,2,3	
199, 200, 201	6-TPL-A,B,C	Textured Plaster (on ceiling)	FS 3	
202, 203, 204	7-WBS-A,B,C	Wallboard System	FS 2	
205, 206, 207	8-BM-A,B,C	Brick Mortar (exterior)	EA 1,2,3,4	
208, 209, 210	9-CC-A,B,C	Concrete Chip (exterior)	EA 4	
211, 212, 213	10-CC-A,B,C	Concrete Chip (Steb boat is sitting on)	EA 2	
214, 215, 216	11-ASD-A,B,C	Asphalt Drive way (over concrete)	EA 4	
217, 218, 219	12-WG-A,B,C	Window Glaze (basement)	EA 1,2,3,4	

		Date	Time	
Relinquished (Name/Organization):	Corey Pruitt	5/26/2023	12:00 PM	am/pm
Received (Name/ETL):	<i>[Signature]</i>	5/31/23	3:21	am/pm
Sample Login (Name/ETL):	<i>[Signature]</i>	5/31/23	3:21	am/pm
Stereoscopic/Sample Analysis (Name/ETL):	Amanda Lynn Howard	06/05/23	12:00	am/pm
Results (Name/ETL):	Amanda Lynn Howard	06/05/23	12:00	am/pm
QV/QC Review (Name/ETL):	<i>[Signature]</i>	06/05/23	1:30	am/pm

<p>Special Instructions: • 1st Positive Stop; • Composite all drywall/joint compound samples if any layer of system is greater than 1% asbestos; • Point Count ALL PLASTER samples Trace to 3% asbestos content • Point Count ALL SAMPLES Trace to 1% asbestos content</p>	Remarks
--	----------------

**IN ORDER TO ENSURE RESULTS BY SPECIFIED TAT, THE LAB MUST BE EMAILED/CALLED WITH THE QUANTITY OF SAMPLES TO BE SHIPPED OR DROPPED OFF

ATTACHMENT B

PHOTOGRAPHS

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
750 SKINNER DR
KALAMZOO, MI 49001



Street view of the house located at 750 Skinner Drive (EA-1) / (EA-5)



View of the left side of the house (EA-2)

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
750 SKINNER DR
KALAMZOO, MI 49001



View of the rear of the house (EA-3)




View of the right side of the house (EA-4)

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
750 SKINNER DR
KALAMZOO, MI 49001



View of FS-1

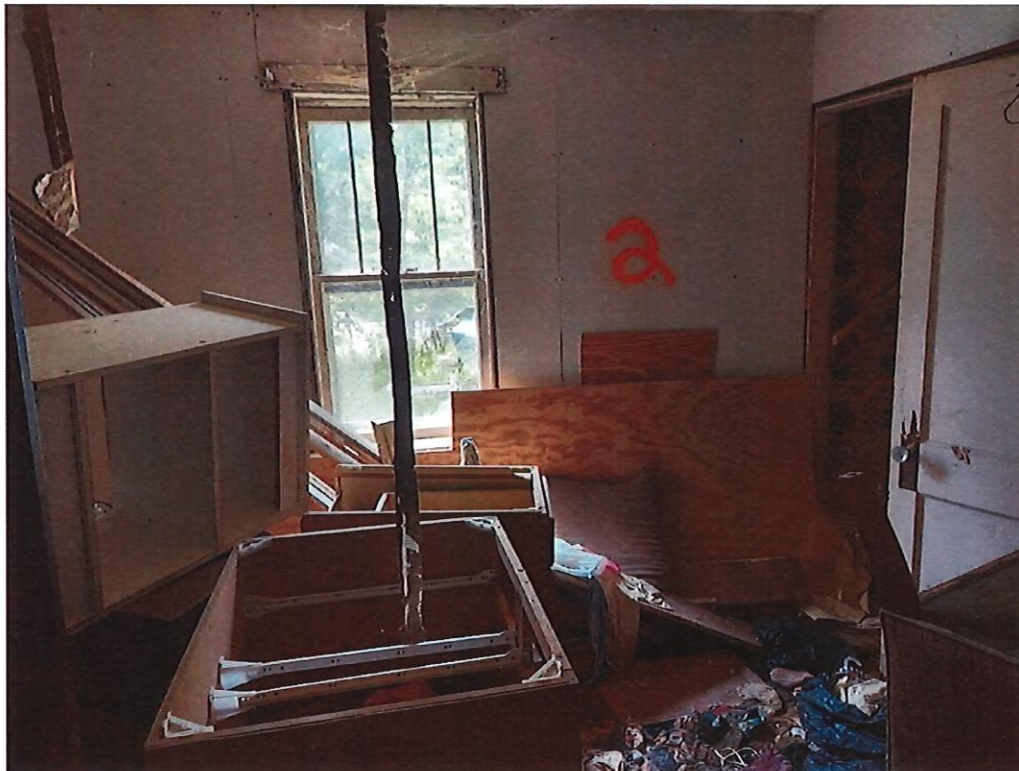

View of FS-2

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
750 SKINNER DR
KALAMZOO, MI 49001



View of FS-3



View of FS-4

ATTACHMENT C
FUNCTIONAL SPACE MAPS

Circle: (Attic) (1st Floor) (2nd Floor) (Basement) (Garage)

14

EA-5
ROOF

EA-2

EA-3

EA-4

FS-6

EA-1

29

Street Address: 750 Skinner

25

Inaccessible




Circle: (Attic) (1st Floor) (2nd Floor) (Basement) (Garage)-

N 4

EA-5
ROOF

EA-2

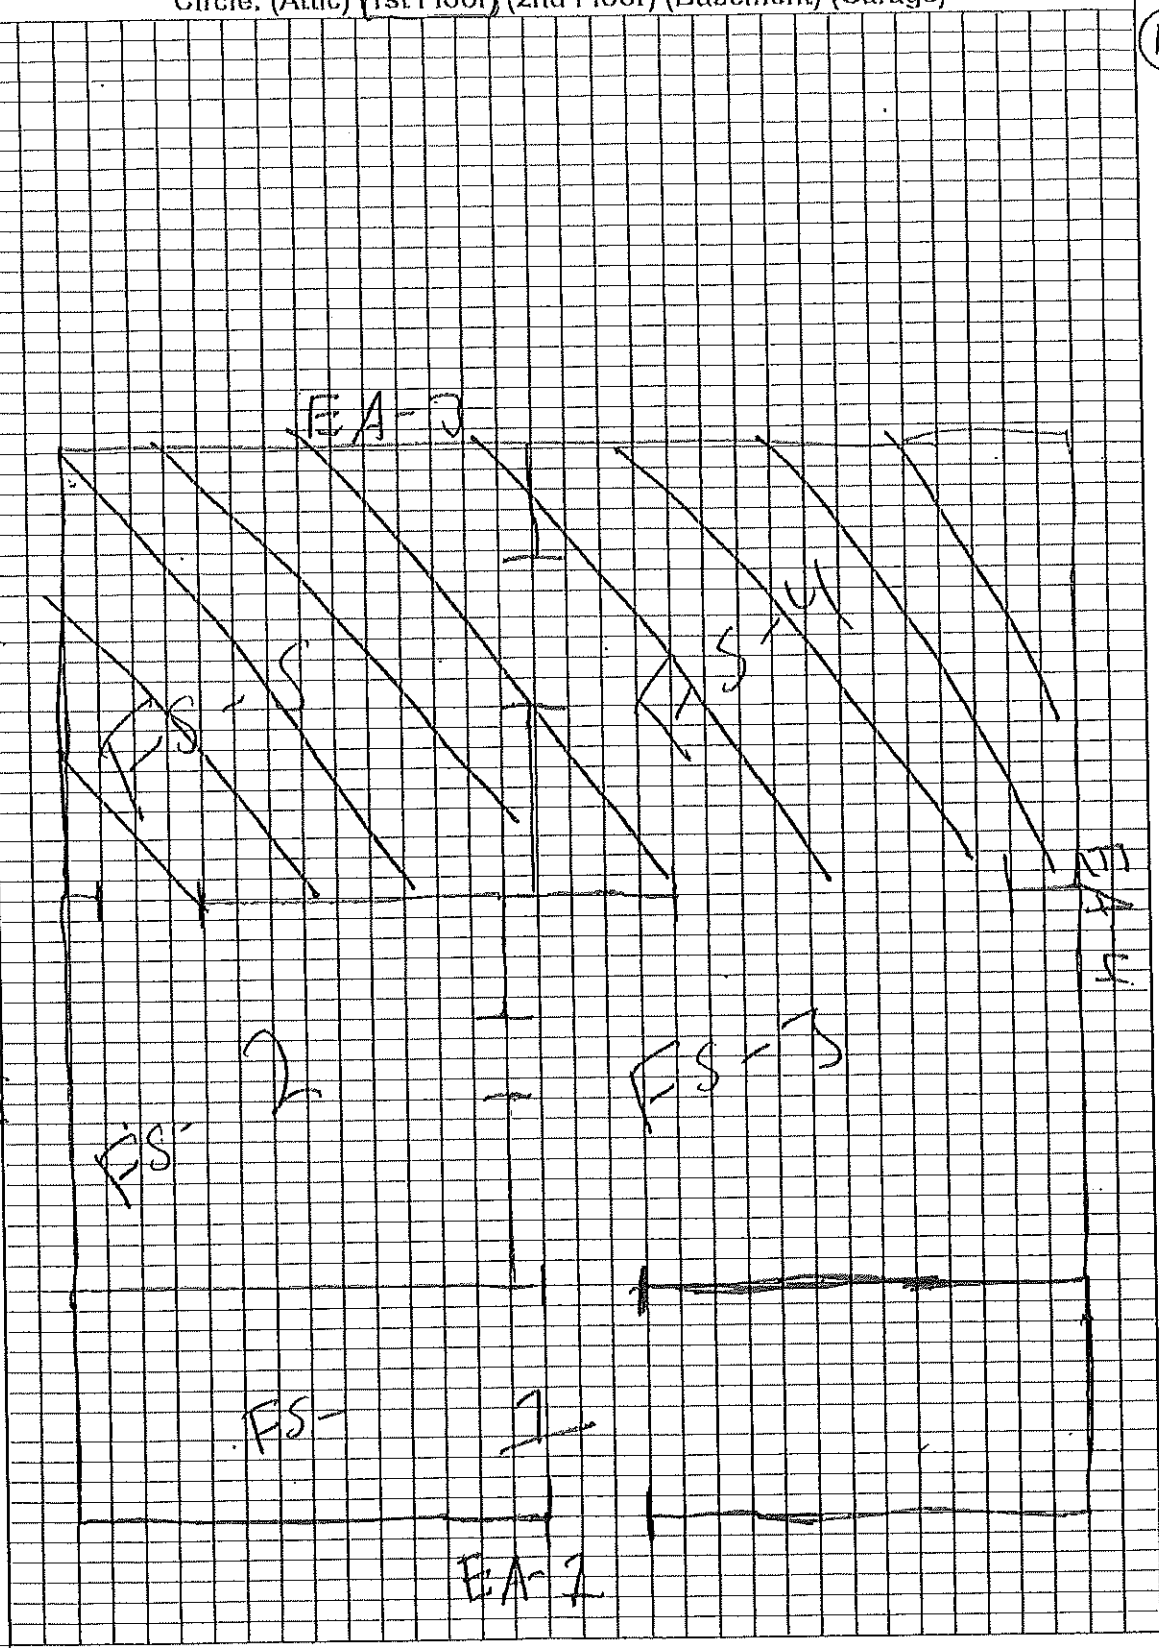

29

24

Street Address: 750 Slcinna

Inaccessible



Circle: (Attic) (1st Floor) (2nd Floor) (Basement) (Garage)



EA-5
ROOF

EA-3

EA-6

EA-2

FS-7

FS-8

EA-1

29

26


Street Address: 750 Skinner


Inaccessible





46555 Humboldt Dr. Ste. 100
Novi, MI 48377
(248) 669-5140 | oneatlas.com

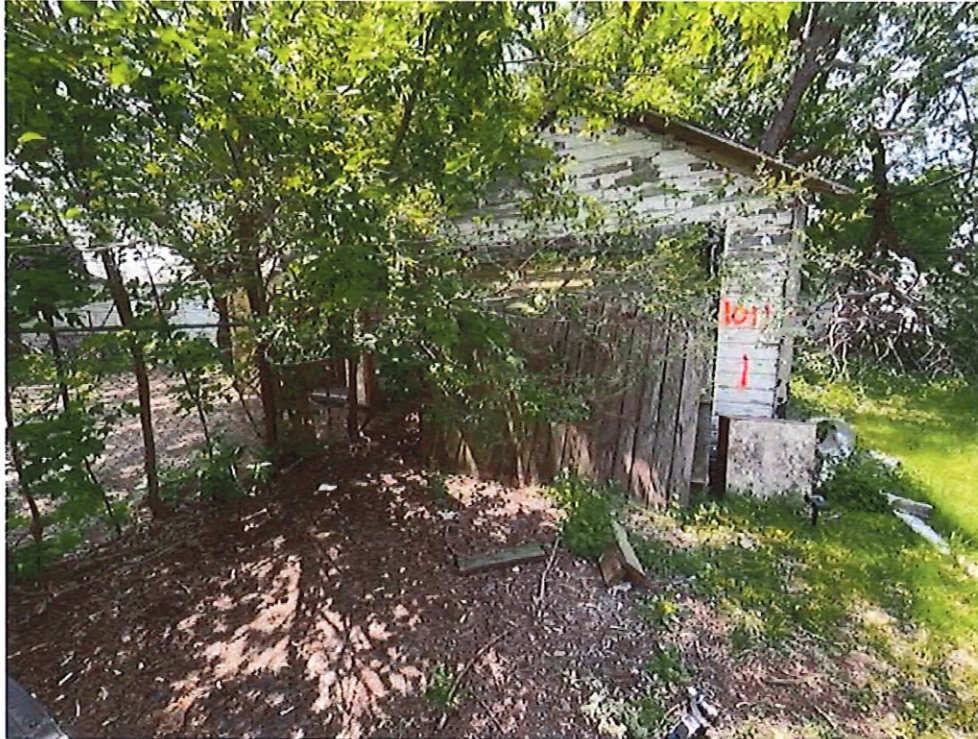

Client Name:	City of Kalamazoo
Project Name:	Commercial Building Asbestos Survey
Project Number:	188BS23418
Project Site Address (Subject Property):	1011 Cobb Street, Kalamazoo, MI 49700
Date of Site Visit:	May 24, 2023
Asbestos Inspection Performed by:	Corey Pruitt (A57116)
Asbestos Inspector's Signature:	
Areas Not Accessible:	Interior of garage was inaccessible
Number of Floors:	Garage Only
Asbestos Present (Yes/No/Other):	No asbestos identified in areas surveyed, however asbestos may be present in inaccessible areas.

On the date indicated above, State of Michigan Asbestos Inspector, Corey Pruitt (A57116) from Atlas Technical Consultants, conducted a pre-demolition asbestos and other regulated materials inspection of the subject unoccupied commercial property.

Table I identifies materials that were found to contain asbestos in concentrations greater than 1% and therefore are regulated under the rules of asbestos in the State of Michigan.

TABLE I
Asbestos-Containing Materials

ID#	MATERIAL	LOCATION	QUANTITY	RESULT	NESHAP CATEGOR Y
None Contain Asbestos					

The purpose of this inspection was to task an accredited asbestos inspector to complete a pre-demolition asbestos and hazardous material survey of the subject site, and provide recommendation options for removal and disposal of identified hazardous/regulated materials prior to demolition of the building(s). The asbestos inspection consisted of the following three basic procedures: conducting a visual inspection of the structure, identifying homogeneous areas (HAs) of suspect surfacing, thermal system insulation, and miscellaneous materials; and sampling identified friable and non-friable suspect materials.

Bulk samples of suspect ACMs were collected and placed into individual containers for transport under Chain of Custody (COC) to a National Voluntary Lab Accreditation Program (NVLAP)-accredited laboratory for analysis. Materials typically known as non-asbestos items (i.e. fibrous glass, foam rubber, wood, etc.) were not sampled.

Laboratory Reports and associated COC's are provided in **Attachment A**. Photographs of the site are included in **Attachment B**. The following sections summarize Atlas' findings.

Table II below identifies the suspect asbestos-containing materials identified during the survey, their locations, approximate quantity, type and percentage of asbestos.

TABLE II
Suspect Asbestos-Containing Materials

HA/ID#	MATERIAL	LOCATION	RESULT
1-RM-A,B,C	Roofing Material	EA 5	ND
2-VP-A,B,C	Vapor Paper (Under Roofing)	EA 5	ND
3-WG-A,B,C	Window Glaze	EA 5	ND

ND = No asbestos detected, NA = Not applicable, UNQ = Unquantified; PC = Point Count

No other suspect ACMs were observed on the site. Although not anticipated based on surface observations, underground structures that could contain ACM may be present and should be managed accordingly if encountered during site redevelopment.

Asbestos is a hazardous substance. Its condition, handling and disposal are regulated by federal, state, and local agencies. ACMs generally do not pose a health threat unless the asbestos fibers are disturbed, become airborne and are inhaled.

Contractors working in an area where asbestos is present must be informed of the type and location of ACMs. Abatement of ACMs, including non-friable ACMs, must be performed by a Michigan licensed, certified and

registered asbestos abatement contractor in accordance with state and federal Occupational Safety and Health Administration (OSHA) and local air quality management regulations.

Table III below lists Other Regulated Materials/Universal Wastes identified during the survey.

**TABLE III
Other Regulated Materials/Universal Wastes**

MATERIAL	LOCATION	APPROXIMATE QUANTITY
None Observed		

Table IV below lists the functional spaces identified during the survey.

**Table IV
Functional Space/ Exterior Area Designations**

DESCRIPTION	DESIGNATION
Roof	EA 5
Garage	FS-1
Exterior Area	EA 1,2,3,4

RECOMMENDATIONS:

Except for the following items listed below, Section 61.145(c) of the Asbestos NESHAP requires that each owner or operator of a demolition or demolition activity involving RACM remove all such material from a facility being demolished or renovated before any activity begins that would break up, dislodge, or similarly disturb the material or preclude access to the material for subsequent removal.

ACM need not be removed before demolition if it:

- (i) Is a Category I non-friable ACM that is not friable.
- (ii) Is on a facility component that is encased in concrete or other similarly hard material and is adequately wet whenever exposed during demolition.
- (iii) Was not accessible for testing and therefore was not discovered until after demolition began and, as a result of the demolition, cannot be safely removed. If not removed for safety reasons, the exposed RACM and any asbestos-contaminated debris must be treated as asbestos-containing waste material and kept adequately wet at all times until disposed of.
- (iv) Is a Category II non-friable ACM and the probability is low that the material will become crumbled, pulverized, or reduced to powder during demolition.

Demolition with Roofing Materials in place is covered under the NESHAP regulations (40 CFR Part 61 Subpart M).

Roofing materials that were not tested during this inspection should be assumed to be Category I asbestos-containing roofing materials.

Since demolition activities do not include sanding, grinding, cutting, or abrading, Category I asbestos-containing roofing materials not in poor condition and not friable are not considered RACM, and are allowed to

remain in place during demolition.

If the asbestos-containing roofing material is not in poor condition and is not friable, it may be disposed of in a landfill which accepts ordinary demolition waste.

The asbestos-containing roofing material may not be ground up for recycling into other products.

*If joint compound within the drywall system is identified as positive, a composite sample was analyzed per NESHAP. If the drywall system as a composite sample is less than 1% asbestos, the material is not considered RACM per NESHAP. However, OSHA requirements regarding materials containing less than 1% asbestos still apply, and contractors performing work should ensure they comply with the requirements if the material is not removed prior to demolition.

In addition, contractors should ensure they follow all OSHA regulations pertaining to demolition / demolition of Category I Asbestos-containing materials. Category I or II non-friable ACM that is not subject to 61.150(a)(3) would still have to be disposed of in a landfill that accepts building debris, in a landfill that operates in accordance with 61.154, or at a facility that operates in accordance with 61.155.

Prior to demolition, the following is recommended:

An asbestos abatement company, licensed in the State of Michigan should remove the materials identified as asbestos containing in Table I in accordance with all applicable Local, State, and Federal Requirements prior to demolition.

Other Regulated Materials/Universal Wastes, identified in Table III, must be transported and disposed in accordance with all applicable Local, State, and Federal Requirements prior to demolition.

LIMITATIONS:

The results, findings, conclusions, and recommendations expressed in the report are based only on conditions that were noted during Atlas' inspection of the vacant above-referenced property located in Kalamazoo, Michigan.

Any conditions or materials that could not be visually identified through limited destructive sampling were not inspected and may differ from those conditions or materials noted. The user of this report should keep in mind that conditions may change with time and observations made by Atlas at the time of the site reconnaissance may not be consistent with future observations made by others.

Additional materials may be encountered during the demolition process and may require further sampling to determine disposal criteria.

The report is designed to aid the building owner, architect, construction manager, general contractors, and potential asbestos abatement contractors in locating asbestos building materials and Other Regulated Materials/Universal Wastes to be removed prior to demolition activities.

Under no circumstances is the report to be utilized as a bidding document or as a project specification document. Contractors bidding the demolition of this site should field-verify project information.

Atlas appreciates the opportunity to be of service to the City of Kalamazoo on this project. In the meantime, if you have questions regarding the information in this report or if we can be of further assistance do not hesitate to contact our office at (248) 669-5140.

ATTACHMENT A
LABORATORY REPORTS AND CHAIN OF CUSTODY



ENVIRONMENTAL TESTING LABORATORIES, INC.

37575 W HURON RIVER DRIVE
ROMULUS, MICHIGAN 48174
(734) 955-6600
FAX: (734) 955-6604

To: Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job: 258025
Client Project: 188BS23418

Attention: Robert Smith
Project Location: 1011 Cobb St. , Kalamazoo , MI 49700

Lab Sample Number	Client Sample Number	Sample Type	Completed
1515173	1-RM-A	Asbestos	06/05/2023
1515174	1-RM-B	Asbestos	06/05/2023
1515175	1-RM-C	Asbestos	06/05/2023
1515176	2-VP-A	Asbestos	06/05/2023
1515177	2-VP-B	Asbestos	06/05/2023
1515178	2-VP-C	Asbestos	06/05/2023
1515179	3-WG-A	Asbestos	06/05/2023
1515180	3-WG-B	Asbestos	06/05/2023
1515181	3-WG-C	Asbestos	06/05/2023

Reviewed by: *Madeline Palmer*
Madeline Palmer

Summary

Method	Sample	Layer	Mastic
PLM	9	3	



Certificate of Analysis

Environmental Testing Laboratories, Inc.
 37575 W Huron River Drive
 Romulus, Michigan 48174
 (734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 258025
 Client Project : 188BS23418
 Date Collected : 05/24/2023
 Date Received : 05/31/2023

Location :
 1011 Cobb St. , Kalamazoo , MI 49700

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515173 1-RM-A	Roofing Material	Black Non-Fibrous Homogenous	PLM 6% Cellulose	PLM 94% Other	PLM None Detected
Layer-1 Analyst: OJ Ivey Date Analyzed : 06/05/2023					
1515173 1-RM-A	Felt	Black Non-Fibrous Homogenous	PLM 3% Cellulose	PLM 97% Other	PLM None Detected
Layer-2 Analyst: OJ Ivey Date Analyzed : 06/05/2023					
1515174 1-RM-B	Roofing Material	Black Non-Fibrous Homogenous	PLM 9% Cellulose	PLM 91% Other	PLM None Detected
Layer-1 Analyst: OJ Ivey Date Analyzed : 06/05/2023					
1515174 1-RM-B	Felt	Black Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-2 Analyst: OJ Ivey Date Analyzed : 06/05/2023					
1515175 1-RM-C	Roofing Material	Black Non-Fibrous Homogenous	PLM 10% Cellulose	PLM 90% Other	PLM None Detected
Layer-1 Analyst: OJ Ivey Date Analyzed : 06/05/2023					
1515175 1-RM-C	Felt	Black Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Layer-2 Analyst: OJ Ivey Date Analyzed : 06/05/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP Item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



Certificate of Analysis

Environmental Testing Laboratories, Inc.
 37575 W Huron River Drive
 Romulus, Michigan 48174
 (734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
 46555 Humboldt Dr. Suite 100
 Novi, Michigan 48377

ETL Job : 258025
 Client Project : 188BS23418
 Date Collected : 05/24/2023
 Date Received : 05/31/2023

Location :
 1011 Cobb St. , Kalamazoo , MI 49700

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
1515176 2-VP-A	Vapor Paper, (under roofing)	Black Fibrous Homogenous	PLM 15% Cellulose	PLM 85% Other	PLM None Detected
Analyst: OJ Ivey Date Analyzed : 06/05/2023					
1515177 2-VP-B	Vapor Paper, (under roofing)	Black Fibrous Homogenous	PLM 15% Cellulose	PLM 85% Other	PLM None Detected
Analyst: OJ Ivey Date Analyzed : 06/05/2023					
1515178 2-VP-C	Vapor Paper, (under roofing)	Black Fibrous Homogenous	PLM 20% Cellulose	PLM 80% Other	PLM None Detected
Analyst: OJ Ivey Date Analyzed : 06/05/2023					
1515179 3-WG-A	Window Glaze	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: OJ Ivey Date Analyzed : 06/05/2023					
1515180 3-WG-B	Window Glaze	Gray Non-Fibrous Homogenous	PLM 2% Cellulose	PLM 98% Other	PLM None Detected
Analyst: OJ Ivey Date Analyzed : 06/05/2023					
1515181 3-WG-C	Window Glaze	Gray Non-Fibrous Homogenous	PLM 1% Cellulose	PLM 99% Other	PLM None Detected
Analyst: OJ Ivey Date Analyzed : 06/05/2023					

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.



SAFETY CODE 2022-0

Certificate of Analysis

Environmental Testing Laboratories, Inc.



37575 W Huron River Drive

Romulus, Michigan 48174

(734) 955-6600, Fax: (734) 955-6604

Polarized Light Microscopy Asbestos Analysis Report

To : Atlas - Novi
46555 Humboldt Dr. Suite 100
Novi, Michigan 48377

ETL Job : 258025
Client Project : 188BS23418
Date Collected : 05/24/2023
Date Received : 05/31/2023

Location :
1011 Cobb St. , Kalamazoo , MI 49700

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
--------	-------------	------------	-----------	---------------	------------

Lab Supervisor/Other Signatory

Analyst:

OJ Ivey

400 Point Count Results by EPA 600/R-93/116 PLM (denoted by "PC")
 Item 198.1: PLM Methods for Identifying and Quantitating Asbestos in Bulk Samples
 Item 198.6: PLM Methods for Identifying and Quantitating Asbestos in Non-Friable Organically Bound Bulk Samples
 EPA 600/R-93/116: Method for Determination of Asbestos in Bulk Building Materials
 EPA 600/M4-82-020: Interim Method for Determination of Asbestos in Bulk Insulation Samples
 A % Asbestos result of "Trace" indicates that the analyzed material was found to contain less than 1% asbestos and would not be considered an Asbestos Containing Material (ACM).

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested. An estimate of uncertainty can be provided at the client's request.

ENVIRONMENTAL TESTING LABORATORIES, INC

38900 HURON RIVER DRIVE
 ROMULUS, MICHIGAN 48174
 (734) 955-6600
 FAX: (734) 992-2261
 www.2ell.com



**Bulk Asbestos
 Chain of Custody**

ETL Project #: 258025

Client: Atlas Technical Consultants	Contact: Rob Smith Phone: 248-669-5140	Project Location/Name: 1011 COBB ST. KALAMAZOO, MI 49704
Address: 46555 Humboldt Dr. Ste. 100 Novi, MI 48377	Fax: 248-669-5147 E-mail:	Client Project #: 188BS23418
Please Provide Results: <input checked="" type="checkbox"/> Email <input type="checkbox"/> Fax <input type="checkbox"/> Verbal <input type="checkbox"/> Other _____		Date Sampled: 5/24/2023

Turnaround Time (TAT): RUSH Same Day 24 hr 48 hr Standard (3-5 days) Other 72 hours

PLM Instructions
(Check all that apply)

<input checked="" type="checkbox"/> PLM EPA600/R-93/116, 1993 (Standard method)	<input checked="" type="checkbox"/> Stop at 1st Positive - <i>Clearly mark Homogenous Group</i>
Point Counting: <input type="checkbox"/> 400 Points* <input type="checkbox"/> NYSDOH ELAP 198.1, 2002*	
<input type="checkbox"/> Gravimetric Reduction* <input type="checkbox"/> NYSDOH ELAP 198.6, 2010*	
<input type="checkbox"/> PLM Non-Building Material (Dust, Wipe, Tape)	<input type="checkbox"/> Soil or Vermiculite Analysis*

* Additional charge and turnaround may be required

Lab ID	Sample ID	Material Description	Sample Location	Quantity
1515173174 175	1-RM-A,B,C	Roofing Material	EA 5	
176,177 178	2-VP-A,B,C	Vapor Paper (under roofing)	EA 5	
179,180 181	3-WG-A,B,C	Window Glaze	EA 4	


	Date	Time
Relinquished (Name/Organization):		
Received (Name/ETL):	5-31-23	3:13 am/pm
Sample Login (Name/ETL):	5-31-23	3:13 am/pm
Stereoscopic/Sample Analysis (Name/ETL):	6-5-23	1:47 am/pm
Results (Name/ETL):	6-5-23	1:47 am/pm
QA/QC Review (Name/ETL):	6-5-23	3:09 am/pm

<p>Special Instructions: 1st Positive Stop; • Composite all drywall/joint compound samples if any layer of system is greater than 1% asbestos; • Point Count ALL PLASTER samples Trace to 3% asbestos content • Point Count ALL SAMPLES Trace to 1% asbestos content</p>	Remarks
--	---------

**IN ORDER TO ENSURE RESULTS BY SPECIFIED TAT, THE LAB MUST BE EMAILED/CALLED WITH THE QUANTITY OF SAMPLES TO BE SHIPPED OR DROPPED OFF

ATTACHMENT B
PHOTOGRAPHS

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
1011 COBB STREET
KALAMAZOO, MI 49007

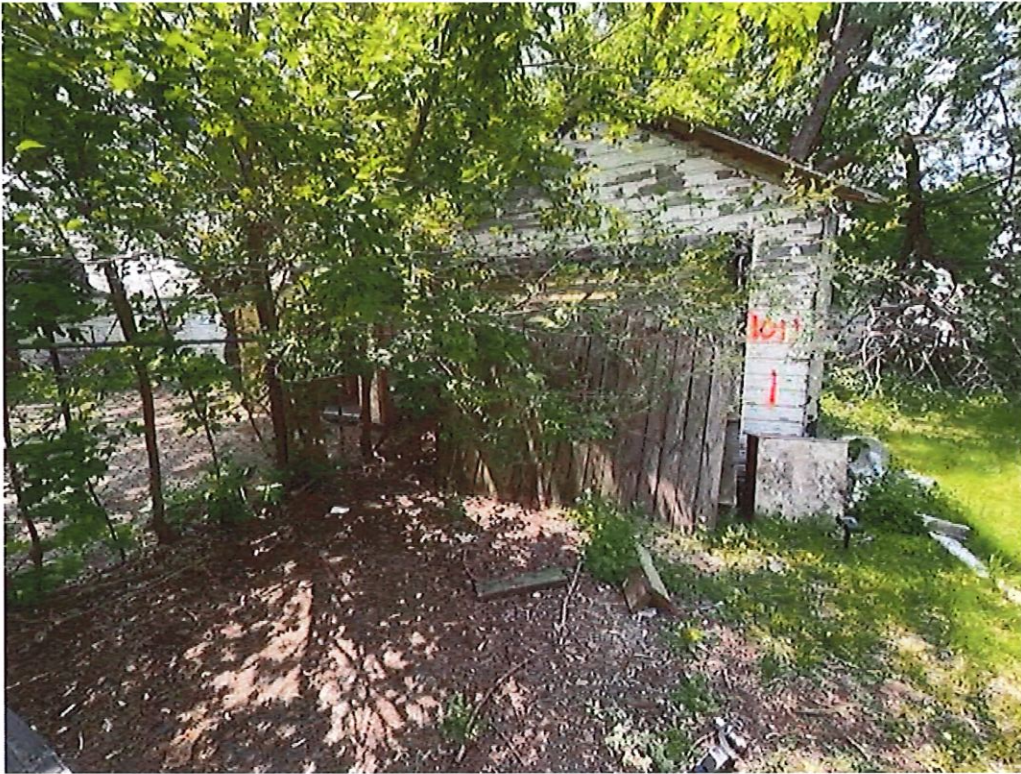

Street view of the house located at 1011 Cobb Street (EA-1) / (EA-5)




View of the left side of the house (EA-2)

ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
1011 COBB STREET
KALAMAZOO, MI 49007



View of the rear of the house (EA-3)

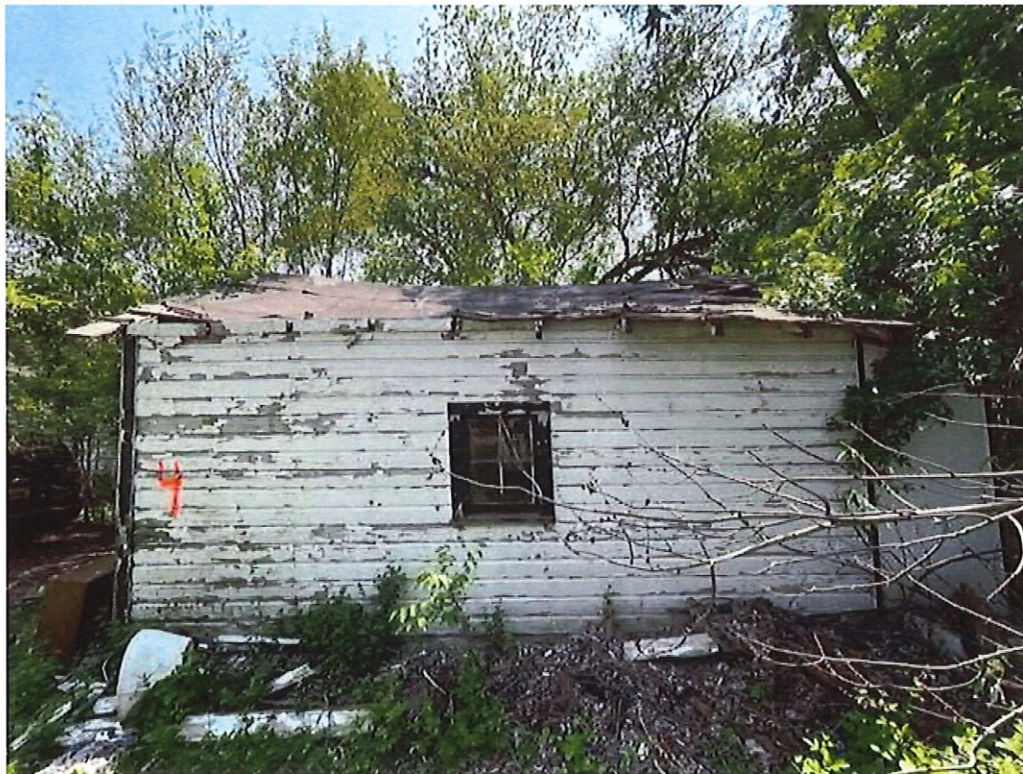

View of the right side of the house (EA-4)


ASBESTOS-CONTAINING MATERIAL SURVEY
VACANT RESIDENTIAL PROPERTY
1011 COBB STREET
KALAMAZOO, MI 49007




View of FS-1

ATTACHMENT C
FUNCTIONAL SPACE MAPS

Circle: (Attic) (1st Floor) (2nd Floor) (Basement) (Garage)



EA5
ROOF

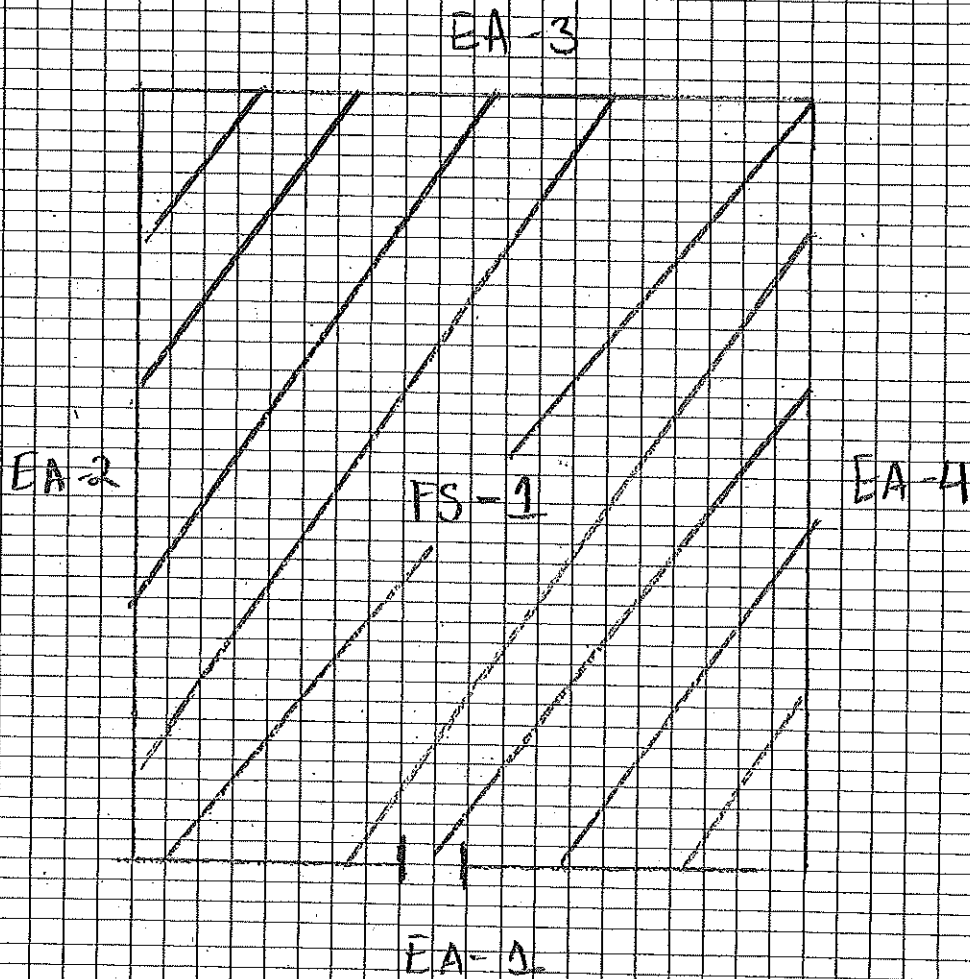

Cobb St

Street Address: 1011 Cobb

12

Inaccessible



20